

# *User's Manual*

GB

## *Measuring centres MC3x0x series*

**Energy Meter – MC320**






















































**Multimeter – MC330**




















































**Network Recorder – MC350 & MC350H**



# TABLE OF CONTENTS

<b>SECURITY ADVICE AND WARNINGS</b> .....	<b>1</b>
<b>WARNINGS, INFORMATION AND NOTES REGARDING DESIGNATION OF THE PRODUCT</b> .....	<b>2</b>
<i>Contents of consignment</i> .....	2
<b>BEFORE SWITCHING THE DEVICE ON</b> .....	<b>3</b>
<b>DEVICE SWITCH OFF WARNING</b> .....	<b>4</b>
<b>HEALTH AND SAFETY</b> .....	<b>5</b>
<b>REAL TIME CLOCK</b> .....	<b>6</b>
<b>DISPOSAL</b> .....	<b>7</b>
<b>BASIC DESCRIPTION AND OPERATION</b> .....	<b>8</b>
INTRODUCTION .....	8
<i>Description of symbols</i> .....	8
GLOSSARY .....	9
DESCRIPTION OF THE PRODUCT .....	10
<i>Appearance</i> .....	10
PURPOSE AND USE OF DIFFERENT TYPES OF MEASURING CENTERS .....	10
<i>Energy meter MC320</i> .....	10
<i>Multifunction meter MC330</i> .....	10
<i>Network Recorder MC350 &amp; MC350H</i> .....	11
TYPE DIFFERENCES.....	11
<i>Differences in hardware</i> .....	11
<i>Software functions</i> .....	11
<i>Supported measurements</i> .....	12
<b>CONNECTION</b> .....	<b>13</b>
INTRODUCTION .....	13
MOUNTING .....	14
ELECTRIC CONNECTION.....	15
CONNECTION OF INPUT/OUTPUT MODULES .....	16
COMMUNICATION CONNECTION .....	17
<i>RS232</i> .....	17
<i>RS485</i> .....	17
<i>M-Bus (MC350 and MC350H only)</i> .....	17
<i>USB</i> .....	18
<i>Service USB (MC320 and MC330 only)</i> .....	18
<i>Profibus (MC330, MC350 and MC350H only)</i> .....	17
<i>Survey of communication connection</i> .....	19
CONNECTION OF POWER SUPPLY .....	19

<b>FIRST STEPS</b> .....	<b>20</b>
INTRODUCTION .....	20
<i>Basic concepts</i>  .....	20
<i>Installation wizard</i>  .....	21
DISPLAY OF DEVICE INFO .....	22
<i>Welcome screen</i>  .....	22
<i>Information</i>   .....	22
<i>Meaning of icons</i>  .....	22
<b>SETTINGS</b> .....	<b>23</b>
INTRODUCTION .....	23
MIQEN SOFTWARE .....	23
<i>Devices management</i> .....	23
<i>Device settings</i> .....	23
<i>Real-time measurements</i> .....	23
<i>Data analysis</i> .....	23
<i>Software upgrading</i> .....	24
SETTING PROCEDURE .....	24
GENERAL SETTINGS .....	25
<i>Description and Location</i>  .....	25
<i>Average interval</i>   .....	25
<i>Language</i>   .....	25
<i>Temperature unit</i>   .....	25
<i>Date format (MC350 and MC350H only)</i>   .....	25
<i>Date and time (MC350 and MC350H only)</i>   .....	25
<i>Auto Summer/Winter time (MC350 and MC350H only)</i>   .....	25
<i>Maximum demand (MD) time constant (MC350, MC350H and MC330 only)</i>   .....	26
<i>Starting current for PF and PA (mA) (MC350, MC350H and MC330 only)</i>  .....	26
<i>Starting current for all powers (mA)</i>  .....	26
<i>Starting voltage for all powers</i>  .....	26
<i>Starting voltage for SYNC (MC350, MC350H and MC330 only)</i>  .....	26
<i>Reactive power and energy calculation</i>  .....	27
CONNECTION .....	27
<i>Connection</i>   .....	27
<i>Setting of current and voltage ratios</i>   .....	27
<i>Used voltage and current range (MC350, MC350H and MC330 only)</i>  .....	27
<i>Nominal frequency (MC350, MC350H and MC330 only)</i>  .....	27
<i>Wrong connection warning</i>  .....	28
<i>Energy flow direction</i>  .....	28
<i>CT connection</i>  .....	28
COMMUNICATION .....	28
<i>Serial Communication</i>   .....	28
<i>USB Communication</i>  .....	28
<i>Service USB Communication (MC330 and MC320 only)</i>  .....	28
<i>PROFIBUS Communication</i>  .....	28
<i>M-Bus Communication</i>  .....	28
DISPLAY .....	29
<i>Display settings</i>   .....	29
<i>Demo cycling period</i>   .....	29
<i>Settings of customized screens (MC350, MC350H and MC330 only)</i>   .....	29
SECURITY .....	30
<i>Password setting</i>   .....	30
<i>Password modification</i>   .....	30
<i>Password disabling</i>   .....	30
<i>Password and language</i> .....	31

ENERGY - COUNTERS.....	31
Active tariff  	31
Common Energy Exponent (Common Energy Counter Resolution – MiQen 2.x and above).....	31
Counter divider (Individual counter Resolution – MiQen 2.x and above).....	32
Tariff clock 	32
Counter measured quantity 	33
INPUTS AND OUTPUTS .....	33
Pulse (SO) module  	34
Relay (alarm) module (MC350, MC350H and MC330 only)  	34
Functions of output modules (Pulse and Relay)  	34
Digital input module 	35
Tariff input module 	35
ALARMS (MC350, MC350H AND MC330 ONLY) .....	36
Alarms setting 	36
Alarms setting 	36
Types of alarms .....	36
MEMORY (MC350 AND MC350H ONLY).....	37
Memory division 	37
Memory operation  	37
Memory clearing 	37
Recorders A and B setting 	37
RESET OPERATIONS.....	38
Reset energy counters (E1, E2, E3, E4)  	38
Reset maximal MD values (MC350, MC350H and MC330 only)  	38
Reset the last MD period (MC350 and MC330 only)  	38
Alarm relay (1 or 2) Off (MC350 and MC330 only)  	38
Reset alarm statistic 	38
<b>MEASUREMENTS.....</b>	<b>39</b>
INTRODUCTION .....	39
SUPPORTED MEASUREMENTS .....	39
AVAILABLE CONNECTIONS .....	39
Survey of supported measurements regarding connection mode .....	39
EXPLANATION OF BASIC CONCEPTS.....	41
Sample factor – MV.....	41
Average interval – MP.....	41
Power and energy flow .....	41
PRESENT VALUES.....	42
CALCULATION AND DISPLAY OF MEASUREMENTS.....	42
Voltage  	43
Current  	43
Active, reactive and apparent power  	43
Power factor and power angle  	43
Frequency  	44
Energy  	44
MD values  	44
THD - Total harmonic distortion  	44
Customized screens  	44
Overview  	44
ALARMS .....	46
Survey of alarms  	46
DEMONSTRATION MEASUREMENTS.....	46
Demo cycling 	46

<b>TECHNICAL DATA.....</b>	<b>47</b>
ACCURACY .....	47
INPUTS.....	48
<i>Voltage input.....</i>	<i>48</i>
<i>Current input.....</i>	<i>48</i>
<i>Frequency.....</i>	<i>48</i>
<i>Supply.....</i>	<i>48</i>
CONNECTION .....	48
<i>Permitted conductor cross-sections .....</i>	<i>48</i>
MODULES.....	49
<i>Relay output.....</i>	<i>49</i>
<i>S0 (pulse) output .....</i>	<i>49</i>
<i>Tariff input module .....</i>	<i>49</i>
<i>Digital input module.....</i>	<i>49</i>
<i>Analogue output .....</i>	<i>49</i>
COMMUNICATION.....	50
ELECTRONIC FEATURES .....	50
<i>LCD .....</i>	<i>50</i>
<i>Response time .....</i>	<i>50</i>
<i>Memory (MC350 &amp; MC350H only).....</i>	<i>50</i>
<i>LED's.....</i>	<i>50</i>
<i>RTC backup supply .....</i>	<i>50</i>
SAFETY FEATURES.....	51
<i>Safety .....</i>	<i>51</i>
<i>Test voltage.....</i>	<i>51</i>
<i>EMC.....</i>	<i>51</i>
<i>Protection.....</i>	<i>51</i>
<i>Ambient conditions .....</i>	<i>51</i>
<i>Enclosure.....</i>	<i>51</i>
DIMENSIONS.....	52
<b>APPENDIX A: MODBUS PROTOCOL .....</b>	<b>53</b>
MODBUS COMMUNICATION PROTOCOL.....	53
<i>Modbus protocol.....</i>	<i>53</i>
<i>Register table for the normalized actual measurements .....</i>	<i>55</i>
<i>100% values calculations for normalized measurements .....</i>	<i>57</i>
<i>Register table for the basic settings.....</i>	<i>57</i>
<i>Data types decoding .....</i>	<i>58</i>
<b>APPENDIX B: DNP3 COMMUNICATION PROTOCOL.....</b>	<b>59</b>
DNP3 COMMUNICATION PROTOCOL.....	59
<i>DNP3 .....</i>	<i>59</i>
<i>Register table for the actual measurements.....</i>	<i>60</i>
<b>APPENDIX C: PROFIBUS PROTOCOL.....</b>	<b>63</b>
PROFIBUS OVERVIEW .....	63
<i>Structure of the input/output telegram .....</i>	<i>63</i>
<i>Telegrams table for the actual measurements .....</i>	<i>65</i>

<b>APPENDIX D: M-BUS</b> .....	<b>68</b>
COMMUNICATION SETTINGS.....	68
COMMAND TELEGRAMS .....	68
Initialize M-Bus (SNK_NKE) .....	68
Select M-BUS MC350 Using Secondary Address (SND_UD) .....	68
Transmit Read-out Data via Primary / Secondary Address (REQ_UD2).....	68
Set Baud Rate via Primary / Secondary Address (SND_UD).....	69
Set Primary Address via Primary / Secondary Address (SND_UD) .....	69
Set Secondary Address via Primary / Secondary Address (SND_UD) .....	69
Reset, Restart M-BUS MC350 via Primary / Secondary Address (SND_UD).....	69
M-BUS TELEGRAMS .....	69
Total Energy counters 0,1,2,3 .....	69
Active Tariff number.....	69
Active Power Total Pt (W) .....	70
Reactive Power Total (kvar) .....	70
Instant Apparent Power Total (VA) .....	70
Power Factor: -: leading et +: lagging: PF .....	70
Current Total (A).....	70
System frequency (Hz/1000) .....	70
Active Power in Phase 1,2,3 (W) .....	70
Current in Phase 1,2,3, Neutral (A) .....	71
Voltages (V).....	71
<b>APPENDIX E: CALCULATIONS &amp; EQUATIONS</b> .....	<b>72</b>
CALCULATIONS .....	72
Definitions of symbols .....	72
EQUATIONS .....	72
Voltage.....	72
Current .....	73
Power .....	73
THD.....	74






# SECURITY ADVICE AND WARNINGS

Please read this chapter carefully before starting work with a Measuring centre.



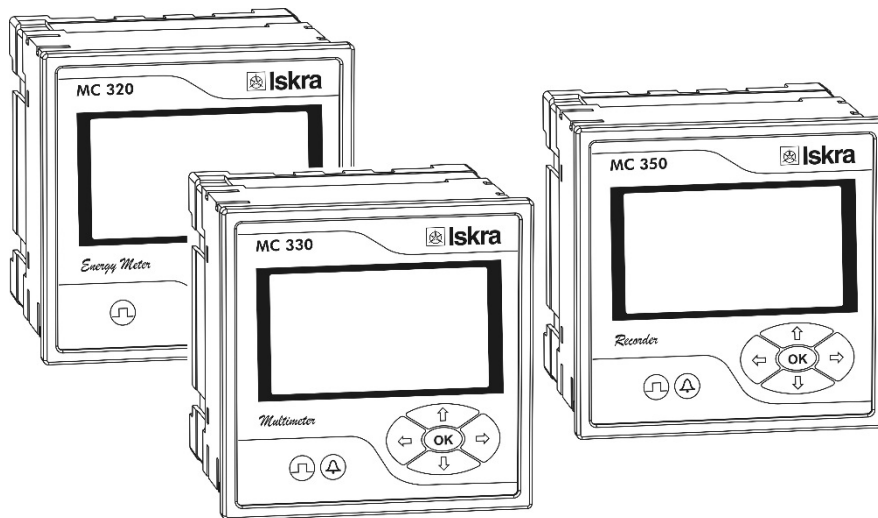


This chapter deals with important information and warnings that should be considered for safe work with a Measuring centre.

This booklet contains instructions for installation and use of Measuring centres MC320, MC330, MC350 & MC350H. Installation and use of devices also includes work with dangerous currents and voltages, therefore such work shall be carried out by qualified persons. The *ISKRA, d.d.* Company assumes no responsibility in connection with installation and use of the product. If there is any doubt regarding installation and use of the system in which the instrument is used for measuring or supervision, please contact a person who is responsible for installation of such system.



# WARNINGS, INFORMATION AND NOTES REGARDING DESIGNATION OF THE PRODUCT

Used symbols on devices' housing:

	<p>See product documentation.</p>
	<p>Double insulation in compliance with the <b>EN 61010-1</b> standard.</p>
	<p>Functional ground potential. Note: This symbol is also used for marking a terminal for protective ground potential if it is used as a part of connection terminal or auxiliary supply terminals.</p>
	<p>Compliance of the product with directive 2002/96/EC, as first priority, the prevention of waste electrical and electronic equipment (WEEE), and in addition, the reuse, recycling and other forms of recovery of such wastes so as to reduce the disposal of waste. It also seeks to improve the environmental performance of all operators involved in the life cycle of electrical and electronic equipment.</p>
	<p>Compliance of the product with European CE directives.</p>

## Contents of consignment

The consignment includes:

- Measuring centres MC320, MC330, MC350 and MC350H
- Quick Guide

# BEFORE SWITCHING THE DEVICE ON

Check the following before switching on the device:

- Nominal voltage,
- Supply voltage,
- Nominal frequency,
- Voltage ratio and phase sequence,
- Current transformer ratio and terminals integrity,
- Protection fuse (recommended maximal external fuse size is 6 A – a type with a red dot or equivalent),
- Integrity of earth terminals (where necessary)



## CAUTION

A current transformer secondary should be short circuited before connecting the meter.

# DEVICE SWITCH OFF WARNING

Auxiliary supply circuits for (external) relays can include capacitors between supply and ground. In order to prevent electrical shock hazard, the capacitors should be discharged via external terminals after having completely disconnected auxiliary supply (both poles of any DC supply).

# HEALTH AND SAFETY

The purpose of this chapter is to provide a user with information on safe installation and handling with the product in order to assure its correct use and continuous operation.

We expect that everyone using the product will be familiar with the contents of chapter »Security Advices and Warnings«.

If equipment is used in a manner not specified by the manufacturer, the protection provided by the equipment may be impaired.

# REAL TIME CLOCK

As a backup power supply for Real time clock supercap is built in. Support time is up to 2 days (after each power supply down).

# DISPOSAL

It is forbidden to deposit electrical and electronic equipment as municipal waste. The manufacturer or provider shall take waste electrical and electronic equipment free of charge. The complete procedure after lifetime should comply with the Directive EZ 2002/96/EG about restriction on the use of certain hazardous substances in electrical and electronic equipment or a corresponding Url 118/04.

# BASIC DESCRIPTION AND OPERATION

## Introduction

Regarding the type of a Measuring centre different chapters should be considered since the types differ in functionality and design. More detailed description of device functions is given in chapter *Type differences*, pages 11. All types of measuring centres are available in DIN housing.

## Description of symbols

In different chapters or tables different symbols may appear in User's Manual. According to the position of symbols, they have different meaning.

### SUBCHAPTER

Symbols next to the subchapters indicate accessibility of functions described. Accessibility of functions is indicated with the following symbols:



- Function accessible via communication (MiQen software)




- Function accessible via navigation keys on the device front side

### TABLES

Supported functions and measurements are listed in tables for all types. Symbols in tables indicate support of enabled functions for each type. Additionally a legend is placed below table of used symbols. Meaning of symbols is:

- - Function is supported
- × - Function is not supported
- - Symbol meaning varies and is described in the legend below the table



For all unknown technical words see chapter Glossary on next page.




## Glossary

Term	Explanation
AC	Alternating voltage
Hand-over place	Connection spot of consumer installation in public network
Hysteresis expressed as percentage [%]	Percentage specifies increase or decrease of a measurement from a certain limit after exceeding it.
MD	Measurement of average values in time interval
MiQen	Software for <i>Iskra, d.d.</i> instruments
MODBUS	Industrial protocol for data transmission
Profibus	Industrial protocol standardized as IEC 61158
M-Bus	Industrial protocol fully complies with M-BUS European standard EN13757-2
$M_p$ – Average interval	Defines frequency of refreshing displayed measurements on the basis of a Sample factor
$M_v$ – Sample factor	Defines a number of periods for measuring calculation on the basis of measured frequency
PA total	Angle calculated from total active and apparent power
PA1, PA2, PA3	Angle between fundamental phase voltage and phase current
PF	Power factor
RMS	Root Mean Square value
RTC	Real time clock
THD	Total harmonic distortion
2SO	S0 (pulse) output module
2TI	Tariff input module
2RO	Relay (alarm) output module
2DI	Digital input module

## Description of the product

A measuring centre is used for measuring, analysing and monitoring three phase electrical power network. Using the latest technologies and numerical methods we have reached high accuracy over a wide measuring range of voltage, current and integrated quantities.

### Appearance

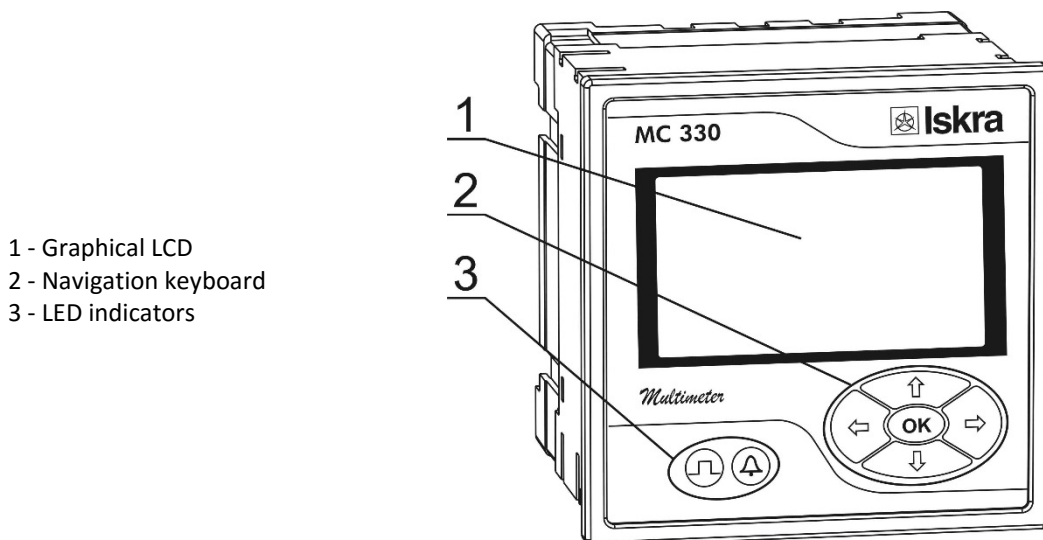

- 1 - Graphical LCD
- 2 - Navigation keyboard
- 3 - LED indicators

### GRAPHICAL LCD

A graphical LCD with back light is used for high resolution of displayed measuring quantities and for a display of selected functions when setting the device.

### NAVIGATION KEYBOARD

The "OK" key is used for confirming the settings, selecting and exiting the display. Direction keys are used for shifting between screens and menus.

### LED INDICATORS

LED indicators warn of a certain state of the instrument. A left (red) one is blinking as pulse output. A right (red) one is blinking when the condition for the alarm is fulfilled.

## Purpose and use of different types of measuring centers

### Energy meter MC320

The instrument is used for monitoring and measuring electric quantities of electrical power system. As the energy counter, instrument records energy in all four quadrants in four tariffs. Two different modules that are optionally built in two module places in the meter are available for controlling measurements. Available is one input and one output module.

### Multifunction meter MC330

The instrument is used for monitoring and measuring electric quantities of three-phase electrical power distribution system. The meter is provided with 16 program adjustable alarms, Configuration can have one input, one output modules and communication module (RS232 or RS485 or USB). With the communication meter can be set and measurements can be checked. The meter also functions as an energy counter with tariffs. As an energy counter it can record energy in all four quadrants in four tariffs. Different modules that are optionally built in two module places in the meter are available for controlling measurements. Available is one input and one output module.

## Network Recorder MC350 & MC350H

The instrument is used for monitoring and measuring electric quantities of electrical power system. It includes all functionality of MC330 and as addition it has 8Mb of flash memory built in. So it's additional functionality is that it measures and stores selected measured quantities and alarms in to recorder, where they are available for further analysis. At tariff clock setting, four seasons and four day groups are available. Additionally, 20 places are available for setting holidays. As an energy counter it can record energy in all four quadrants in four tariffs. The meter could be provided with M-Bus communication module.

## Type differences

Different types differ on functionality and equipment as shown in the following table.

### Differences in hardware

Feature	MC320	MC330	MC350	MC350H
Graphical LCD display	●	●	●	●
Back light of LCD display	●	●	●	●
LED indicator (pulse/alarm)	●/x	●/●	●/●	●/●
Control keys on front panel (5)	●	●	●	●
Communication interface RS232 or RS485 or USB	○	○	●	●
Module 1 (2S0/2RO)	○/x	○/○	●/○	●/○
Module 2 (2TI/2DI)	○/x	○/○	●/○	●/○
Automatic voltage range	○	○	●	●
Automatic current range	●	●	●	●
AC or universal supply	●/○	●/○	○/●	○/●
Real time clock (RTC) with tariff clock	x	x	●	●
8MB flash memory for recorder and alarm	x	x	●	●

● - serial ○ - option x - not supported

### Software functions

	Functions	MC320	MC330	MC350	MC350H
Basic	Setup wizard	●	●	●	●
	Wrong connection warning	●	●	●	●
	Custom screens (3)	x	●	●	●
	Demonstration screen cycling	●	●	●	●
	Programmable refresh time	●	●	●	●
Additional	MODBUS and DNP3 protocol	●	●	●	●
	MD calculation (TF)	x	●	●	●
	M-Bus protocol	x	x	●	●
	Profibus protocol	x	x	●	●
	Programmable alarms (16)	x	●	●	●

● - serial x - not supported

## Supported measurements

	Basic measurements	MC320	MC330	MC350	MC350H
Phase	Voltage U1, U2, U3 and U~	x	●	●	●
	Current I1, I2, I3, In, It and I~	x	●	●	●
	Active power P1, P2, P3, and Pt	x	●	●	●
	Reactive power Q1, Q2, Q3, and Qt	x	●	●	●
	Apparent power S1, S2, S3, and St	x	●	●	●
	Power factor PF1, PF2, PF3 and PF	x	●	●	●
	Power angle $\phi_1$ , $\phi_2$ , $\phi_3$ and $\phi$	x	●	●	●
	THD of phase voltage U1, U2 and U3	x	●	●	●
	THD of power angle I1, I2 and I3	x	●	●	●
Phase-to-phase	Phase-to-phase voltage U12, U23, U31	x	●	●	●
	Average phase-to-phase voltage Uff	x	●	●	●
	Phase-to-phase angle $\phi_{12}$ , $\phi_{23}$ , $\phi_{31}$	x	●	●	●
	THD of phase-to-phase voltage	x	●	●	●
Energy	Counter 1	●	●	●	●
	Counter 2	●	●	●	●
	Counter 3	●	●	●	●
	Counter 4	●	●	●	●
	Total	●	●	●	●
	Active tariff	●	●	●	●

● - serial    x - not supported

	Other measurements	MC320	MC330	MC350	MC350H
MD values	Phase current I1, I2, I3	x	●	●	●
	Active power P (Positive)	x	●	●	●
	Active power P (Negative)	x	●	●	●
	Reactive power Q – L	x	●	●	●
	Reactive power Q – C	x	●	●	●
	Apparent power S	x	●	●	●

● - serial (thermal function)    x - not supported

	Other measurements	MC320	MC330	MC350	MC350H
	Frequency	x	●	●	●
	Internal temperature	●	●	●	●

● - serial    x - not supported

# CONNECTION


## Introduction

This chapter deals with the instructions for measuring centre connection. Both the use and connection of the device includes handling with dangerous currents and voltages. Connection shall therefore be performed by a qualified person. *Iskra, d.d.* does not take any responsibility regarding the use and connection. If any doubt occurs regarding connection and use in the system which device is intended for, please contact a person who is responsible for such installations.

**Before use:** Check voltages and phase rotation, supply voltage and nominal frequency.

Check protective fuse rating (the recommended maximum rating of the external protective fuse for this equipment is 6A - Red Spot type or equivalent).

### WARNING!



Wrong or incomplete connection of voltage or other terminals can cause non-operation or damage to the device.


### PLEASE NOTE



After connection, settings have to be performed via a keyboard on the front side of the instrument that reflect connection of device to voltage network (connection mode, current and voltage transformers ratio, ...).

## Mounting

- 1 Before inserting device into the panel cut out, remove four screws, insert device and position the screws correctly. Fix device to the panel.

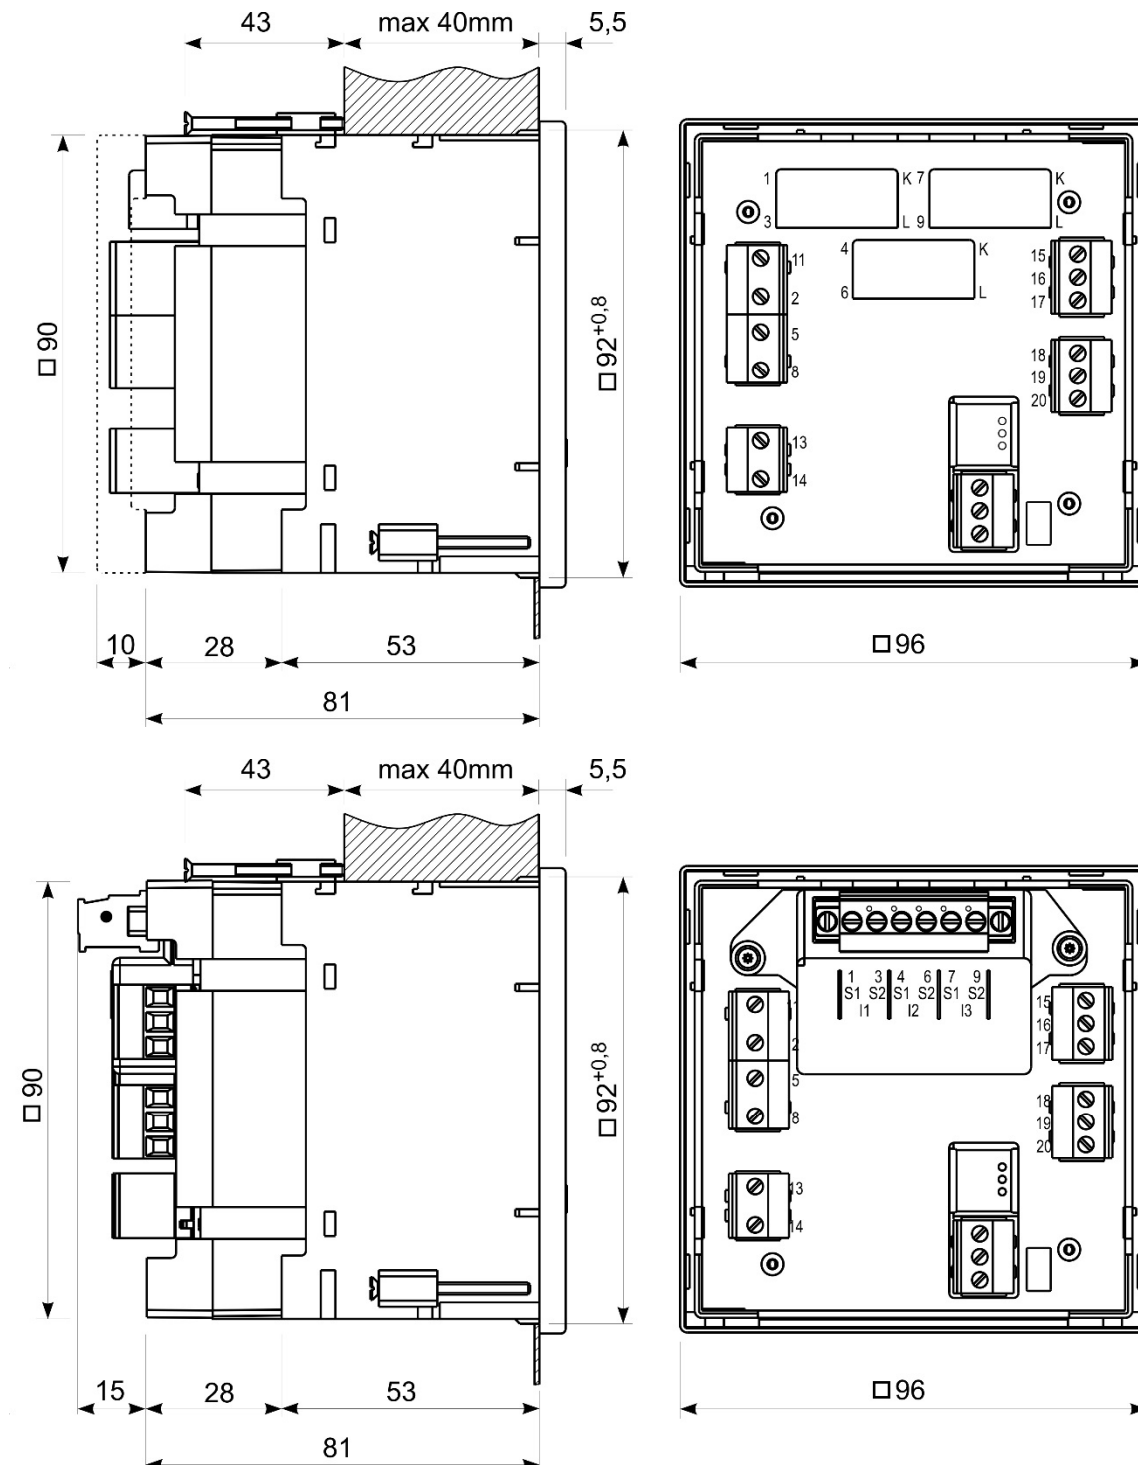

Panel cut out:  
DIN 92 x 92 mm <sup>+0.8</sup>

Remove protection foil from the screen.

## Electric connection


Voltage inputs of measuring centre can be connected directly to low-voltage network or via a voltage measuring transformer to high-voltage network.


There are two current connection options (defined when ordering):

- Through hole transformer
- Screw terminal connector

Depending on your current connections, refer to connection table below.

- 2 Choose corresponding connection from the figures below and connect corresponding voltages and currents. Information on electrical consumption of current and voltage inputs is given in chapter *Inputs* on page 48.

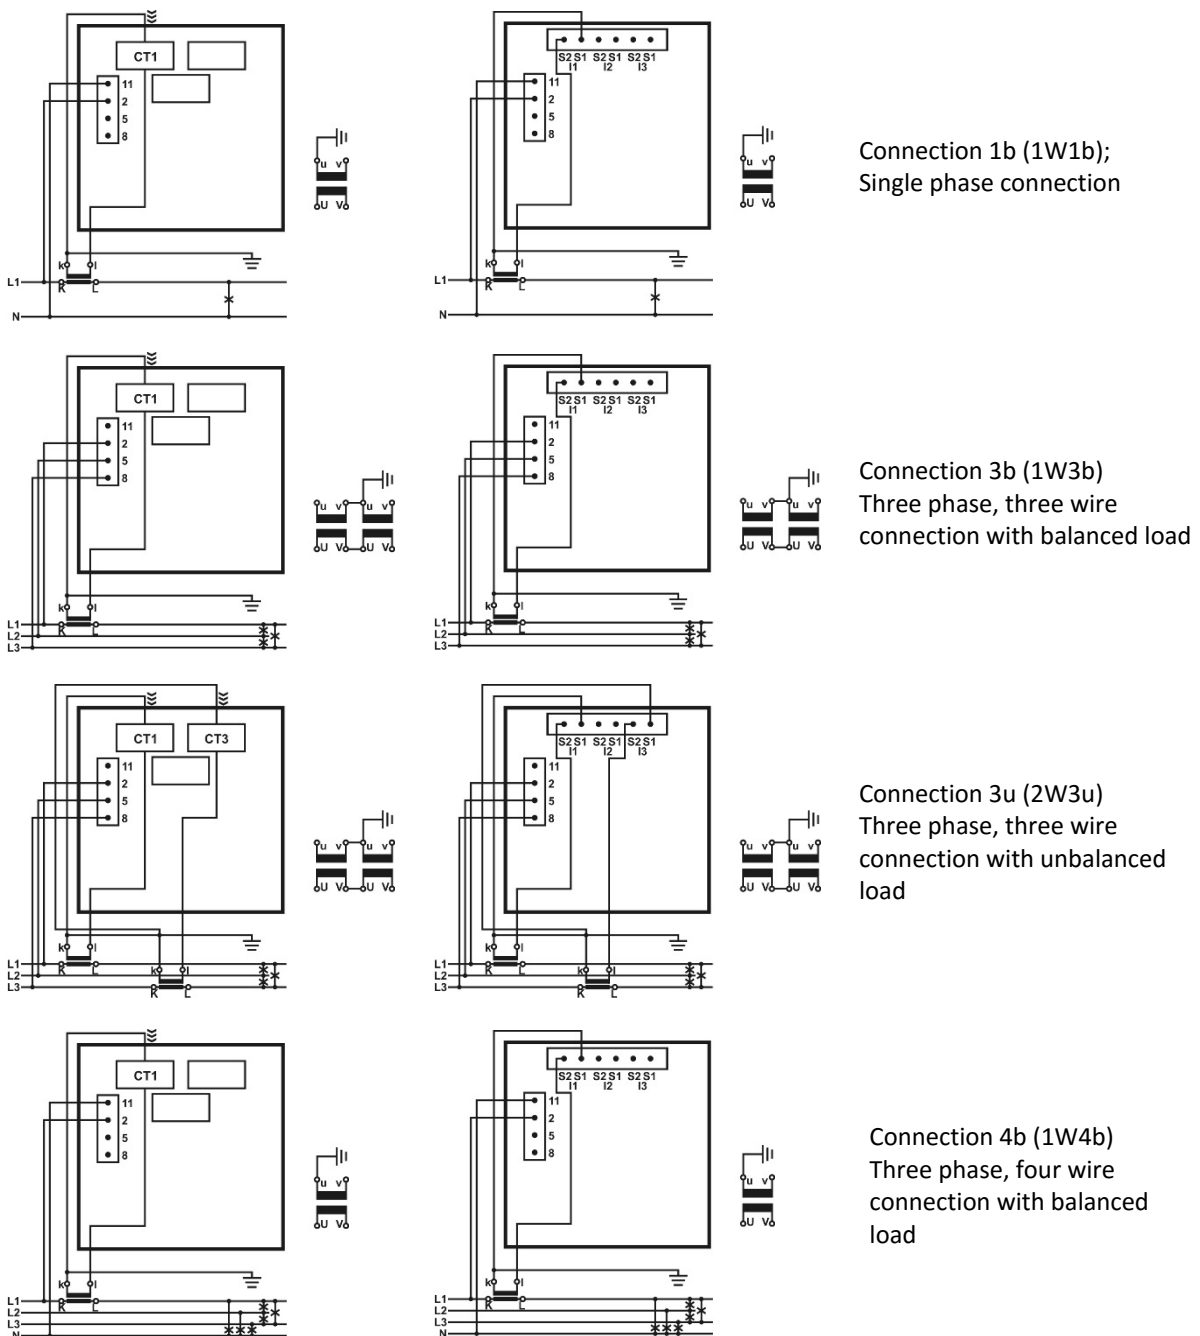

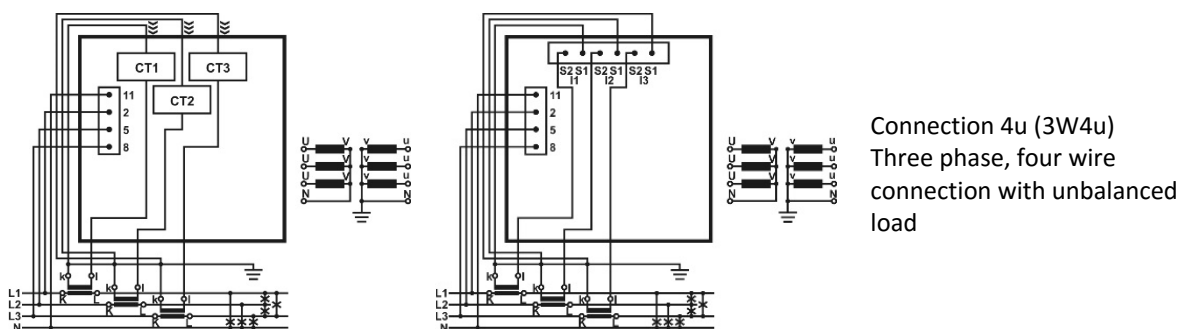

Connection 4u (3W4u)  
Three phase, four wire  
connection with unbalanced  
load


**PLEASE NOTE**



Examples of connections are shown without input / output modules and communication. Connection does not depend on a number of built-in modules and communication, and is shown on the device label.

## Connection of input/output modules

**WARNING!**



Check the module features that are specified on the label, before connecting module contacts. Wrong connection can cause damage or destruction of module and/or device.

**PLEASE NOTE**



Frequency of the tariff input voltage signal should not essentially deviate from the frequency of the measuring input signal. At no signal on the measuring inputs the tariff triggering is not reliable.

- Connect module contacts as specified on the label. Examples of labels are given below and describe modules built in the device. Information on electrical properties of modules is given in chapter *Modules* on page 49.

<table border="1"> <thead> <tr> <th colspan="2">I/O 3/4</th> </tr> </thead> <tbody> <tr> <td>2 x Tariff input</td> <td></td> </tr> <tr> <td>230 V AC ± 20%</td> <td> <table border="1"> <tr><td>3</td><td>~</td><td>18</td></tr> <tr><td>4</td><td>~</td><td>19</td></tr> <tr><td></td><td>~</td><td>20</td></tr> </table> </td> </tr> </tbody> </table>	I/O 3/4		2 x Tariff input		230 V AC ± 20%	<table border="1"> <tr><td>3</td><td>~</td><td>18</td></tr> <tr><td>4</td><td>~</td><td>19</td></tr> <tr><td></td><td>~</td><td>20</td></tr> </table>	3	~	18	4	~	19		~	20	Tariff input module with two tariff inputs for changeover between up to four tariffs.			
I/O 3/4																			
2 x Tariff input																			
230 V AC ± 20%	<table border="1"> <tr><td>3</td><td>~</td><td>18</td></tr> <tr><td>4</td><td>~</td><td>19</td></tr> <tr><td></td><td>~</td><td>20</td></tr> </table>	3	~	18	4	~	19		~	20									
3	~	18																	
4	~	19																	
	~	20																	
<table border="1"> <thead> <tr> <th colspan="2">I/O 3/4</th> </tr> </thead> <tbody> <tr> <td>2 x Tariff input</td> <td></td> </tr> <tr> <td>110 V AC ± 20%</td> <td> <table border="1"> <tr><td>3</td><td>~</td><td>18</td></tr> <tr><td>4</td><td>~</td><td>19</td></tr> <tr><td></td><td>~</td><td>20</td></tr> </table> </td> </tr> </tbody> </table>	I/O 3/4		2 x Tariff input		110 V AC ± 20%	<table border="1"> <tr><td>3</td><td>~</td><td>18</td></tr> <tr><td>4</td><td>~</td><td>19</td></tr> <tr><td></td><td>~</td><td>20</td></tr> </table>	3	~	18	4	~	19		~	20	Tariff input module with two tariff inputs for changeover between up to four tariffs.			
I/O 3/4																			
2 x Tariff input																			
110 V AC ± 20%	<table border="1"> <tr><td>3</td><td>~</td><td>18</td></tr> <tr><td>4</td><td>~</td><td>19</td></tr> <tr><td></td><td>~</td><td>20</td></tr> </table>	3	~	18	4	~	19		~	20									
3	~	18																	
4	~	19																	
	~	20																	
<table border="1"> <thead> <tr> <th colspan="2">I/O 1/2</th> </tr> </thead> <tbody> <tr> <td>2 x S0 output</td> <td></td> </tr> <tr> <td>40 V DC 30 mA</td> <td> <table border="1"> <tr><td>1</td><td>+</td><td>15</td></tr> <tr><td></td><td>-</td><td>16</td></tr> <tr><td>2</td><td>+</td><td>17</td></tr> <tr><td></td><td>-</td><td></td></tr> </table> </td> </tr> </tbody> </table>	I/O 1/2		2 x S0 output		40 V DC 30 mA	<table border="1"> <tr><td>1</td><td>+</td><td>15</td></tr> <tr><td></td><td>-</td><td>16</td></tr> <tr><td>2</td><td>+</td><td>17</td></tr> <tr><td></td><td>-</td><td></td></tr> </table>	1	+	15		-	16	2	+	17		-		S0 (pulse) output module with two pulse outputs for energy counters.
I/O 1/2																			
2 x S0 output																			
40 V DC 30 mA	<table border="1"> <tr><td>1</td><td>+</td><td>15</td></tr> <tr><td></td><td>-</td><td>16</td></tr> <tr><td>2</td><td>+</td><td>17</td></tr> <tr><td></td><td>-</td><td></td></tr> </table>	1	+	15		-	16	2	+	17		-							
1	+	15																	
	-	16																	
2	+	17																	
	-																		
<table border="1"> <thead> <tr> <th colspan="2">I/O 1/2</th> </tr> </thead> <tbody> <tr> <td>2 x Relay output</td> <td></td> </tr> <tr> <td>35 V DC 40 V AC 1000 mA</td> <td> <table border="1"> <tr><td>1</td><td>+/-</td><td>15</td></tr> <tr><td></td><td>-/+</td><td>16</td></tr> <tr><td>2</td><td>+/-</td><td>17</td></tr> <tr><td></td><td>-/+</td><td></td></tr> </table> </td> </tr> </tbody> </table>	I/O 1/2		2 x Relay output		35 V DC 40 V AC 1000 mA	<table border="1"> <tr><td>1</td><td>+/-</td><td>15</td></tr> <tr><td></td><td>-/+</td><td>16</td></tr> <tr><td>2</td><td>+/-</td><td>17</td></tr> <tr><td></td><td>-/+</td><td></td></tr> </table>	1	+/-	15		-/+	16	2	+/-	17		-/+		Relay output module with two outputs. (MC330, MC350, MC350H only)
I/O 1/2																			
2 x Relay output																			
35 V DC 40 V AC 1000 mA	<table border="1"> <tr><td>1</td><td>+/-</td><td>15</td></tr> <tr><td></td><td>-/+</td><td>16</td></tr> <tr><td>2</td><td>+/-</td><td>17</td></tr> <tr><td></td><td>-/+</td><td></td></tr> </table>	1	+/-	15		-/+	16	2	+/-	17		-/+							
1	+/-	15																	
	-/+	16																	
2	+/-	17																	
	-/+																		




<table border="1"> <thead> <tr> <th colspan="2">I/O 3/4</th> </tr> </thead> <tbody> <tr> <td colspan="2">2 x Digital input</td> </tr> <tr> <td>230 V DC/AC ± 20%</td> <td> <table border="1"> <tr> <td>3</td> <td>+/-</td> <td>18</td> </tr> <tr> <td>4</td> <td>+/-</td> <td>19</td> </tr> <tr> <td>4</td> <td>+/-</td> <td>20</td> </tr> </table> </td> </tr> </tbody> </table>	I/O 3/4		2 x Digital input		230 V DC/AC ± 20%	<table border="1"> <tr> <td>3</td> <td>+/-</td> <td>18</td> </tr> <tr> <td>4</td> <td>+/-</td> <td>19</td> </tr> <tr> <td>4</td> <td>+/-</td> <td>20</td> </tr> </table>	3	+/-	18	4	+/-	19	4	+/-	20	Digital input module with two digital inputs enables reception of impulse signals. (MC350, MC350H and MC330 only).
I/O 3/4																
2 x Digital input																
230 V DC/AC ± 20%	<table border="1"> <tr> <td>3</td> <td>+/-</td> <td>18</td> </tr> <tr> <td>4</td> <td>+/-</td> <td>19</td> </tr> <tr> <td>4</td> <td>+/-</td> <td>20</td> </tr> </table>	3	+/-	18	4	+/-	19	4	+/-	20						
3	+/-	18														
4	+/-	19														
4	+/-	20														
<table border="1"> <thead> <tr> <th colspan="2">I/O 3/4</th> </tr> </thead> <tbody> <tr> <td colspan="2">2 x Digital input</td> </tr> <tr> <td>110 V DC/AC ± 20%</td> <td> <table border="1"> <tr> <td>3</td> <td>+/-</td> <td>18</td> </tr> <tr> <td>4</td> <td>+/-</td> <td>19</td> </tr> <tr> <td>4</td> <td>+/-</td> <td>20</td> </tr> </table> </td> </tr> </tbody> </table>	I/O 3/4		2 x Digital input		110 V DC/AC ± 20%	<table border="1"> <tr> <td>3</td> <td>+/-</td> <td>18</td> </tr> <tr> <td>4</td> <td>+/-</td> <td>19</td> </tr> <tr> <td>4</td> <td>+/-</td> <td>20</td> </tr> </table>	3	+/-	18	4	+/-	19	4	+/-	20	Digital input module with two digital inputs enables reception of impulse signals. (MC350, MC350H and MC330 only).
I/O 3/4																
2 x Digital input																
110 V DC/AC ± 20%	<table border="1"> <tr> <td>3</td> <td>+/-</td> <td>18</td> </tr> <tr> <td>4</td> <td>+/-</td> <td>19</td> </tr> <tr> <td>4</td> <td>+/-</td> <td>20</td> </tr> </table>	3	+/-	18	4	+/-	19	4	+/-	20						
3	+/-	18														
4	+/-	19														
4	+/-	20														
<table border="1"> <thead> <tr> <th colspan="2">I/O 3/4</th> </tr> </thead> <tbody> <tr> <td colspan="2">2 x Digital input</td> </tr> <tr> <td>24 V DC</td> <td> <table border="1"> <tr> <td>3</td> <td>+</td> <td>18</td> </tr> <tr> <td>4</td> <td>-</td> <td>19</td> </tr> <tr> <td>4</td> <td>+</td> <td>20</td> </tr> </table> </td> </tr> </tbody> </table>	I/O 3/4		2 x Digital input		24 V DC	<table border="1"> <tr> <td>3</td> <td>+</td> <td>18</td> </tr> <tr> <td>4</td> <td>-</td> <td>19</td> </tr> <tr> <td>4</td> <td>+</td> <td>20</td> </tr> </table>	3	+	18	4	-	19	4	+	20	Digital input module with two digital inputs enables reception of impulse signals. (MC350, MC350H and MC330 only).
I/O 3/4																
2 x Digital input																
24 V DC	<table border="1"> <tr> <td>3</td> <td>+</td> <td>18</td> </tr> <tr> <td>4</td> <td>-</td> <td>19</td> </tr> <tr> <td>4</td> <td>+</td> <td>20</td> </tr> </table>	3	+	18	4	-	19	4	+	20						
3	+	18														
4	-	19														
4	+	20														
<table border="1"> <thead> <tr> <th colspan="2">I/O 3/4</th> </tr> </thead> <tbody> <tr> <td colspan="2">2 x Analogue output</td> </tr> <tr> <td>0...20 mA R<sub>max</sub>=150 Ω</td> <td> <table border="1"> <tr> <td>3</td> <td>+</td> <td>18</td> </tr> <tr> <td>4</td> <td>-</td> <td>19</td> </tr> <tr> <td>4</td> <td>+</td> <td>20</td> </tr> </table> </td> </tr> </tbody> </table>	I/O 3/4		2 x Analogue output		0...20 mA R <sub>max</sub> =150 Ω	<table border="1"> <tr> <td>3</td> <td>+</td> <td>18</td> </tr> <tr> <td>4</td> <td>-</td> <td>19</td> </tr> <tr> <td>4</td> <td>+</td> <td>20</td> </tr> </table>	3	+	18	4	-	19	4	+	20	Analogue output module with two analogue outputs (0...20mA), proportional to measured quantities. (MC350, MC350H with high range aux. power supply only)
I/O 3/4																
2 x Analogue output																
0...20 mA R <sub>max</sub> =150 Ω	<table border="1"> <tr> <td>3</td> <td>+</td> <td>18</td> </tr> <tr> <td>4</td> <td>-</td> <td>19</td> </tr> <tr> <td>4</td> <td>+</td> <td>20</td> </tr> </table>	3	+	18	4	-	19	4	+	20						
3	+	18														
4	-	19														
4	+	20														

## Communication connection

A type of connector depends on ordered communication type. RS232, RS485 and M-Bus communication are equipped with screw terminal connector, Profibus with D-SUB 9pin connector, USB with USB standard B type terminal and Service USB port with mini-B type terminal.

### WARNING!



When connecting a communication connector it is necessary to assure which type RS232 or RS485 or M-Bus communication is used. Otherwise the communication module can be damaged or destroyed. See connection diagrams below.

- Corresponding data are stated on the instrument label, regarding the selected communication. Connector terminals are marked on the label on the upper side of the instrument. More detailed information on communication is given in chapter *Communication* on page 50.

### RS232

RS232 communication is intended for direct connection of the Measuring centre to the personal computer. For proper operation it is necessary to assure the corresponding connection of individual terminals (see table on next page).

### RS485

RS485 communication is intended for connection of devices to network where several devices with RS485 communication are connected to a common communication interface. We suggest using one of the *ISKRA, d.d.* communication interfaces!

### M-Bus (MC350 and MC350H only)

M-Bus slave interface is intended for connection to network where M-Bus master device is present. For more information regarding M-Bus please refer to Appendix D on page 68.

### Profibus (MC330, MC350 and MC350H only)

Profibus DP-V0 communication protocol is supported. Up to 32 slave devices can be configured into the single Profibus network. Each device can be configured as a slave device providing wide range of measuring data to the Profibus master. For more information regarding Profibus please refer to Appendix C on page 63.

## USB

USB communication serves as a fast peer-to-terminal data link. The device is detected by host as a USB 2.0 compatible device. The USB connection is provided through a USB standard Type B connector.



### PLEASE NOTE



When MC3x0x is connected to a PC through USB communication for the first time, a user is prompted to install a driver. The driver is integrated in MiQen software or can be downloaded from the *Iskra, d.d.* web page [www.iskra.eu](http://www.iskra.eu). With this driver installed, USB is redirected to a serial port, which should be selected when using MiQen software.

## Service USB (MC320 and MC330 only)


Service USB communication serves as a fast peer-to-terminal data link. The device is detected by host as a USB 2.0 compatible device. Service USB connection is provided through a USB mini-B type connector.

Service USB is intended only for parameterisation of the meter and is not galvanic separated. Advantage is that in this case meter does not need a power supply to communicate. Communication via service port is time limited.

When using service communication, power supply and measuring voltages need to be disconnected.



### WARNING!



Service USB communication is not galvanic separated!

When using service USB communication, power supply and measuring voltages need to be disconnected!









### PLEASE NOTE



When MC3x0x is connected to a PC through USB communication for the first time, a user is prompted to install a driver. The driver is integrated in MiQen software or can be downloaded from the *Iskra, d.d.* web page [www.iskra.eu](http://www.iskra.eu). With this driver installed, USB is redirected to a serial port, which should be selected when using MiQen software.

## Survey of communication connection

	Connector	Terminals	Position	Data direction	Description
RS232	Screw terminal		21	From	Data reception (Rx)
			22	-	Grounding ( $\perp$ )
			23	To	Data transmission (Tx)
RS485	Screw terminal		21	To/From	A
			22	-	Do not connect!
			23	To/From	B
M-Bus	Screw terminal		21	To/From	M+
			22	-	NC
			23	To/From	M-
USB	USB type B		Standard USB 2.0 compatible cable recommended (standard B type plug)		
Profibus	D-SUB 9pin		8 – A	A line	Profibus A – RS485 line
			3 – B	B line	Profibus B – RS485 line
			6 – 5 V	5 V	5 V Power Supply for Profibus Line termination
			5 – GND	GND	GND
			4 – RTS	RTS	Request to send
Service USB	Mini-B type		Standard USB 2.0 compatible cable recommended (mini-B type plug)		

## Connection of power supply

Measuring centre has adaptable power supply. It enables connection to certain AC power supply or universal (AC/DC) power supply. Power supply voltage depends on ordered voltage. Information on electric consumption is given in chapter *Technical data* on page 47.

- 5 Regarding power supply voltage specification on the label choose and connect the power supply voltage:

INPUTS	
Current: 5 A	
Voltage: 240 V	
Frequency: 50, 60 Hz	
Connect.: 4u	
Class: 0.5	
SUPPLY	
20...300 V DC	13
48...276 V AC	14
40...65 Hz	
< 5 VA	

Connection of universal power supply to terminals 13 and 14.

Example for MC350!

INPUTS	
Current: 5 A	
Voltage: 500 V	
Frequency: 50, 60 Hz	
Connect.: 4u	
Class: 0.5	
SUPPLY	
230, 240 V AC	13
40...65 Hz	14
< 5 VA	

Connection of AC power supply to terminals 13 and 14.


Example for MC350!

# FIRST STEPS

## Introduction

Instruction for work with measuring centre is given in the following chapters. Procedure can differ regarding the types and their configuration (functions support). More than one procedure can be used for some types.

### WARNING!







Measuring centre start-up begins after electrical connection. After proper connection it is assured that the user security is not threatened.

After correct switch-on and respected safety measures the work with device does not represent any danger for a user.


## Basic concepts

Navigation keys and LCD enable application and basic device settings. During the operation some icons can be displayed in upper part of LCD. The significance of icons (from right to left) is explained in the table below.

Icon	Meaning
	Device is locked with a password of the second level (L2). The first level (L1) can be unlocked.
	Device can be wrongly connected at 4u connection. Energy flow direction is different by phases.
	The device supply is too low.
	Clock not set (MC350, MC350H only)

Example (MC330):

 Main menu ⇒ Info OK ↑



Meaning of icons is displayed on LCD in the Information menu.

## Installation wizard

After installation and electrical connection, basic parameters have to be set in order to assure correct operation. The easiest way to achieve that is use the Installation wizard. When entering the Installation menu, settings follow one another when the previous one is confirmed. All required parameters shall be entered and confirmed. Exit from the menu is possible when all required settings are confirmed or with interruption (key ← several times) without changes.

To use instrument on the Profibus/M-Bus network please note that installation wizard doesn't cover Profibus/M-Bus settings. Profibus settings must be done as described in the Appendix C. M-Bus settings must be done as described in the Appendix D.



### PLEASE NOTE



All settings that are performed through the Installation wizard can be subsequently changed by means of the Settings menu or via MiQen by means of communication.



Main menu ⇒ Installation ⇒

The menus follow one after another:

### START MENU

Start screen is displayed on LCD.

### LANGUAGE

Set device language.

### DATE (MC350, MC350H ONLY)

Set device date.

### TIME (MC350, MC350H ONLY)

Set device time.

### CONNECTION MODE

Choose connection and define load connection.

### PRIMARY VOLTAGE

Set primary voltage if a voltage transformer is used.

### SECONDARY VOLTAGE

Set secondary voltage if a voltage transformer is used; set voltage of low voltage network if connection is direct.

### PRIMARY CURRENT

Set primary current if a current transformer is used.

### SECONDARY CURRENT

Set secondary current.

### COMMON ENERGY EXPONENT (MC350, MC350H ONLY)

Define common energy exponent as recommended in table below, where counter divider is at default value 10. Values of primary voltage and current determine proper Common energy exponent. For detailed information see chapter *Energy* on page 31.

Current \ Voltage	1 A	5 A	50 A	100 A	1000 A
110 V	-1 (100 mWh)	0 (1 Wh)	1 (10 Wh)	1 (10 Wh)	2 (100 Wh)
230 V	0 (1 Wh)	0 (1 Wh)	1 (10 Wh)	2 (100 Wh)	3 (1 kWh)
1000 V	0 (1 Wh)	1 (10 Wh)	2 (100 Wh)	3 (1 kWh)	4 (10 kWh)
30 kV	2 (100 Wh)	2 (100 Wh)	3 (1 kWh)	4 (10 kWh)	4* (10 kWh)

\* - Counter divider (MiQen 2.x and above - Individual Counter Resolution) should be at least 100

## DEVICE ADDRESS

Set MODBUS address for the device. Default address is 33.

## BITS PER SECOND

Set communication rate. Default rate is 115200 b/s.

## PARITY

Set communication parity. Default value is None.

## STOP BIT

Set communication stop bits. Default value is 2.

# Display of device info

A menu is divided into several submenus with data and information about device:

- Welcome screen
- Information
- Meaning of icons

## Welcome screen

When entering the information menu, a welcome screen is displayed on LCD showing type designation and name of measuring centre.



Main menu ⇒ Info OK

## Information

Data on a device are collected in the Information menu. They include a serial number, a software version, a hardware version, date of manufacture and a number of operational hours in days, hours and minutes.



Main menu ⇒ Info OK ↓↓



Main menu ⇒ Info OK ↓↓↓

## Meaning of icons

All possible icons with their meaning are displayed.



Main menu ⇒ Info OK ↓↓↓↓



Example of display of icons with their meaning without active icons and at locked MC:

Info
🔒 Locked
⚡ Wrong connection
🔋 Low supply
🏠 Main menu

⇒

After automatic  
password activation

⇒

Info
🔒 Locked
⚡ Wrong connection
🔋 Low supply
🏠 Main menu

# SETTINGS

---

## Introduction

Settings of measuring centre can be done via the front keyboard or with a PC and MiQen software. Setting is easier using MiQen. Basic and simpler settings are accessible via navigation keyboard. For new setting to be activated settings file should be transferred to the device via communication (MiQen) or memory card. Setting done via navigation keyboard comes in to function after confirmation (OK).

---

## MiQen software

MiQen software is a tool for complete monitoring of the measuring instruments. RS485 or RS232 or USB is used for connection with a PC. A user-friendly interface consists of five segments: devices management, instrument settings, real-time measurements, data analysis and software upgrading.



PLEASE NOTE



You can download freeware MiQen from [www.iskra.eu](http://www.iskra.eu).

---

## Devices management

In MiQen it is very easy to manage devices. If dealing with the same device, it can be easily selected from a favourite's line. Use the network explorer to set and explore the devices in serial network or browser for Ethernet devices connected in local Ethernet network. Also setting of communication parameters to establish communication with a single device can easily be done.

## Device settings

Multi Register Edit technology assures a simple modification of settings that are organized in a tree structure. Besides transferring settings into the device, storing and reading from the setting files and memory cards are also available.

## Real-time measurements

All supported measurements can be seen in real time in a table or graphical form. For further processing of the results of measurements, it is possible to set a recorder on active device that will record and save selected measurements to MS Excel .csv file format.

## Data analysis

Analysis can be performed for the devices with a built-in memory. Recorded quantities can be monitored in a tabular or a graphical form. The events that triggered alarms can be analysed or a report on supply voltage quality can be made. All data can be exported to MS Excel worksheets.

## Software upgrading

Always use the latest version of software, both MiQen and software in the device. The program automatically informs you about available upgrades that can be transferred and used for upgrading.




PLEASE NOTE



More information about MiQen software can be found in MiQen Help system!

## PC MiQen 2.x user interface

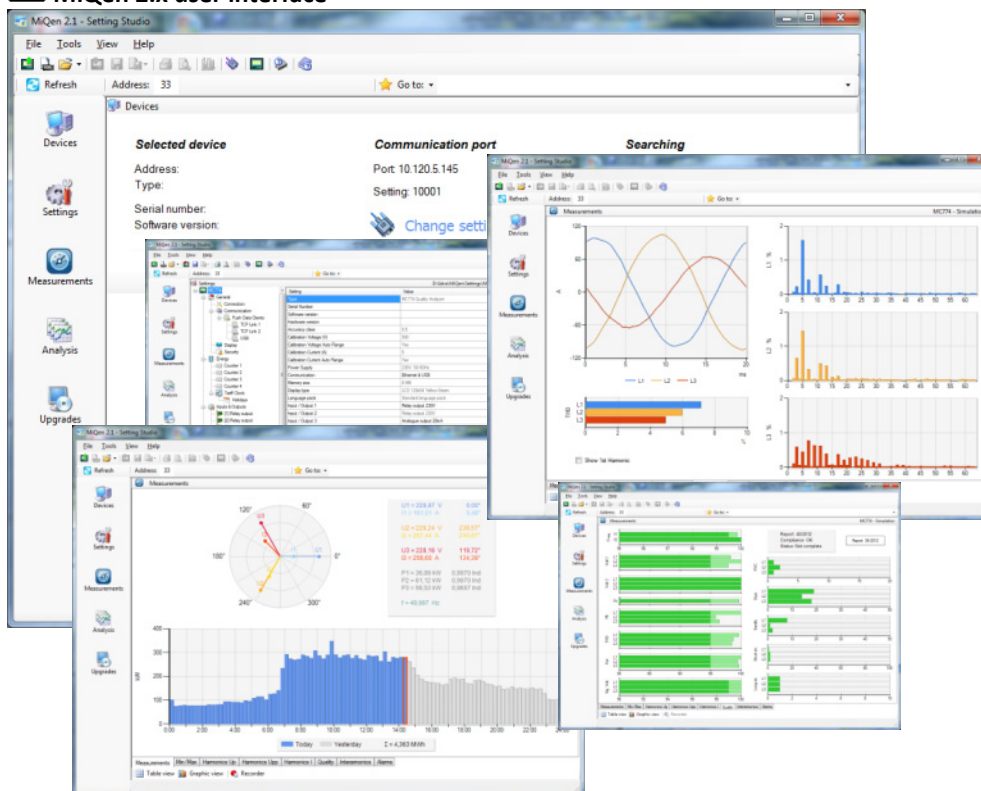

## Setting procedure

Before setting the instrument by means of MiQen, the current settings should be read first. Reading is available either via communication or from a file (stored on a PC local disk). A setting structure that is similar to a file structure in an explorer is displayed in the left part of the MiQen setting window. Available settings of that segment are displayed in the right part by clicking any of the stated parameters.



PLEASE NOTE



Some settings are probably not available due to unsupported measurements and/or functions that depend on the device type. For a survey of supported measurements and functions see chapter *Type differences*, pages 11.



## General settings

General settings are essential for measuring centre. They are divided into four additional sublevels (Connection, Communication, Display and Security).

MC320 lacks Communication tab; see chapter *Type differences*, pages 11.

### Description and Location

These two parameters are intended for easier recognition of a certain unit. They are especially used for identification of the device or location on which measurements are performed.

### Average interval

The averaging interval defines a refresh rate of measurements on LCD and communication.

It is used also as averaging interval for minimum and maximum values stored in recorder (MC350) and actual alarm value calculation for alarm triggering (MC330, MC350 and MC350H).

- Shorter average interval means better resolution in minimum and maximum value in to recorded period detection and faster alarm response. Also data presented in display will refresh faster.
- Longer average interval means lower minimum and maximum value in recorded period detection and slower alarm response (alarm response can be delayed also with Compare time delay setting – See chapter *Alarms* on page 36). Also data on display will refresh slower.

### Language

Set language on LCD. When language is changed from or to Russian, characters of the password are changed too. For overview of character translation see chapter *Password and language* on page 31.

 Main menu ⇒ Settings ⇒ General ⇒ Language




#### PLEASE NOTE



If a wrong language is set, a menu of languages can be displayed by simultaneous pressing up and down keys.


### Temperature unit

Choose a unit for temperature display.

 Main menu ⇒ Settings ⇒ General ⇒ Temperature unit


### Date format (MC350 and MC350H only)

Set a date format.

 Main menu ⇒ Settings ⇒ Date & Time ⇒ Date format

### Date and time (MC350 and MC350H only)

Set date and time of the device. Setting is important for correct memory operation, maximal values (MD), etc.

 Main menu ⇒ Settings ⇒ Date & Time ⇒ Date / Time

### Auto Summer/Winter time (MC350 and MC350H only)

If Yes is chosen, time will be automatically shifted to a winter or a summer time, regarding the time that is momentarily set.

 Main menu ⇒ Settings ⇒ Date & Time ⇒ Automatic S/W time

## Maximum demand (MD) time constant (MC350, MC350H and MC330 only)

The instrument provides maximum demand values based on a thermal function. Thermal function time constant can be selected via keyboard or via communication.



Main menu ⇒ Settings ⇒ General ⇒ MD mode / MD time constant

### THERMAL FUNCTION

A thermal function assures exponent thermal characteristic based on simulation of bimetal meters. Maximal values and time of their occurrence are stored in device. A time constant (t. c.) can be set from 1 to 255 minutes and is 6 – time thermal time constant (t. c. = 6 \* thermal time constant).


Example:

Mode: Thermal function

Time constant: 8 min.

Current MD and maximal MD: Reset at 0 min.

**Thermal function**

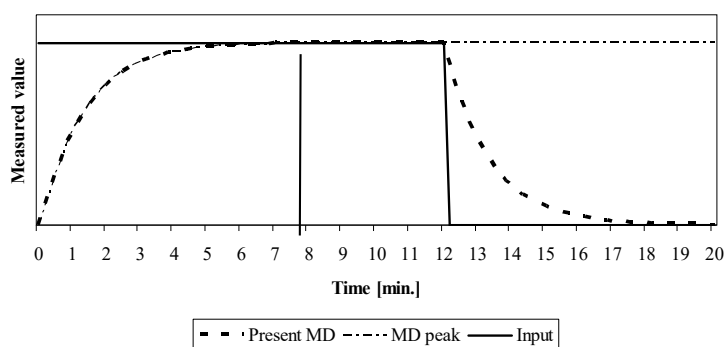

## Starting current for PF and PA (mA) (MC350, MC350H and MC330 only)

At all measuring inputs noise is usually present. It is constant and its influence on the accuracy is increased by decreasing measuring signals. It is present also when measuring signals are not connected and it occurs at all further calculations as very sporadic measurements. By setting a common starting current, a limit of input signal is defined where measurements and all other calculations are still performed.

## Starting current for all powers (mA)

Noise is limited with a starting current also at measurements and calculations of powers.

## Starting voltage for all powers

Noise is limited with a starting voltage also at measurements and calculations of powers. Until voltage reaches user defined starting voltage limit, all powers are set to 0. Using three wire electrical connections, virtual phase voltage is used in calculations.

## Starting voltage for SYNC (MC350, MC350H and MC330 only)

If all voltages are less than Starting voltage for SYNC, than the current inputs are used for synchronisation. If all currents are less than Starting current for PF and PA, than the synchronisation is stopped and the frequency result is 0 Hz

## Reactive power and energy calculation

User can select between two different principles of reactive power and energy calculation:

### *Standard method:*

With this method a reactive power and energy are calculated based on assumption that all power (energy) that is not active is reactive.

$$Q^2 = S^2 - P^2$$

This means also that all higher harmonics (out of phase with base harmonic) will be measured as reactive power (energy).

### *Delayed current method:*

With this method, reactive power (energy) is calculated by multiplication of voltage samples and delayed current samples (see chapter *Equations* on page 72):

$$Q = U \times I |_{+90^\circ}$$

With this method, reactive power (energy) represents only true reactive component of apparent power (energy).

## Connection



PLEASE NOTE



Settings of connections shall reflect actual state otherwise measurements are not valid.

## Connection

When connection is selected, load connection and the supported measurements are defined (see chapter *Survey of supported measurements regarding Connection mode* on page 21).



Main menu ⇒ Settings ⇒ Connection ⇒ Connection mode

## Setting of current and voltage ratios

Before setting current and voltage ratios it is necessary to be familiar with the conditions in which device will be used. All other measurements and calculations depend on these settings. Up to five decimal places can be set (up / down). To set decimal point and prefix (up / down) position the cursor (left / right) to last (empty) place or the decimal point.

Settings range	VT primary	VT secondary	CT primary	CT secondary
Maximal value	1638.3 kV	13383 V	1638.3 kA	13383 A
Minimal value	0.1 V	1 mV	0.1 A	1 mA



Main menu ⇒ Settings ⇒ Connection ⇒ VT primary / VT secondary / CT primary / CT secondary

## Used voltage and current range (MC350, MC350H and MC330 only)

Setting of the range is connected with all settings of alarms, where 100% represents 500 V and 5A. In case of subsequent change of the range, alarms settings shall be correspondingly changed, as well.

## Nominal frequency (MC350, MC350H and MC330 only)

A valid frequency measurement is within the range of nominal frequency  $\pm 32$  Hz. This setting is used for alarms only.

## Wrong connection warning

If all phase currents (active powers) do not have same sign (some are positive and some negative) and/or if phase voltages and phase currents are mixed, the warning will be activated if this setting is set to YES. This warning is seen only on remote display.

## Energy flow direction

This setting allows manual change of energy flow direction (IMPORT to EXPORT or vice versa) in readings tab. It has no influence on readings sent to communication or to memory.

## CT connection

If this setting is set to REVERSED it has the same influence as if CT's would be reversely connected. All power readings will also change its sign.

# Communication

## Serial Communication

They define parameters that are important for the operation in RS485 network or connections with PC via RS232 communication. Factory settings of communication are #33\115200,n,8,2 (address 1 to 247\rate 2400 to 115200 b/s, parity, data bits, stop bit).



Main menu ⇒ Settings ⇒ Communication ⇒

## USB Communication

Has no setting. Device is automatically recognized in Windows environment if device driver has been correctly installed. For more detailed information how to handle device with USB communication use Help section in MiQen software.

## Service USB Communication (MC330 and MC320 only)

Has no setting. Device is automatically recognized in Windows environment if device driver has been correctly installed. For more detailed information how to handle device with USB communication use Help section in MiQen software




### PLEASE NOTE



Service USB is intended only for parameterisation of the meter and is not galvanic separated. Advantage is that in this case meter does not need a power supply to communicate. Communication via service port is time limited.



### WARNING!



Service USB communication is not galvanic separated!

When using service USB communication, power supply and measuring voltages need to be disconnected!

## PROFIBUS Communication

To set Profibus communication please see Appendix C.

## M-Bus Communication

To set M-Bus communication please see Appendix D.

# Display

## Display settings

A combination of setting of the contrast and back light defines visibility and legibility of a display. Display settings shall be defined in compliance with the conditions in which it will be monitored. Economizing mode switches off back light according to the set time of inactivity.

Main menu ⇒ Settings ⇒ LCD ⇒ Contrast / Back light / Back light time off

## Demo cycling period

It defines time in seconds for each displayed screen of measurements on LCD.

Main menu ⇒ Settings ⇒ LCD ⇒ Demo cycling period

## Settings of customized screens (MC350, MC350H and MC330 only)

For easier and faster survey of measurements that are important for the user, three settings of customized screens are available. Each customized screen displays three measurements. When setting customized screens the designations are displayed in shorter form, with up to 4 characters. For survey of all designations see chapter *Survey of supported measurements regarding Connection* on page 13.

Example:

Desired result:

Customized screen 1	Customized screen 2	Customized screen 3
Phase voltage 1	Total current	Power angle (U <sub>1</sub> -I <sub>1</sub> )
Phase current 1	Neutral current	Frequency
Phase power 1	Average current	THD of current I <sub>1</sub>

Setting:

Main menu ⇒ Settings ⇒ LCD ⇒ Custom screen 1 / 2 / 3

Customized screen 1

Custom screen 1
U <sub>1</sub> I <sub>1</sub> P <sub>1</sub>
OK Select

Customized screen 2

Custom screen 2
I <sub>1</sub> Inc I <sub>avg</sub>
OK Select

Customized screen 3

Custom screen 3
ϕ <sub>1</sub> f 11%
OK Select

Main menu ⇒ Measurements ⇒ Present values ⇒ Custom OK

225.2 <sub>6</sub> V U <sub>1</sub>
55.3 <sub>1</sub> mA I <sub>1</sub>
10.3 <sub>9</sub> W P <sub>1</sub>

⇔

0.396 <sub>1</sub> A I <sub>1</sub>
0.38 <sub>6</sub> A Inc
0.132 <sub>0</sub> A I <sub>avg</sub>

⇔

+4.3 <sub>6</sub> ° ϕ <sub>1</sub>
49.996 <sub>4</sub> Hz f
87.5 <sub>6</sub> % THD

## Security

Settings parameters are divided into four groups regarding security level:

- 1 At the lowest level (PL0), where a password is not required, parameters of LCD can be set: language, contrast and LCD back light.
- 2 At the first level (PL1), settings of a real time clock (MC350 and MC350H) can be changed and energy meters and MD can be reset.
- 3 At the second level (PL2), the access to all data that are protected with the first level (PL1) and setting of all other parameters in the »SETTINGS« menu are available.
- 4 A backup password (BP) is used if passwords at levels 1 (PL1) and 2 (PL2) have been forgotten, and it is different for each device (depending on a serial number of the meter). The BP password is available in the user support department in *ISKRA, d.d.*, and is entered instead of the password PL1 or/and PL2. Do not forget to state the meter serial number when contacting the personnel in *ISKRA, d.d.*



### PLEASE NOTE



A serial number of device is stated on the label, LCD (see example below) and is also accessible with MiQen software.

The access to the device serial number via a keyboard

Example:

 Main menu ⇒ Info OK ↓

Main menu
Measurements
Settings
Resets
<b>Info</b>
Installation
Temperature 41.4°C

OK

ISKRA
<b>MC350</b>
Recorder
ISKRA


↓

Info
Ser. #: MC300005
S.ver: 0.28
H.ver: A
Date : 21.05.2009
Run : 15d 13h 51'
← Main menu

## Password setting


A password consists of four letters taken from the British alphabet from A to Z. When setting a password, only the letter being set is visible while the others are covered with \*.

A password of the first (L1) and the second (L2) level is entered, and time of automatic activation is set.

 Main menu ⇒ Settings ⇒ Security ⇒ Password level 1 / Password level 2 / Password lock time


## Password modification

A password is optionally modified; however, only that password can be modified to which the access is unlocked at the moment.

 Main menu ⇒ Settings ⇒ Security ⇒ Password level 1 / Password level 2

## Password disabling

A password is disabled by setting the "AAAA" password.

 Main menu ⇒ Settings ⇒ Security ⇒ Password level 1 / Password level 2 ⇒ "AAAA" OK



### PLEASE NOTE



A factory set password is "AAAA" at both access levels (L1 and L2). This password does not limit access.


## Password and language

Language change is possible without password input. When language is changed from or to Russian or Hebrew, character transformation has to be taken in to account. Character transformation table (English or Russian alphabet) is stated below.

English	A	B	C	D	E	F	G	H	I	J	K	L	M	N	O	P	Q	R	S	T	U	V	W	X	Y	Z
Russian	А	Б	В	Г	Д	Е	Ж	З	И	Й	К	Л	М	Н	О	П	Р	С	Т	У	Ф	Х	Ц	Ч	Ш	Щ

## Energy - counters

### WARNING!



Before modification, all energy counters should be read or if energy values are stored in recorders, recorder should be read with MiQen software or stored on Memory card to assure data consistency for the past.

After modification of energy parameters, the energy meters (counters) should be reset. All recorded measurements from this point back might have wrong values so they should not be transferred to any system for data acquisition and analysis. Data stored before modification should be used for this purpose.

### Active tariff

When active tariff is set, one of the tariffs is defined as active; switching between tariffs is done either with a tariff clock or a tariff input. For the operation of the tariff clock other parameters of the tariff clock that are accessible only via communication or Memory card must be set correctly.

## Common Energy Exponent (Common Energy Counter Resolution – MiQen 2.x and above)

Common energy exponent defines minimal energy that can be displayed on the energy counter. On the basis of this and a counter divider, a basic calculation prefix for energy is defined (-3 is 10<sup>-3</sup>Wh = mWh, 4 is 10<sup>4</sup>Wh = 10 kWh). A common energy exponent also influences in setting a number of impulses for energy of pulse output or alarm output functioning as an energy meter.

Define common energy exponent as recommended in table below, where counter divider is at default value 10. Values of primary voltage and current determine proper Common energy exponent.

In MiQen setting software version 2.x and above, this setting parameter is renamed in Common Energy Counter Resolution. Also setting values are changed to give user better perspective of represented value.

In table below, new setting values are quoted in parenthesis.

Current Voltage	1 A	5 A	50 A	100 A	1000 A
110 V	-1 (100 mWh)	0 (1 Wh)	1 (10 Wh)	1 (10 Wh)	2 (100 Wh)
230 V	0 (1 Wh)	0 (1 Wh)	1 (10 Wh)	2 (100 Wh)	3 (1 kWh)
1000 V	0 (1 Wh)	1 (10 Wh)	2 (100 Wh)	3 (1 kWh)	4 (10 kWh)
30 kV	2 (100 Wh)	2 (100 Wh)	3 (1 kWh)	4 (10 kWh)	4* (10 kWh)

\* - Counter divider (MiQen 2.x and above - Individual Counter Resolution) should be at least 100

## Counter divider (Individual counter Resolution – MiQen 2.x and above)

The counter divider additionally defines precision of a certain counter, according to settings of common energy exponent.

An example for 1kW of consumed active energy in the first tariff:

Common energy exponent	0	2	2
Counter divider	1	1	100
Example of result, displayed	2.577 kWh	0.2577 MWh	25.77 MWh

## Tariff clock


Basic characteristics of a program tariff clock:

- 4 tariffs (T1 to T4)
- Up to 4 time spots in each Day program for tariff switching
- Whichever combination of valid days in a week or holidays for each program
- Combining of day groups (use of over 4 time spots for certain days in a week)
- Separate settings for 4 seasons a year
- Up to 20 settable dates for holidays

### OPERATION OF INTERNAL TARIFF CLOCK

Tariff status is displayed in the Info menu.

Example of display for selected Active tariff:

 Main menu ⇒ Info OK ↓ ↓ ↓ ⇒

Tariff status
Season: 1
Day programs
P1 -- -- --
Tariff: T3
← Info

or

Tariff status
Selected: T2
← Info

or

Tariff status
Tariff input
Selected: T1
← Info

**Day program** sets up to 4 time spots (rules) for each day group in a season for tariff switching.

**A date of real time clock** defines an active period. An individual period is active from the period starting date to the first next date of the beginning of other periods.

The order of seasons and starting dates is not important, except when two dates are equal. In that case the season with a higher successive number has priority, while the season with a lower number will never be active.


If no starting date of a season is active, the active period is 1.

If the present date is before the first starting date of any period, the period is active with the last starting date.

Example of settings:

Season	Season start day
Season 1:	15.02
Season 2:	30.10
Season 3:	-
Season 4:	01.06
Date	Active season
01.01. - 14.02.	2 (last in the year)
15.02. - 31.05.	1
01.06. - 29.10.	4
30.10. - 31.12.	2



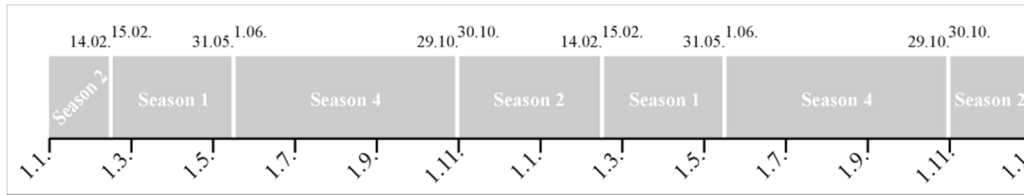

**Days in a week and selected dates for holidays** define time spots for each daily group in a period for tariff switching. Dates for holidays have priority over days in a week.

When the real time clock date is equal to one of a date of holidays, tariff is switched to holiday, within a period of active daily group with a selected holiday.

If there is no date of holidays that is equal to the real time clock date, all daily groups with the selected current day in a week are active.

Several daily groups can be active simultaneously, which enables more than 4 time spots in one day (combine of day programs). **If the time spot is not set for a certain day, tariff T1 is chosen.**

**Time of a real time clock** defines an active tariff regarding currently active day program. A selected tariff T1 to T4 of individual time spot is active from the time of the time spot to the first next time of the remaining time spots.

The order of time spots is not important, except when two times are equal. In that case the time with a higher successive number has priority (if several time spots are active, times of higher time spots have higher successive numbers), while the time spot with a lower number will never be active.

If current time is before the first time of any time spot of active spots, the time spot with the last time is chosen.

**If no time spot of active programs is valid, tariff T1 is chosen.**

Time selected tariff T1 to T4 or fixed selected tariff (via communication) defines activity of an energy counter.

## Counter measured quantity PC

For each of four (4) counters different measured quantity can be selected. User can select from a range of predefined options referring to measured total energy or energy on single phase. Or can even select its own option by selecting appropriate quantity, quadrant, absolute or inverse function.

To energy counter also pulse / digital input can be attached. In this case Energy counter counts pulses from an outside source (water, gas, energy... meter).

## Inputs and outputs

MC3x0x can be equipped with different I/O. For its technical specifications see chapter *Technical data* on page 47. I/O are available also over Profibus communication – for details please look into Appendix C.

For I/O 1 and 2 following options are available.

**Module 1 - Outputs:** There are two different output modules.

- Pulse output (solid state)
- Relay output (relay)

**Module 2 - Inputs:** There are two different input modules.

- Digital input
- Tariff input

Tariff and digital input can be ordered as a different hardware types with different voltage levels.

All modules have double input or output and are in MiQen software presented as two separate modules.

Relay output and a pulse output can also be selected via a keyboard. When selecting settings of energy and quadrants for a certain counter, only present selection is possible, while more demanding settings are accessible via communication.

MC320 only supports pulse output and tariff input modules; Please see chapter *Type differences*, pages 11.

## Pulse (S0) module

It is a solid state, optocoupler open collector switch. Its main intention is to be used as a pulse output for selected energy counter, but can also be used as an alarm or general purpose digital output.

For description of output functionality see chapter Functions of Digital output (Pulse and Relay) modules below.

## Relay (alarm) module (MC350, MC350H and MC330 only)

It is a relay switch. Its main intention is to be used as an alarm output, but can also be used as a pulse or general purpose digital output.

A parallel RC filter with time constant of at least  $250 \mu\text{s}$  ( $R \cdot C \geq 250 \mu\text{s}$ ) should be used in case of a sensitive pulse counter. RC filter attenuates relay transient signals.

For description of output functionality see chapter Functions of Digital output (Pulse and Relay) modules below.


## Functions of output modules (Pulse and Relay)

To Digital outputs, Pulse and Relay, different functions can be attached. All can be set with MiQen software.


### PULSE OUTPUT OF ENERGY COUNTER

A corresponding energy counter is defined to a pulse output. A number of pulses per energy unit, pulse length, and a tariffs in which output is active are set.

#### WARNING!



Pulse parameters are defined by EN 62053–31 standard. In chapter Calculation of recommended pulse parameters, below a simplified rule is described to assist you in setting the pulse output parameters.

 Main menu  $\Rightarrow$  Settings  $\Rightarrow$  Inputs/Outputs  $\Rightarrow$  I/O 1 / 2 / 3 / 4  $\Rightarrow$  Setting of pulse output OK

The pulse module can also function as an alarm output with maximum current load 30 mA.

### CALCULATION OF RECOMMENDED PULSE PARAMETERS

Number of pulses per energy unit should be in certain limits according to expected power. If not so the measurement from pulse output can be incorrect. Settings of current and voltage transformers can help in estimation of expected power.

Principle described below for pulse setting, where e is prefix, satisfies EN 62053-31: 2001 standards pulse specifications:

1,5...15 eW  $\rightarrow$  100 p/1 eWh


Examples:

Expected power	$\rightarrow$	Pulse output settings
150 - 1500 kW	$\rightarrow$	1 p/1kWh
1.5 - 15 MW	$\rightarrow$	100 p/1MWh
15 - 150 MW	$\rightarrow$	10 p/1MWh
150 - 1500 MW	$\rightarrow$	1 p/1MWh

### CALCULATION OF RECOMMENDED PULSE PARAMETERS


If Digital output is defined as an Alarm output, its activity (trigger) is connected to Alarm groups. Multiple alarm groups can be attached to it and different signal shapes defined. For more information on how to define alarm groups, see chapter *Alarms* on page 36.

Alarm groups connected to a specific output module can also be defined via keyboard.

 Main menu ⇒ Settings ⇒ Inputs/Outputs ⇒ V/I 1 / 2 / 3 / 4 ⇒ Setting of alarm output OK

**SIGNAL SHAPE:**

- Normal – a relay is closed until condition for the alarm is fulfilled.
- Normal inverse – a relay is open until condition for the alarm is fulfilled.
- Latched – a relay is closed when condition for the alarm is fulfilled, and remains closed until it is reset via communication.
- Latched inverse – a relay is opened when condition for the alarm is fulfilled, and remains closed until it is reset via communication.
- Pulsed – an impulse of the set length is sent always when condition for the alarm is fulfilled.
- Pulsed inverse – a pause of the set length is sent always when condition for the alarm is fulfilled. Otherwise relay is closed.
- Always switched on / off (permanent) – A relay is permanently switched on or switched off irrespective of the condition for the alarm.



This possibility of permanent alarm setting enables remote control via communication.

**Digital input module PC**

Module has no settings. General purpose is to collect digital signals from various devices, such as (intrusion detection relay, different digital signals in transformer station, industry ...). It is available in three different hardware versions.

When used in DC mode it can also be used as a pulse counter from external meters (water, gas, heat ...). Its value can be assigned to any of four energy counters (see chapter *Energy* on page 31).

**Tariff input module PC**

**TARIFF INPUT**

Has no setting. It operates by setting active tariff at a tariff input (see chapter *Tariff clock* on page 32). The instrument can have maximal one module with 2 tariff inputs only. With the combination of 2 tariff inputs maximal 4 tariffs can be selected.

**ACTIVE TARIFF SELECTION TABLE:**

Active tariff	Signal presence on tariff input	
	Input T1/T2	Input T3/T4
Tariff 1	0	0
Tariff 2	1	0
Tariff 3	0	1
Tariff 4	1	1

## Alarms (MC350, MC350H and MC330 only)

Alarms are used for alarming exceeded set values of the measured quantities.

MC320 - alarms are not supported; Please see chapter Type differences, pages 11.


### Alarms setting PC

Measuring centre supports alarm functionality. 16 alarms divided in 2 groups (2 x 8 alarms) can be set. For each group of alarms a time constant of maximal values in thermal mode, a delay time and alarm deactivation hysteresis can be defined.

Quantity, value (a current value or a MD – thermal function) and a condition for alarm switch-on are defined for every individual alarm.

MC350 supports also storing of alarms in internal memory.

#### WARNING!



New values of alarms are calculated in percentage at modification of connection settings.

### Alarms setting PC

Device evident all triggered alarms and stores it in internal RAM. Statistic is valid since last power supply On and could be reset with MiQen software (See chapter *Reset operations* on page 38)


## Types of alarms

### VISUAL ALARM

When alarm is switched on, a red LED on the meter front side is blinking (see figure shown on next page).

### ALARM OUTPUT (PULSE)

According to the alarm signal shape the output relay will behave as shown on next page.

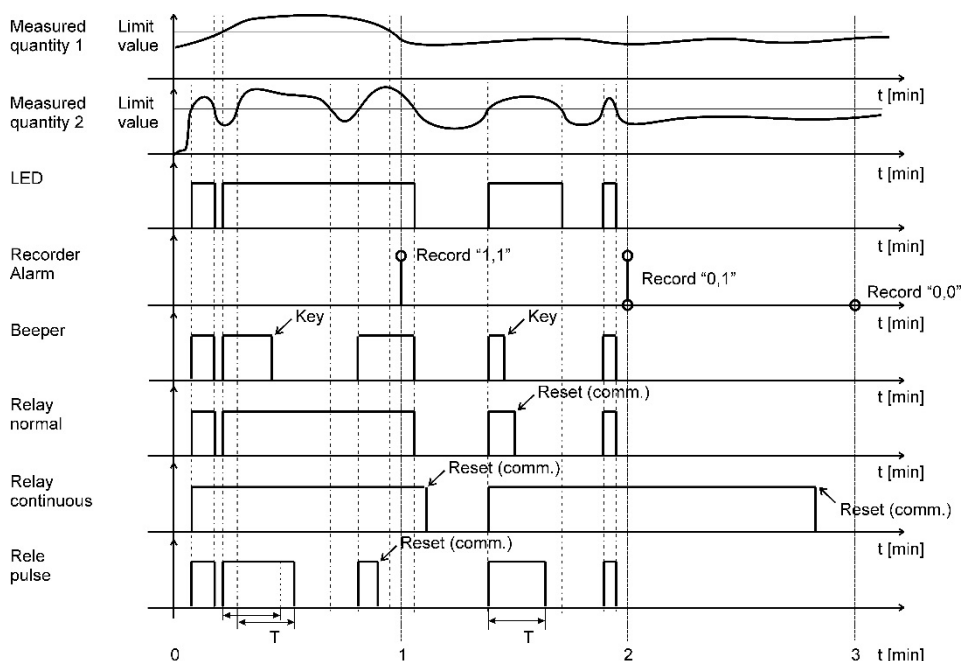

## Memory (MC350 and MC350H only)

Measurements and alarms can be stored in a built in 8MB flash memory. All records stored in memory are accessible via communication with MiQen software.

### Memory division

MC memory is divided into 3 partitions which size is defined by the user. Measurements are stored in A and B partitions, while all alarms that occurred are recorded in an alarm partition.


### Memory operation

Memory functions in a cyclic mode in compliance with the FIFO method. This means that only the latest records are stored in the memory that will replace the oldest ones. A number of stored data or a storing period depends on selected partition size, a number of recorded quantities and time of division sampling. Occupancy of partitions is shown in the Information menu (see chapter *Display* of device info on page 28).

### Memory clearing

There is usually no need to clear the memory, because it works in cyclic mode. If you want to clear memory data anyway, the data storing must be stopped first. Read the device settings with MiQen and set "Recorder state" in Memory setting group to stopped. Download changes to the device and open Memory info form and then click on Clear memory button. Select memory partitions to be cleared on Memory clearing form and click on OK button. Set "Recorder state" setting back to active.

#### WARNING!



It is strongly advised to download recorder values before applying any changes to recorder or changes of settings for energy, type of connection, current and voltage transformer settings, used current and voltage ranges ...

These changes might have impact on recorded history so data might no longer be valid.

### Recorders A and B setting

Separately, for each of the recorders, settings can be set:

**Storage interval:** sets a time interval for readings to be written to a recorder

**Recorded quantities:** for each of 16 measurements, which are to be recorded it is possible to set a required value and its representation within storage interval (minimum, maximum ...).

**Parameter:** here monitoring quantity can be selected from a list of supported measurements.

**Value:** representation of a value within set monitoring interval can be set to different conditions.


- Average value represents calculated average value
- Actual value represents value of recorded quantity at sampling intervals
- Minimum and Maximum value represents minimum or maximum of recorded quantity in selected storage interval. Minimum or maximum in this case represents averaged value according to average interval selected in *General settings* (see page 25).

## Reset operations

☛ – MC320 support only reset energy counters

### Reset energy counters (E1, E2, E3, E4)

All or individual energy meters are reset.

 Main menu ⇒ Resets ⇒ Energy counters ⇒ All energy counters / Energy counter E1 / E2 / E3 / E4 OK

### Reset maximal MD values (MC350, MC350H and MC330 only)

#### THERMAL MODE

Current and stored MDs are reset.

 Main menu ⇒ Resets ⇒ MD values ⇒

### Reset the last MD period (MC350 and MC330 only)

#### THERMAL MODE


Current MD value is reset.

 Main menu ⇒ Resets ⇒ Last period MD ⇒

### Alarm relay (1 or 2) Off (MC350 and MC330 only)

When using MiQen, each alarm output can be reset separately. On device (manually) only all alarm outputs together can be reset.

All alarms are reset.

 Main menu ⇒ Reset ⇒ Reset alarm output ⇒

### Reset alarm statistic

Clears the alarm statistic that is evidenced since last power supply On.

# MEASUREMENTS

## Introduction

In the following chapters operation of the device is explained more in detail.

## Supported measurements

Measurements support regarding the device type is described in chapter *Type differences*, pages 11. Selection of supported measurements of individual instrument type is changed with the connection settings.

## Available connections

Different electric connections are described more in detail in chapter *Electric connection* on page 15. Connections are marked as follows:

- Connection 1b (1Wb) – Single phase connection
- Connection 3b (1W3b) – Three phase, three wire connection with balanced load
- Connection 4b (1W4b) – Three phase, four wire connection with balanced load
- Connection 3u (2W3u) – Three phase, three wire connection with unbalanced load
- Connection 4u (3W4u) – Tree phase, four wire connection with unbalanced load



PLEASE NOTE



Measurements support depends on connection mode and the device type.  
Calculated measurements are only informative.

## Survey of supported measurements regarding connection mode

All measurements, with designations can be displayed on customized screens.

	Basic measurements	Designat.	Unit	1b	3b	3u	4b	4u
Phase	Voltage $U_1$	U1	V	●	×	×	●	●
	Voltage $U_2$	U2	V	×	×	×	○	●
	Voltage $U_3$	U3	V	×	×	×	○	●
	Average voltage $U_{\sim}$	$U_{\lambda}$	V	×	×	×	○	●
	Current $I_1$	I1	A	●	●	●	●	●
	Current $I_2$	I2	A	×	○	●	○	●
	Current $I_3$	I3	A	×	○	●	○	●
	Current $I_n$	I <sub>nc</sub>	A	×	○	○	○	●
	Total current $I_t$	I	A	●	○	○	○	●
	Average current $I_a$	I <sub>avg</sub>	A	×	○	○	○	●
	Active power $P_1$	P1	W	●	×	×	●	●
	Active power $P_2$	P2	W	×	×	×	○	●
	Active power $P_3$	P3	W	×	×	×	○	●
	Total active power $P_t$	P	W	●	●	●	○	●
	Reactive power $Q_1$	Q1	var	●	×	×	●	●
	Reactive power $Q_2$	Q2	var	×	×	×	○	●
Reactive power $Q_3$	Q3	var	×	×	×	○	●	
Total reactive power $Q_t$	Q	var	●	●	●	○	●	

● - serial ○ - option × - not supported

	Basic measurements	Designat.	Unit	1b	3b	3u	4b	4u
Phase	Apparent power $S_1$	S1	VA	●	×	×	●	●
	Apparent power $S_2$	S2	VA	×	×	×	○	●
	Apparent power $S_3$	S3	VA	×	×	×	○	●
	Total apparent power $S_t$	S	VA	●	●	●	○	●
	Power factor $PF_1$	PF1/ePF1		●	×	×	●	●
	Power factor $PF_2$	PF2/ePF2		×	×	×	○	●
	Power factor $PF_3$	PF3/ePF3		×	×	×	○	●
	Total power factor $PF^{\sim}$	PF/ePF		●	●	●	○	●
	Power angle $\phi_1$	$\phi_1$	°	●	×	×	●	●
	Power angle $\phi_2$	$\phi_2$	°	×	×	×	○	●
	Power angle $\phi_3$	$\phi_3$	°	×	×	×	○	●
	Total power angle $\phi^{\sim}$	$\phi$	°	●	●	●	○	●
	THD of phase voltage $U_{f1}$	U1%	%THD	●	×	×	●	●
	THD of phase voltage $U_{f2}$	U2%	%THD	×	×	×	○	●
	THD of phase voltage $U_{f3}$	U3%	%THD	×	×	×	○	●
	THD of phase current $I_1$	I1%	%THD	●	●	●	●	●
THD of phase current $I_2$	I2%	%THD	×	○	●	○	●	
THD of phase current $I_3$	I3%	%THD	×	○	●	○	●	
Phase-to-phase	Phase-to-phase voltage $U_{12}$	U12	V	×	●	●	○	●
	Phase-to-phase voltage $U_{23}$	U23	V	×	●	●	○	●
	Phase-to-phase voltage $U_{31}$	U31	V	×	●	●	○	●
	Average phase-to-phase voltage ( $U_{ff}$ )	$U_{\Delta}$	V	×	●	●	○	●
	Phase-to-phase angle $\phi_{12}$	$\phi_{12}$	°	×	×	×	○	●
	Phase-to-phase angle $\phi_{23}$	$\phi_{23}$	°	×	×	×	○	●
	Phase-to-phase angle $\phi_{31}$	$\phi_{31}$	°	×	×	×	○	●
	THD of phase-to-phase voltage $THD_{U12}$	U12%	%THD	×	●	●	○	●
	THD of phase-to-phase voltage $THD_{U23}$	U23%	%THD	×	●	●	○	●
	THD of phase-to-phase voltage $THD_{U31}$	U31%	%THD	×	●	●	○	●
Energy	Counters 1–4	E1, E2	Wh VAh	●	●	●	●	●
	Active tariff	Atar		●	●	●	●	●
Max. values MD	MD current $I_1$	I1	A	●	●	●	●	●
	MD current $I_2$	I2	A	×	○	●	○	●
	MD current $I_3$	I3	A	×	○	●	○	●
	MD active power P (positive)	P+	W	●	●	●	●	●
	MD active power P (negative)	P-	W	●	●	●	●	●
	MD reactive power Q-L	$Q_{\text{L}}$	var	●	●	●	●	●
	MD reactive power Q-C	$Q_{\text{C}}$	var	●	●	●	●	●
MD apparent power S	S	VA	●	●	●	●	●	

● - serial ○ - option × - not supported




## PLEASE NOTE



Basic and MD measurements have designations for recognition via LCD. In this way they can be selected via LCD for a display on customized screens.



**WARNING!**



When, due to mode of connection, unsupported measurement is selected for customized screen an undefined value is displayed.

## Explanation of basic concepts

### Sample factor – MV



A device measures all primary quantities with sample frequency which cannot exceed a certain number of samples in a time period. Based on these limitations (65 Hz·128 samples) a sample factor is calculated. A sample factor ( $M_V$ ), depending on frequency of a measured signal, defines a number of periods for a measurement calculation and thus a number of harmonics considered in calculations.

### Average interval – MP

Due to readability of measurements from LCD and via communication, an Average interval ( $M_P$ ) is calculated with regard to the measured signal frequency. The Average interval (see chapter *Average interval* on page 41) defines refresh rate of displayed measurements based on a sampling factor.

### Power and energy flow

Figures below show a flow of active power, reactive power and energy for 4u connection.

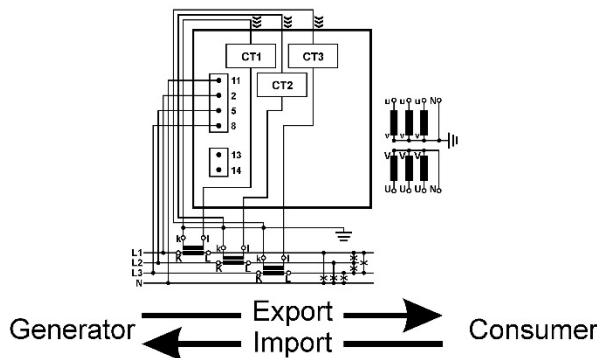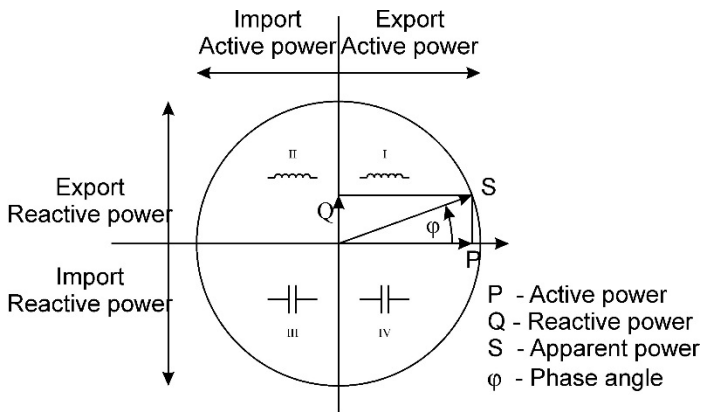

**PLEASE NOTE**



Display of energy flow direction can be adjusted to connection and operation requirements by changing the *Energy flow direction* settings in general / connection (see page 28).

## Present values

MC320 does not have all described measurements supported (see chapter *Type differences*, pages 11)



PLEASE NOTE



Since measurement support depends on connection mode some display groups can be combined in to one, within Measurements menu.

## Calculation and display of measurements

This chapter deals with capture, calculation and display of all supported quantities of measurement. Only the most important equations are described; however, all of them are shown in chapter *Equations* on page 72 with additional descriptions and explanations.

MC320 does not have all described measurements supported (see chapter *Type differences* on pages 11)



PLEASE NOTE




Calculation and display of measurements depend on the device type and connection used. For more detailed information see *chapters Survey of supported measurements regarding connection mode* on page 39.

For entry and quitting measurement display menu, the OK key is used. Direction keys (left / right / up / down) are used for passing between displays as show in example below.

Example for MC330 at 4u connection mode:



Main menu Main menu ⇒ Measurements ⇒ Present values ⇒ Voltage OK

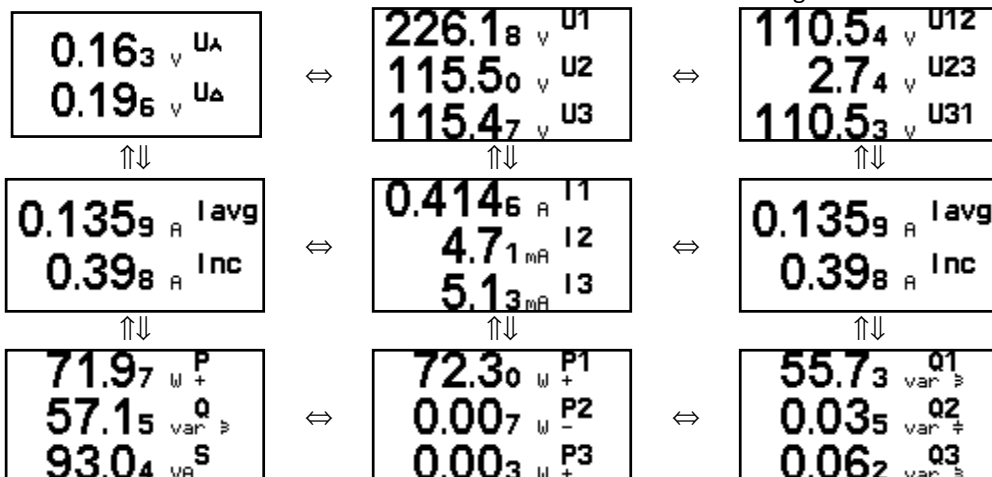


## Voltage

Instrument measures real effective (rms) value of all phase voltages ( $U_1, U_2, U_3$ ) connected to the meter. Phase-to-phase voltages ( $U_{12}, U_{23}, U_{31}$ ), average phase voltage ( $U_f$ ) and average phase-to-phase voltage ( $U_a$ ) are calculated from measured phase voltages ( $U_1, U_2, U_3$ ).

$$U_f = \sqrt{\frac{\sum_{n=1}^N u_n^2}{N}} \quad U_{xy} = \sqrt{\frac{\sum_{n=1}^N (u_{xn} - u_{yn})^2}{N}}$$

All voltage measurements are available via communication, serial and customized displays on LCD.


 Main menu  $\Rightarrow$  Measurements  $\Rightarrow$  Present values  $\Rightarrow$  Voltage OK

## Current

The device measures real effective (rms) value of phase currents, connected to current inputs. Neutral current ( $I_n$ ), average current ( $I_a$ ) and a sum of all phase currents ( $I_t$ ) are calculated from phase currents.


$$I_{RMS} = \sqrt{\frac{\sum_{n=1}^N I_n^2}{N}}$$

All current measurements are available via communication, serial (except  $I_t$ ) and customized displays on LCD.

 Main menu  $\Rightarrow$  Measurements  $\Rightarrow$  Present values  $\Rightarrow$  Current OK

## Active, reactive and apparent power


Active power is calculated from instantaneous phase voltages and currents. All measurements are seen via communication or are displayed on LCD. For more detailed information about calculation see chapter *Equations* on page 72.

 Main menu  $\Rightarrow$  Measurements  $\Rightarrow$  Present values  $\Rightarrow$  Power OK


## Power factor and power angle

Power angle is calculated as quotient of active and apparent power for each phase separately ( $\cos\varphi_1, \cos\varphi_2, \cos\varphi_3$ ) and total power angle ( $\cos\varphi_t$ ). A symbol for a coil represents inductive load and a symbol for a capacitor represents capacitive load. For correct display of PF via analogue output and application of the alarm, ePF (extended power factor) is applied. It illustrates power factor with one value as described in the table below. For a display on LCD both of them have equal display function: between -1 and 1 with the icon for inductive or capacitive load.


Load	C	$\rightarrow$		$\leftarrow$	L
Angle [°]	-180	-90	0	+90	+180 (179.99)
PF	-1	0	1	0	-1
ePF	-1	0	1	2	3

 Main menu  $\Rightarrow$  Measurements  $\Rightarrow$  Present values  $\Rightarrow$  PF & Power angle OK

Example of analogue output for PF and ePF (MC350 and MC350H only):



PF    -1    0    1  
       -180° -90° 0°  
       +180° +90°

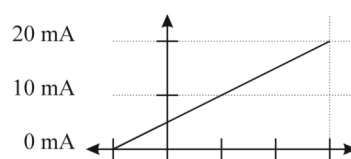


ePF    -1    0    1    2    3  
       -180° -90° 0° +90° +180°

Power angle represents angle between first voltage harmonic and first current harmonic for each individual phase. Total power angle is calculated from total active and reactive power (see equation for Total power angle, chapter *Equations* on page 72). A positive sign shows inductive load, and a negative sign shows capacitive load.


## Frequency

Network frequency is calculated from time periods of measured voltage.

 Main menu ⇒ Measurements ⇒ Present values ⇒ Frequency OK


## Energy

Two ways of energy display are available: by individual meters and by tariffs for each meter separately. At a display of meter energy by tariffs, the sum in the upper line depends on the tariffs set in the meter.

 Main menu ⇒ Measurements ⇒ Present values ⇒ Energy OK

## MD values

Display of MD values.

 Main menu ⇒ Measurements ⇒ Present values ⇒ MD values OK

## THD - Total harmonic distortion


THD is calculated for phase currents, phase and phase-to-phase voltages and is expressed as percent of high harmonic components regarding RMS value or relative to first harmonic.

Instrument uses measuring technique of real effective (rms) value that assures exact measurements with the presence of high harmonics up to 32nd harmonic.

 Main menu ⇒ Measurements ⇒ Present values ⇒ THD OK


## Customized screens

A display of customized screens depends on settings. See chapter *Settings of customized screens* on page 29.

 Main menu ⇒ Measurements ⇒ Present values ⇒ Custom OK

## Overview

It combines several measurements on each display as the following screens are displayed:

 Explanation of measurements for MC330 at connection mode 4u:

### SCREEN 1:

Current phase measurements			Current phase measurements		
U <sub>A</sub>	Average voltage U <sub>~</sub>	V	P	Total active power P <sub>t</sub>	W
1	Phase voltage U <sub>1</sub>	V	P1	Active power P <sub>1</sub>	W
2	Phase voltage U <sub>2</sub>	V	P2	Active power P <sub>2</sub>	W
3	Phase voltage U <sub>3</sub>	V	P3	Active power P <sub>3</sub>	W
I <sub>A</sub>	Average current I <sub>~</sub>	A	Q	Total reactive power Q <sub>t</sub>	var
1	Current I <sub>1</sub>	A	Q1	Reactive power Q <sub>1</sub>	var
2	Current I <sub>2</sub>	A	Q2	Reactive power Q <sub>1</sub>	var
3	Current I <sub>3</sub>	A	Q3	Reactive power Q <sub>1</sub>	var

**SCREEN 2:**

Current phase-to-phase measurements		Current phase-to-phase measurements	
U $\Delta$	Average phase-to-phase U $\sim$ V	Frequency f	Hz
12	Phase-to-phase voltage U $_{12}$ V	$\phi$	Power angle $\phi_1$ °
23	Phase-to-phase voltage U $_{23}$ V	$\phi$	Power angle $\phi_2$ °
31	Phase-to-phase voltage U $_{31}$ V	$\phi$	Power angle $\phi_3$ °
PF	Total power factor	$\phi$	Average phase-to-phase angle $\phi$ °
PF1	Power factor PF $_1$	$\phi$	Power angle $\phi_{12}$ °
PF2	Power factor PF $_2$	$\phi$	Power angle $\phi_{23}$ °
PF3	Power factor PF $_3$	$\phi$	Power angle $\phi_1$ °

**SCREEN 3:**

Dynamic MD values				Maximal MD values			
P+	MD active power (positive)	P	W	MD active power P (positive)	P	W	
P-	MD active power (negative)	P	W	MD active power (negative)	P	W	
Q $\ominus$	MD reactive power Q-L	var		MD reactive power Q-L	var		
Q $\oplus$	MD reactive power Q-C	var		MD reactive power Q-C	var		
S	MD apparent power S	VA		MD apparent power S	VA		
I1	MD current I1	A		MD current I1	A		
I2	MD current I2	A		MD current I2	A		
I3	MD current I3	A		MD current I3	A		

Example for MC350 at connection 4u:

Main menu  $\Rightarrow$  Measurements  $\Rightarrow$  Present values  $\Rightarrow$  Overview OK /  $\Rightarrow$

U $\Delta$	U $_{12}$	U $_{23}$	U $_{31}$	U $_{12}$	U $_{23}$	U $_{31}$	f	P+	P-	Q $\ominus$	Q $\oplus$	S	I1	I2	I3
151.14	109.90	109.74	109.57	74.17	109.90	109.74	49.996	64.933	0.000	0.000	0.000	4.4640	0.000	4.658	0.007
224.93	2.277	3.277	3.277	-2.277	3.277	3.277		6.562	3.3265	14.994	10.010	10.007			
114.56	0.000	0.000	0.000	0.000	0.000	0.000		0.000	0.000	0.000	0.000	0.000			
0.13	0.000	0.000	0.000	0.000	0.000	0.000		0.000	0.000	0.000	0.000	0.000			
0.39	0.000	0.000	0.000	0.000	0.000	0.000		0.000	0.000	0.000	0.000	0.000			
4.69	0.000	0.000	0.000	0.000	0.000	0.000		0.000	0.000	0.000	0.000	0.000			
5.11	0.000	0.000	0.000	0.000	0.000	0.000		0.000	0.000	0.000	0.000	0.000			

## Alarms

An alarm menu enables surveying state of alarms. In the basic alarm menu, groups of alarms with the states of individual alarms and data on alarm outputs are displayed in the bottom line. For each active alarm a number of an alarm is written in a certain group at a certain place: Group 1: 1...45...8. Dot stands for alarm not active.

```

Measurements
Present values
Alarms
Demo cycling
Main menu
    
```

OK

```

Alarms
Group 1: 123...
Group 2: .....
Out 1
Measurements
    
```

OK

```

G1A1 U1 < 200.00
G1A2 U2 < 200.00
G1A3 U3 < 200.00
G1A4 U1 > 300.00
G1A5 U2 > 300.00
G1A6 U3 > 300.00
G1A7 --
G1A8 --
    
```

### Survey of alarms

In a detailed survey alarms are collected in groups. A number of a group and alarm is stated in the first column, a measurement designation in the second, and a condition for alarm in the third one. Active alarm is marked.



Main menu ⇒ Measurements ⇒ Alarms OK / ⇒

## Demonstration measurements

### Demo cycling

Regarding the period that is defined in settings, measurement screen cycling is started until any key is pressed.



Main menu ⇒ Measurements ⇒ Demo cycling OK

# TECHNICAL DATA

## Accuracy

Measured values	Range		Accuracy class*
Rms current ( $I_1, I_2, I_3, I_{avg}, I_n$ )	1 A		0.5
	5 A		0.5
Maximum current	12.5 A		0.5**
Rms phase voltage ( $U_1, U_2, U_3, U_{avg}$ )	75 V <sub>L-N</sub>		0.5
	120 V <sub>L-N</sub>		0.5
	250 V <sub>L-N</sub>		0.5
	500 V <sub>L-N</sub>		0.5
Maximum voltage	600 V		0.5**
Rms phase-to-phase voltage ( $U_{12}, U_{23}, U_{31}, U_{avg}$ )	120 V <sub>L-L</sub>		0.5
	210 V <sub>L-L</sub>		0.5
	400 V <sub>L-L</sub>		0.5
	800 V <sub>L-L</sub>		0.5
Frequency (f) – actual	50 / 60 Hz		10 mHz
Nominal frequency range	16...400 Hz		0.02
Power angle ( $\phi$ )	-180...0...180°		0.5°
Power factor (PF)	-1...0...+1		0.5
	U = 50 ... 120 % $U_n$ I = 2 % ... 200 % $I_n$		
Maximal values (MD)	75	375	1.0
	120	600	
	250	1250	
	500	2500	
	[W/var/VA]	[W/var/VA]	
	$I_n = 1 \text{ A}$	$I_n = 5 \text{ A}$	
THD	5...500 V		0.5
	0...400 %		
Active power	75	375	0.5
Reactive power	120	600	
	Apparent power	250	1250
500		2500	
	[W/var/VA]	[W/var/VA]	0.5
	$I_n = 1 \text{ A}$	$I_n = 5 \text{ A}$	
Active energy	EN 62053-21		Class 1***
Active energy (optional)	EN 62053-22		Class 0.5S***
Reactive energy	EN 62053-23		Class 2***



PLEASE NOTE



\* – All measurements are calculated with high harmonic signals. For voltage up to 65 Hz or less, harmonics up to 32<sup>nd</sup> are measured.

\*\* – From range

\*\*\* – Partial compliance

## Inputs

Voltage input	Nominal voltage ( $U_n$ )	500 $V_{L-N}$	
	Rating	75 $V_{L-N}$ / 250 $V_{L-N}$ / 500 $V_{L-N}$	
	Overload	1.2 x $U_n$ permanently	
	Minimal measurement	From starting voltage for all powers	
	Maximal measurement	600 $V_{L-N}$	
	Consumption	< 0.1 VA per phase	
Current input	Nominal current ( $I_n$ )	5 A	
	Rating	1 A / 5 A	
	Overload	3 x $I_n$ permanently, 25 x $I_n$ – 3 s, 50 x $I_n$ – 1 s	
	Minimal measurement	From starting current for all powers	
	Maximal measurement	12,5 A sinusoidal	
	Consumption	< 0.1 VA per phase	
Frequency	Nominal frequency ( $f_n$ )	50, 60 Hz	
	Measuring range	16...400 Hz	
	Maximum range	10 Hz...1 kHz	
Supply	Universal	AC voltage range	48...276 V
		AC frequency range	40...65 Hz
		DC voltage range	20...300 V
	AC	Consumption	< 5 VA
		Voltage range	57.7, 63.5, 100, 110, 230, 240, 400, 500 V
		Consumption	< 3 VA

## Connection

### Permitted conductor cross-sections

Terminals	Max. conductor cross-sections
Voltage inputs (4)	$\leq 2.5 \text{ mm}^2$
Current inputs (3)	$\leq \varnothing 6 \text{ mm}$ one conductor with insulation
Supply (2)	$\leq 2.5 \text{ mm}^2$
Modules (2 x 3)	$\leq 2.5 \text{ mm}^2$ one conductor



## Modules

<b>Relay output</b> <b>(MC330, MC350, MC350H only)</b>	<table> <tr> <td>Purpose</td> <td>alarm, pulse, general purpose digital output</td> </tr> <tr> <td>Type</td> <td>Electromechanical Relay switch</td> </tr> <tr> <td>Rated voltage AC</td> <td>250 V AC</td> </tr> <tr> <td>Max. switching current AC</td> <td>1000 mA AC</td> </tr> <tr> <td>Rated voltage DC</td> <td>250 V DC</td> </tr> <tr> <td>Max. switching current DC</td> <td>200 mA DC</td> </tr> <tr> <td></td> <td>(valid for resistive load)</td> </tr> <tr> <td>Contact resistance</td> <td>≤ 100 mΩ (100 mA, 24 V)</td> </tr> <tr> <td>Pulse (if used as pulse output)</td> <td>Max. No.4000 imp/hour Min. length 100 ms</td> </tr> <tr> <td>Insulation voltage</td> <td></td> </tr> <tr> <td>Between coil and contact</td> <td>4 kV AC TRMS</td> </tr> <tr> <td>Between contacts</td> <td>1 kV AC TRMS</td> </tr> </table>	Purpose	alarm, pulse, general purpose digital output	Type	Electromechanical Relay switch	Rated voltage AC	250 V AC	Max. switching current AC	1000 mA AC	Rated voltage DC	250 V DC	Max. switching current DC	200 mA DC		(valid for resistive load)	Contact resistance	≤ 100 mΩ (100 mA, 24 V)	Pulse (if used as pulse output)	Max. No.4000 imp/hour Min. length 100 ms	Insulation voltage		Between coil and contact	4 kV AC TRMS	Between contacts	1 kV AC TRMS
Purpose	alarm, pulse, general purpose digital output																								
Type	Electromechanical Relay switch																								
Rated voltage AC	250 V AC																								
Max. switching current AC	1000 mA AC																								
Rated voltage DC	250 V DC																								
Max. switching current DC	200 mA DC																								
	(valid for resistive load)																								
Contact resistance	≤ 100 mΩ (100 mA, 24 V)																								
Pulse (if used as pulse output)	Max. No.4000 imp/hour Min. length 100 ms																								
Insulation voltage																									
Between coil and contact	4 kV AC TRMS																								
Between contacts	1 kV AC TRMS																								
<b>S0 (pulse) output</b>	<table> <tr> <td>Purpose</td> <td>pulse, alarm, general purpose digital output</td> </tr> <tr> <td>Type</td> <td>Optocoupler open collector switch</td> </tr> <tr> <td>Rated voltage</td> <td>40 V AC/DC</td> </tr> <tr> <td>Max. switching current</td> <td>30 mA (<math>R_{ONmax} = 8 \Omega</math>)</td> </tr> <tr> <td>Pulse length (if used as pulse output)</td> <td>programmable (2 ... 1000 ms)</td> </tr> </table>	Purpose	pulse, alarm, general purpose digital output	Type	Optocoupler open collector switch	Rated voltage	40 V AC/DC	Max. switching current	30 mA ( $R_{ONmax} = 8 \Omega$ )	Pulse length (if used as pulse output)	programmable (2 ... 1000 ms)														
Purpose	pulse, alarm, general purpose digital output																								
Type	Optocoupler open collector switch																								
Rated voltage	40 V AC/DC																								
Max. switching current	30 mA ( $R_{ONmax} = 8 \Omega$ )																								
Pulse length (if used as pulse output)	programmable (2 ... 1000 ms)																								
<b>Tariff input module</b>	<table> <tr> <td>Rated voltage</td> <td>230 V ± 20 % AC/DC 75 ... 110 V AC/DC</td> </tr> <tr> <td>Max. current</td> <td>&lt; 0.6 mA</td> </tr> <tr> <td>Frequency range</td> <td>45 ... 65 Hz</td> </tr> <tr> <td>ON voltage</td> <td>40 ... 120 % of rated voltage</td> </tr> <tr> <td>OFF voltage</td> <td>0 ... 10 % of rated voltage</td> </tr> </table>	Rated voltage	230 V ± 20 % AC/DC 75 ... 110 V AC/DC	Max. current	< 0.6 mA	Frequency range	45 ... 65 Hz	ON voltage	40 ... 120 % of rated voltage	OFF voltage	0 ... 10 % of rated voltage														
Rated voltage	230 V ± 20 % AC/DC 75 ... 110 V AC/DC																								
Max. current	< 0.6 mA																								
Frequency range	45 ... 65 Hz																								
ON voltage	40 ... 120 % of rated voltage																								
OFF voltage	0 ... 10 % of rated voltage																								
<b>Digital input module</b> <b>(MC330, MC350, MC350H only)</b>	<table> <tr> <td>Rated voltage</td> <td>230 V ± 20 % AC/DC 75 ... 110 V AC/DC 24 V DC</td> </tr> <tr> <td>Max. current</td> <td>&lt; 0.6 mA</td> </tr> <tr> <td>Frequency range</td> <td>45 ... 65 Hz</td> </tr> <tr> <td>ON voltage</td> <td>40 ... 120 % of rated voltage</td> </tr> <tr> <td>OFF voltage</td> <td>0 ... 10 % of rated voltage</td> </tr> </table>	Rated voltage	230 V ± 20 % AC/DC 75 ... 110 V AC/DC 24 V DC	Max. current	< 0.6 mA	Frequency range	45 ... 65 Hz	ON voltage	40 ... 120 % of rated voltage	OFF voltage	0 ... 10 % of rated voltage														
Rated voltage	230 V ± 20 % AC/DC 75 ... 110 V AC/DC 24 V DC																								
Max. current	< 0.6 mA																								
Frequency range	45 ... 65 Hz																								
ON voltage	40 ... 120 % of rated voltage																								
OFF voltage	0 ... 10 % of rated voltage																								
<b>Analogue output</b> <b>(MC350, MC350H, with aux. power supply type H only)</b>	<table> <tr> <td>Output range</td> <td>0 ... 20 mA</td> </tr> <tr> <td>Accuracy</td> <td>0.5 % of range</td> </tr> <tr> <td>Maximum load</td> <td>150 Ω</td> </tr> <tr> <td>Max. voltage on output (open circuit current output)</td> <td>5 V</td> </tr> <tr> <td>Linearization</td> <td>Linear, Quadratic</td> </tr> <tr> <td>Max. No. of break points</td> <td>5</td> </tr> <tr> <td>Output value limits</td> <td>120 % of nominal output</td> </tr> <tr> <td>Response time of analogue output</td> <td>Depends on set Average interval (8 – 256 periods)</td> </tr> <tr> <td>Residual ripple</td> <td>&lt; 1 % p.p.</td> </tr> </table>	Output range	0 ... 20 mA	Accuracy	0.5 % of range	Maximum load	150 Ω	Max. voltage on output (open circuit current output)	5 V	Linearization	Linear, Quadratic	Max. No. of break points	5	Output value limits	120 % of nominal output	Response time of analogue output	Depends on set Average interval (8 – 256 periods)	Residual ripple	< 1 % p.p.						
Output range	0 ... 20 mA																								
Accuracy	0.5 % of range																								
Maximum load	150 Ω																								
Max. voltage on output (open circuit current output)	5 V																								
Linearization	Linear, Quadratic																								
Max. No. of break points	5																								
Output value limits	120 % of nominal output																								
Response time of analogue output	Depends on set Average interval (8 – 256 periods)																								
Residual ripple	< 1 % p.p.																								

## Communication

	RS232	RS485	USB	Service USB	Profibus	M-Bus
Type of connection	Direct	Network	Direct	Direct	Network	Direct
Max. connection length	3 m	1000 m	5 m	5 m	100 - 1200 m	1000 m
Terminals	3 pin connector		USB – B type	Mini USB – B type	DSUB 9-pin female	3 pin connector
Insulation	In accordance with EN 61010-1 standard			Not galvanic insulated	Galvanic insulated	Galvanic insulated
Transfer mode	Asynchronous					
Protocol	MODBUS RTU /DNP3			Profibus – IEC61158	M-Bus –EN13757	
Transfer rate	2.400 to 115.200 bit/s		115.200 bit/s		9.6 kbit/s to 12 Mbit/s	300 to 9600 bit/s

## Electronic features

<b>LCD</b> Type Size LCD refreshing	Graphic LCD 128 x 64 dots Every 200 ms
<b>Response time</b> Input – screen Input – communication Input – alarm	All calculations are averaged over an interval of between 8 to 256 periods. Present interval is 64 periods, which is 1.28 second at 50 Hz.
<b>Memory (MC350 &amp; MC350H only)</b> Capacity Divisions Selection of limit values Sampling period	8 Mb built in flash Recorders A and B Alarms recorder Average, minimum, maximum actual 1 to 60 min
<b>LED's</b> Pulse output Alarm (MC350, MC350H and MC330 only)	Red Energy flow Red Fulfilled condition for alarm
<b>RTC backup supply</b> Supercap	Lifespan 2 days

## Safety features


<b>Safety</b>	In compliance with EN 61010-1 600 V rms, installation category II 300 V rms, installation category III Pollution degree 2
<b>Test voltage</b>	3.7 kV rms,
<b>EMC</b>	Directive on electromagnetic compatibility 2014/30/EU In compliance with EN 61326-1
<b>Protection</b>	In compliance with EN 60529 Front side: IP52 Rear side (with protection cover): IP20
<b>Ambient conditions</b>	
Temperature range of operation	-10 to +60°C
Storage temperature range	-40 to +70°C
Max. storage and transport humidity	≤ 75% r.h.
<b>Enclosure</b>	
Material	PC, incombustibility – self-extinguishability, in compliance with UL 94 V0
Weight	Max. 500 g

# Dimensions

## CASING

Construction	Appearance
	All dimensions are in mm

## PANEL CUT OUT

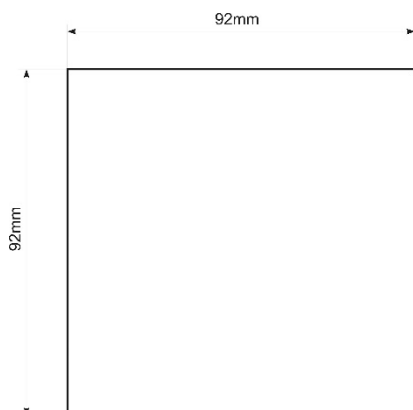

# APPENDIX A: MODBUS PROTOCOL

## Modbus communication protocol

Modbus and DNP3 protocol are enabled via RS232 or RS485 or USB communication port. The response is the same type as the request.

### Modbus protocol

Modbus protocol enables operation of device on Modbus networks. For device with serial communication the Modbus protocol enables point to point (for example Device to PC) communication via RS232 communication and multi drop communication via RS485 communication. Modbus protocol is a widely supported open interconnect originally designed by Modicon.

The memory reference for input and holding registers is 30000 and 40000 respectively.

At MODBUS register 40100 (MODBUS table for measurements) you can select register map. Value "0" is MC7X0 compatible register map. Value "1" is MI71X0 compatible register map.

Register table for the actual measurements

Parameter	Type	MC7x0 RM Comp.		MI71x0 RM Comp.	
		Start	End	Start	End
Voltage $U_1$	T5	30107	30108	30044	30045
Voltage $U_2$	T5	30109	30110	30046	30047
Voltage $U_3$	T5	30111	30112	30048	30049
Average phase Voltage $U_{\sim}$	T5	30113	30114	30042	30043
Phase to phase voltage $U_{12}$	T5	30118	30119	30081	30082
Phase to phase voltage $U_{23}$	T5	30120	30121	30083	30084
Phase to phase voltage $U_{31}$	T5	30122	30123	30085	30086
Avg. phase to phase Voltage $U_{pp\sim}$	T5	30124	30125	30079	30080
Current $I_1$	T5	30126	30127	30036	30037
Current $I_2$	T5	30128	30129	30038	30039
Current $I_3$	T5	30130	30131	30040	30041
Total Current I	T5	30138	30139	30034	30035
Neutral current $I_n$	T5	30132	30133	30074	30075
Real Power $P_1$	T6	30142	30143	30020	30021
Real Power $P_2$	T6	30144	30145	30022	30023
Real Power $P_3$	T6	30146	30147	30024	30025
Total Real Power P	T6	30140	30141	30018	30019
Reactive Power $Q_1$	T6	30150	30151	30028	30029
Reactive Power $Q_2$	T6	30152	30153	30030	30031
Reactive Power $Q_3$	T6	30154	30155	30032	30033
Total Reactive Power Q	T5	30148	30149	30026	30027
Apparent Power $S_1$	T5	30158	30159	30052	30053
Apparent Power $S_2$	T5	30160	30161	30054	30055
Apparent Power $S_3$	T5	30162	30163	30056	30057
Total Apparent Power S	T7	30156	30157	30050	30051

Parameter	Type	MC7x0 RM Comp.		MI71x0 RM Comp.	
		Start	End	Start	End
Power Factor PF <sub>1</sub>	T7	30166	30167	30060	30061
Power Factor PF <sub>2</sub>	T7	30168	30169	30062	30063
Power Factor PF <sub>3</sub>	T7	30170	30171	30064	30065
Total Power Factor PF	T7	30164	30165	30058	30059
Power Angle U <sub>1</sub> -I <sub>1</sub>	T2	30173		30071	
Power Angle U <sub>2</sub> -I <sub>2</sub>	T2	30174		30072	
Power Angle U <sub>3</sub> -I <sub>3</sub>	T2	30175		30073	
Power Angle atan2(Pt, Qt)	T2	30172		30070	
Angle U <sub>1</sub> -U <sub>2</sub>	T2	30115		30076	
Angle U <sub>2</sub> -U <sub>3</sub>	T2	30116		30077	
Angle U <sub>3</sub> -U <sub>1</sub>	T2	30117		30078	
Frequency f	T5	30105	30106		
Frequency f (mHz)	T1			30066	
THD I <sub>1</sub>	T1	30188		30118	
THD I <sub>2</sub>	T1	30189		30119	
THD I <sub>3</sub>	T1	30190		30120	
THD U <sub>1</sub>	T1	30182		30112	
THD U <sub>2</sub>	T1	30183		30113	
THD U <sub>3</sub>	T1	30184		30114	
THD U <sub>12</sub>	T1	30185		30115	
THD U <sub>23</sub>	T1	30186		30116	
THD U <sub>31</sub>	T1	30187		30117	
Max Demand Since Last RESET					
MD Real Power P (positive)	T6	30542	30543		
MD Real Power P (negative)	T6	30548	30549		
MD Reactive Power Q – L	T6	30554	30555		
MD Reactive Power Q – C	T6	30560	30561		
MD Apparent Power S	T5	30536	30537		
MD Current I <sub>1</sub>	T5	30518	30519		
MD Current I <sub>2</sub>	T5	30524	30525		
MD Current I <sub>3</sub>	T5	30530	30531		
Dynamic Demand Values					
MD Real Power P (positive)	T6	30510	30511		
MD Real Power P (negative)	T6	30512	30513		
MD Reactive Power Q – L	T6	30514	30515		
MD Reactive Power Q –	T6	30516	30517		
MD Apparent Power S	T5	30508	30509		
MD Current I <sub>1</sub>	T5	30502	30503		
MD Current I <sub>2</sub>	T5	30504	30505		
MD Current I <sub>3</sub>	T5	30506	30507		
Energy					
Energy Counter 1 Exponent	T2	30401		30006	
Energy Counter 2 Exponent	T2	30402		30007	
Energy Counter 3 Exponent	T2	30403		30008	
Energy Counter 4 Exponent	T2	30404		30009	

Parameter	Type	MC7x0 RM Comp.		MI71x0 RM Comp.	
		Start	End	Start	End
Counter E1	T3	30406	30407	30010	30011
Counter E2	T3	30408	30409	30012	30013
Counter E3	T3	30410	30411	30014	30015
Counter E4	T3	30412	30413	30016	30017
Active tariff	T1	30405		30133	
Internal Temperature	T17	30181		30128	

## Register table for the normalized actual measurements

Parameter	MODBUS		100% value
	Register	Type	
Voltage $U_1$	30801	T16	Un
Voltage $U_2$	30802	T16	Un
Voltage $U_3$	30803	T16	Un
Average phase Voltage $U_{\sim}$	30804	T16	Un
Phase to phase voltage $U_{12}$	30805	T16	Un
Phase to phase voltage $U_{23}$	30806	T16	Un
Phase to phase voltage $U_{31}$	30807	T16	Un
Average phase to phase Voltage	30808	T16	Un
Current $I_1$	30809	T16	In
Current $I_2$	30810	T16	In
Current $I_3$	30811	T16	In
Total Current I	30812	T16	It
Neutral current $I_n$	30813	T16	In
Average Current $I_{\sim}$	30815	T16	In
Real Power $P_1$	30816	T17	Pn
Real Power $P_2$	30817	T17	Pn
Real Power $P_3$	30818	T17	Pn
Total Real Power P	30819	T17	Pt
Reactive Power $Q_1$	30820	T17	Pn
Reactive Power $Q_2$	30821	T17	Pn
Reactive Power $Q_3$	30822	T17	Pn
Total Reactive Power Q	30823	T17	Pt
Apparent Power $S_1$	30824	T16	Pn
Apparent Power $S_2$	30825	T16	Pn
Apparent Power $S_3$	30826	T16	Pn
Total Apparent Power S	30827	T16	Pt
Power Factor $PF_1$	30828	T17	1
Power Factor $PF_2$	30829	T17	1
Power Factor $PF_3$	30830	T17	1
Total Power Factor PF	30831	T17	1
CAP/IND P.F. Phase 1 ( $PF_1$ )	30832	T17	1
CAP/IND P.F. Phase 2 ( $PF_2$ )	30833	T17	1
CAP/IND P.F. Phase 3 ( $PF_3$ )	30834	T17	1
CAP/IND P.F. Total ( $PF_t$ )	30835	T17	1

Parameter	MODBUS		100% value
	Register	Type	
Power Angle $U_1-I_1$	30836	T17	100°
Power Angle $U_2-I_2$	30837	T17	100°
Power Angle $U_3-I_3$	30838	T17	100°
Power Angle $\text{atan } 2(P_t, Q_t)$	30839	T17	100°
Angle $U_1-U_2$	30840	T17	100°
Angle $U_2-U_3$	30841	T17	100°
Angle $U_3-U_1$	30842	T17	100°
Frequency	30843	T17	$F_n+10\text{Hz}$
THD $I_1$	30845	T16	100%
THD $I_2$	30846	T16	100%
THD $I_3$	30847	T16	100%
THD $U_1$	30848	T16	100%
THD $U_2$	30849	T16	100%
THD $U_3$	30850	T16	100%
THD $U_{12}$	30851	T16	100%
THD $U_{23}$	30852	T16	100%
THD $U_{31}$	30853	T16	100%
<b>Max Demand Since Last Reset</b>			
MD Real Power P (positive)	30854	T16	Pt
MD Real Power P (negative)	30855	T16	Pt
MD Reactive Power Q – L	30856	T16	Pt
MD Reactive Power Q – C	30857	T16	Pt
MD Apparent Power S	30858	T16	Pt
MD Current $I_1$	30859	T16	In
MD Current $I_2$	30860	T16	In
MD Current $I_3$	30861	T16	In
<b>Dynamic Demand Values</b>			
MD Real Power P (positive)	30862	T16	Pt
MD Real Power P (negative)	30863	T16	Pt
MD Reactive Power Q – L	30864	T16	Pt
MD Reactive Power Q – C	30865	T16	Pt
MD Apparent Power S	30866	T16	Pt
MD Current $I_1$	30867	T16	In
MD Current $I_2$	30868	T16	In
MD Current $I_3$	30869	T16	In
<b>Energy</b>			
Energy Counter 1	30870	T17	Actual counter value MOD 20000 is returned
Energy Counter 2	30871	T17	
Energy Counter 3	30872	T17	
Energy Counter 4	30873	T17	
Active Tariff	30879	T1	
Internal Temperature	30880	T17	100°



## 100% values calculations for normalized measurements

Un =	(R40147 / R40146) * R30015 * R40149
In =	(R40145 / R40144) * R30017 * R40148
Pn =	Un*In
It =	In      Connection Mode: 1b
It =	3*In      Connection Modes: 3b, 4b, 3u, 4u
Pt =	Pn      Connection Mode: 1b
Pt =	3*Pn      Connection Modes: 3b, 4b, 3u, 4u
Fn =	R40150

Register	Content
30015	Calibration voltage
30017	Calibration current

## Register table for the basic settings

Register	Content	Type	Ind	Values / Dependencies	Min	Max	P. Level
40143	Connection Mode	T1	0	No mode	1	5	2
			1	1b - Single Phase			
			2	3b - 3 phase 3 wire balanced			
			3	4b - 3 phase 4 wire balanced			
			4	3u - 3 phase 3 wire unbalanced			
			5	4u - 3 phase 4 wire unbalanced			
40144	CT Secondary	T4		mA			2
40145	CT Primary	T4		A/10			2
40146	VT Secondary	T4		mV			2
40147	VT Primary	T4		V/10			2
40148	Current input range (%)	T16		10000 for 100%	5,00	200,00	2
40149	Voltage input range (%)	T16		10000 for 100%	2,50	100,00	2
40150	Frequency nominal value	T1		Hz	10	1000	2

## Data types decoding

Type	Bit mask	Description
T1		<b>Unsigned Value (16 bit)</b> Example: 12345 = 3039(16)
T2		<b>Signed Value (16 bit)</b> Example: -12345 = CFC7(16)
T3		<b>Signed Long Value (32 bit)</b> Example: 123456789 = 075B CD 15(16)
T4	bits # 15...14 bits # 13...00	<b>Short Unsigned float (16 bit)</b> Decade Exponent(Unsigned 2 bit) Binary Unsigned Value (14 bit) Example: 10000*102 = A710(16)
T5	bits # 31...24 bits # 23...00	<b>Unsigned Measurement (32 bit)</b> Decade Exponent(Signed 8 bit) Binary Unsigned Value (24 bit) Example: 123456*10-3 = FD01 E240(16)
T6	bits # 31...24 bits # 23...00	<b>Signed Measurement (32 bit)</b> Decade Exponent (Signed 8 bit) Binary Signed value (24 bit) Example: - 123456*10-3 = FDFE 1DC0(16)
T7	bits # 31...24 bits # 23...16 bits # 15...00	<b>Power Factor (32 bit)</b> Sign: Import/Export (00/FF) Sign: Inductive/Capacitive (00/FF) Unsigned Value (16 bit), 4 decimal places Example: 0.9876 CAP = 00FF 2694(16)
T9	bits # 31...24 bits # 23...16 bits # 15...08 bits # 07...00	<b>Time (32 bit)</b> 1/100s 00 - 99 (BCD) Seconds 00 - 59 (BCD) Minutes 00 - 59 (BCD) Hours 00 - 24 (BCD) Example: 15:42:03.75 = 7503 4215(16)
T10	bits # 31...24 bits # 23...16 bits # 15...00	<b>Date (32 bit)</b> Day of month 01 - 31 (BCD) Month of year 01 - 12 (BCD) Year (unsigned integer) 1998..4095 Example: 10, SEP 2000 = 1009 07D0(16)
T16		<b>Unsigned Value (16 bit), 2 decimal places</b> Example: 123.45 = 3039(16)
T17		<b>Signed Value (16 bit), 2 decimal places</b> Example: -123.45 = CFC7(16)
T_Str4		<b>Text:</b> 4 characters (2 characters for 16 bit register)
T_Str6		<b>Text:</b> 6 characters (2 characters for 16 bit register)
T_Str8		<b>Text:</b> 8 characters (2 characters for 16 bit register)
T_Str16		<b>Text:</b> 16 characters (2 characters for 16 bit register)
T_Str40		<b>Text:</b> 40 characters (2 characters for 16 bit register)

# APPENDIX B: DNP3 COMMUNICATION PROTOCOL

## DNP3 communication protocol

Modbus and DNP3 protocol are enabled via RS232 or RS485 or USB communication port. The response is the same type as the request.

### DNP3

DNP3 protocol enables operation of device on DNP3 networks. For device with serial communication the DNP3 protocol enables point to point (for example Device to PC) communication via RS232 communication and multi drop communication via RS485 communication.

Object			Request		Response	
Object Number	Variation Number	Description	Function Codes (dec)	Qualifier Codes (hex)	Function Codes (dec)	Qualifier Codes (hex)
0	242	Device Attributes - software version	1	00	129	00, 17
0	243	Device Attributes – hardware version	1	00	129	00, 17
0	246	Device Attributes – user assigned ID	1	00	129	00, 17
0	248	Device Attributes – serial number	1	00	129	00, 17
0	250	Device Attributes – product name	1	00	129	00, 17
0	252	Device Attributes – manufacture name	1	00	129	00, 17
0	254	Device Attributes – nonspecific all attributes request	1	00, 06		
0	255	Device Attributes – list of attribute variation	1	00, 06	129	00, 5B

Points for object 0						
0	Software version	T_Str3	Data	var	242	
0	Hardware version	T_Str2	Data	var	243	
0	user assigned ID	T_Str2	Data	var	246	
0	serial number	T_Str8	Data	var	248	
0	product name	T_Str16	Data	var	250	
0	manufacture name	T_Str20	Data	var	252	

Object			Request		Response	
Object Number	Variation Number	Description	Function Codes (dec)	Qualifier Codes (hex)	Function Codes (dec)	Qualifier Codes (hex)
10	0	Binary output status with flag	1	6		
10	2	Binary output status with flag	1	00, 01 ,06	129	00, 01

Points for object 10						
0	Relay 1	T1	Data	0	1	
1	Relay 2	T1	Data	0	1	

### Register table for the actual measurements

Object			Request		Response	
Object Number	Variation Number	Description	Function Codes (dec)	Qualifier Codes (hex)	Function Codes (dec)	Qualifier Codes (hex)
30	0	16-Bit Analog Input without flag	1	00, 01, 06		
30	2	16-Bit Analog Input with flag	1	00, 01, 06	129	00, 01
30	4	16-Bit Analog Input without flag	1	00, 01, 06	129	00, 01

Points for object 30						
0	U1	T16	Data	-Un	+Un	
1	U2	T16	Data	-Un	+Un	
2	U3	T16	Data	-Un	+Un	
3	Uavg (phase to neutral)	T16	Data	-Un	+Un	
4	U12	T16	Data	-Un	+Un	
5	U23	T16	Data	-Un	+Un	
6	U31	T16	Data	-Un	+Un	
7	Uavg (phase to phase)	T16	Data	-Un	+Un	
8	I1	T16	Data	-In	+In	
9	I2	T16	Data	-In	+In	
10	I3	T16	Data	-In	+In	
11	I total	T16	Data	-In	+In	
12	I neutral (calculated)	T16	Data	-In	+In	
13	I neutral (measured)	T16	Data	-In	+In	
14	Iavg	T16	Data	-In	+In	
15	Active Power Phase L1 (P1)	T17	Data	-Pn	+Pn	
16	Active Power Phase L2 (P2)	T17	Data	-Pn	+Pn	
17	Active Power Phase L3 (P3)	T17	Data	-Pn	+Pn	
18	Active Power Total (Pt)	T17	Data	-Pt	+Pt	
19	Reactive Power Phase L1 (Q1)	T17	Data	-Pn	+Pn	
20	Reactive Power Phase L2 (Q2)	T17	Data	-Pn	+Pn	
21	Reactive Power Phase L3 (Q3)	T17	Data	-Pn	+Pn	
22	Reactive Power Total (Qt)	T17	Data	-Pt	+Pt	
23	Apparent Power Phase L1 (S1)	T16	Data	-Pn	+Pn	
24	Apparent Power Phase L2 (S2)	T16	Data	-Pn	+Pn	
25	Apparent Power Phase L3 (S3)	T16	Data	-Pn	+Pn	
26	Apparent Power Total (St)	T16	Data	-Pt	+Pt	
27	Power Factor Phase 1 (PF1)	T17	Data	-1	+1	
28	Power Factor Phase 2 (PF2)	T17	Data	-1	+1	
29	Power Factor Phase 3 (PF3)	T17	Data	-1	+1	
30	Power Factor Total (PFt)	T17	Data	-1	+1	
31	CAP/IND P. F. Phase 1 (PF1)	T17	Data	-1 CAP	+1	300% for -1 IND
32	CAP/IND P. F. Phase 2 (PF2)	T17	Data	-1 CAP	+1	300% for -1 IND
33	CAP/IND P. F. Phase 3 (PF3)	T17	Data	-1 CAP	+1	300% for -1 IND
34	CAP/IND P. F. Total (PFt)	T17	Data	-1 CAP	+1	300% for -1 IND
35	j1 (angle between U1 and I1)	T17	Data	-100°	+100°	

36	j2 (angle between U2 and I2)	T17	Data	-100°	+100°	
37	j3 (angle between U3 and I3)	T17	Data	-100°	+100°	
38	Power Angle Total (atan2(Pt,Qt))	T17	Data	-100°	+100°	
39	j12 (angle between U1 and U2)	T17	Data	-100°	+100°	
40	j23 (angle between U2 and U3)	T17	Data	-100°	+100°	
41	j31 (angle between U3 and U1)	T17	Data	-100°	+100°	
42	Frequency	T17	Data	F <sub>n</sub> -10Hz	F <sub>n</sub> +10Hz	
43	U unbalance	T16	Data	-100%	+100%	
44	I1 THD%	T16	Data	-100%	+100%	
45	I2 THD%	T16	Data	-100%	+100%	
46	I3 THD%	T16	Data	-100%	+100%	
47	U1 THD%	T16	Data	-100%	+100%	
48	U2 THD%	T16	Data	-100%	+100%	
49	U3 THD%	T16	Data	-100%	+100%	
50	U12 THD%	T16	Data	-100%	+100%	
51	U23 THD%	T16	Data	-100%	+100%	
52	U31 THD%	T16	Data	-100%	+100%	
	MAX DEMAND SINCE LAST RESET					
53	Active Power Total (Pt) - (positive)	T16	Data	-Pt	+Pt	
54	Active Power Total (Pt) - (negative)	T16	Data	-Pt	+Pt	
55	Reactive Power Total (Qt) - L	T16	Data	-Pt	+Pt	
56	Reactive Power Total (Qt) - C	T16	Data	-Pt	+Pt	
57	Apparent Power Total (St)	T16	Data	-Pt	+Pt	
58	I1	T16	Data	-I <sub>n</sub>	+I <sub>n</sub>	
59	I2	T16	Data	-I <sub>n</sub>	+I <sub>n</sub>	
60	I3	T16	Data	-I <sub>n</sub>	+I <sub>n</sub>	
	DYNAMIC DEMAND VALUES					
61	Active Power Total (Pt) - (positive)	T16	Data	-Pt	+Pt	
62	Active Power Total (Pt) - (negative)	T16	Data	-Pt	+Pt	
63	Reactive Power Total (Qt) - L	T16	Data	-Pt	+Pt	
64	Reactive Power Total (Qt) - C	T16	Data	-Pt	+Pt	
65	Apparent Power Total (St)	T16	Data	-Pt	+Pt	
66	I1	T16	Data	-I <sub>n</sub>	+I <sub>n</sub>	
67	I2	T16	Data	-I <sub>n</sub>	+I <sub>n</sub>	
68	I3	T16	Data	-I <sub>n</sub>	+I <sub>n</sub>	
	ENERGY					
69	Energy Counter 1	T17	Data			(32-bit value) MOD
70	Energy Counter 2	T17	Data			(32-bit value) MOD
71	Energy Counter 3	T17	Data			(32-bit value) MOD
72	Energy Counter 4	T17	Data			(32-bit value) MOD
73	Energy Counter 1 Cost	T17	Data			(32-bit value) MOD
74	Energy Counter 2 Cost	T17	Data			(32-bit value) MOD
75	Energy Counter 3 Cost	T17	Data			(32-bit value) MOD
76	Energy Counter 4 Cost	T17	Data			(32-bit value) MOD
77	Total Energy Counter Cost	T17	Data			(32-bit value) MOD
78	Aktiv Tariff	T1	Data			
79	Internal Temperature	T17	Data	-100°	+100°	

Object			Request		Response	
Object Number	Variation Number	Description	Function Codes (dec)	Qualifier Codes (hex)	Function Codes (dec)	Qualifier Codes (hex)
60	1	CLASS 0 DATA	1	6		
60	2	CLASS 1 DATA	1.22*	06		
60	3	CLASS 2 DATA	1.22*	06		
60	4	CLASS 3 DATA	1.22*	06		

\*only object 30

Tests:

- Invalid start octets
- Invalid primary function code
- Invalid destination address
- Invalid CRC
- Invalid FCV


# APPENDIX C: PROFIBUS PROTOCOL

## Profibus overview

Iskra MC350H supports Profibus DP-V0 communication protocol. Up to 32 slave devices could be configured into the single Profibus network at the speeds up to 12 Mbps at ranges up to 100 meters. Each device could be configured as a slave device providing wide range of measuring data to the Profibus master. Profibus communication is enabled over a RS485 SUB-D 9- pin connector without internal terminal resistors. This requires the use of the standard Profibus cable with bus termination on it (390/220/390 Ohms).

To set Profibus connection settings could be done or via MiQen Settings Studio or via LCD screen. To use LCD screen please go to:

 Main menu ⇒ Settings ⇒ Communication ⇒

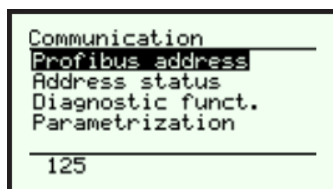

Main menu ⇒ Settings ⇒ Communication where 4 Profibus settings are available (slave address-default set to 125, address locking bit under address status, diagnostic option and parametrization option). To start using MC350H on the Profibus network only setting of the Profibus slave address is necessary. There is no setting for the baudrate, because the MC350H has baudrate autodetection and the baudrate is always set automatically by the Profibus Master. The same settings parameters are available also under MiQen menu: Settings ⇒ General ⇒ Communication.

## Structure of the input/output telegram

When Iskra MC350H Profibus enters the Data Exchange operation mode then standard SRD (Send and Request Data with acknowledge) telegrams are exchanged between Master device and MC350H device. Iskra defines one output telegrams (master to slave) and 4 input telegrams (slave to master), to provide data information being exchanged. Output telegram is used to write data into the output module registers. And the input telegrams are used to read one of four modules with measuring data. Telegrams are defined on the data section field (data field up to 244 Bytes long) inside the SDR message structure. The purpose of telegrams definition is to provide exchange of measurements data from MC350H to the Master device and to control MC350H outputs from the Master device.

MC350H output telegram is defined as:

Master telegram to the Slave	Meaning/contents	Value
Header byte 0	Telegram ID – or module number of the data segment to be requested	1-5
Header byte 1	reserved-not used at this time	
Header byte 2	control byte	WRXXX XXXDU
Header byte 3	reserved-not used at this time	
Data bytes 4-128	up to 124 bytes of user data	user data being exchanged

The output telegram is used to indicate to the MC350H which data module should be returned in the following input telegram. Output telegram is also used to write values to the MC350H output module registers. Header byte 0 indicates the module number index being requested. This number (1-4) tells the MC350H which module of measuring data should be transferred inside the input telegram which follows next or with number 5 indicates the output module being written.

Header bytes 1 and 3 are not used. Header byte 2 is used as a control byte to control operation flow as follows:

B7	B6	B5	B4	B3	B2	B1	B0
WR	X	X	X	X	X	X	DU

Bit 0 when set to 1 tells the MC350H device that it should update internal measuring data which are currently active on the Profibus exchange telegram. If this bit is set to 0, data are not refreshed on the Profibus network.

Bit 7 when cleared indicates that write operation to the module 5 output registers is being executed. When set indicates that read operation of the 1-5 module registers is performed.

In Data bytes section which follows Header byte 4 up to 124 bytes of measuring data for any of the 4 modules could be included. Module table definition is described in next section.

MC350H input telegram is defined as:

Slave telegram to the Master	Meaning/contents	Value
Header byte 0	telegram ID – or module number of the returned data segment	1-5
Header byte 1	reserved-not used at this time	
Header byte 2	reserved-not used at this time	
Header byte 3	status byte	XXXUP XXIDX
Data bytes 4-128	up to 124 bytes of user data	user data being exchanged

Header byte 0 indicates the module number index being requested. With this number (1-5) MC350H indicates to the Master which module of data is being transferred inside the SRD data section.

Header bytes 1 and 2 are not used.

Header byte 3 is used as a status byte with the following meaning.

B7	B6	B5	B4	B3	B2	B1	B0
X	X	X	UP	X	X	ID	X

With bit 4 (UP) set to 1 MC350H indicates to the Master that internal data update is in progress. Value 0 means that internal data processing completed.

With bit 1 (ID) set to 1 MC350H signals to the Master that telegram ID inside the header byte 1 is wrong (not in the range 1-5). This prevents errors when addressing wrong input telegrams at the Master output telegram.



## Telegrams table for the actual measurements

MODULE 1: Main measurements (Input telegram)					
Profibus byte index inside the telegram	Description	Modbus address start	Modbus address end	Data Type	Data Unit
4	U1	32500	32501	Float	V
8	U2	32502	32503	Float	V
12	U3	32504	32505	Float	V
16	Uavg (phase to neutral)	32506	32507	Float	V
20	U12	32508	32509	Float	V
24	U23	32510	32511	Float	V
28	U31	32512	32513	Float	V
32	Uavg (phase to phase)	32514	32515	Float	V
36	I1	32516	32517	Float	A
40	I2	32518	32519	Float	A
44	I3	32520	32521	Float	A
48	S I	32522	32523	Float	A
52	I neutral (calculated)	32524	32525	Float	A
56	Frequency	32584	32585	Float	HZ
60	U unbalance	32586	32587	Float	V
64	$\varphi$ 1 (angle between U1 and I1)	32570	32571	Float	°
68	$\varphi$ 2 (angle between U2 and I2)	32572	32573	Float	°
72	$\varphi$ 3 (angle between U3 and I3)	32574	32575	Float	°
76	Power Angle Total (atan2(Pt,Qt))	32576	32577	Float	°
80	$\varphi$ 12 (angle between U1 and U2)	32578	32579	Float	°
84	$\varphi$ 23 (angle between U2 and U3)	32580	32581	Float	°
88	$\varphi$ 31 (angle between U3 and U1)	32582	32583	Float	°
92	I1 THD%	32588	32589	Float	%
96	I2 THD%	32590	32591	Float	%
100	I3 THD%	32592	32593	Float	%
104	U1 THD%	32594	32595	Float	%
108	U2 THD%	32596	32597	Float	%
112	U3 THD%	32598	32599	Float	%
116	U12 THD%	32600	32601	Float	%
120	U23 THD%	32602	32603	Float	%
124	U31 THD%	32604	32605	Float	%

MODULE 2: Power & Energy (Input telegram)					
Profibus byte index inside the telegram	Description	Modbus address start	Modbus address end	Data Type	Data Unit
4	Active Power Phase L1 (P1)	32530	32531	Float	W
8	Active Power Phase L2 (P2)	32532	32533	Float	W
12	Active Power Phase L3 (P3)	32534	32535	Float	W
16	Active Power Total (Pt)	32536	32537	Float	W
20	Reactive Power Phase L1 (Q1)	32538	32539	Float	var
24	Reactive Power Phase L2 (Q2)	32540	32541	Float	var
28	Reactive Power Phase L3 (Q3)	32542	32543	Float	var
32	Reactive Power Total (Qt)	32544	32545	Float	var
36	Apparent Power Phase L1 (S1)	32546	32547	Float	VA
40	Apparent Power Phase L2 (S2)	32548	32549	Float	VA
44	Apparent Power Phase L3 (S3)	32550	32551	Float	VA
48	Apparent Power Total (St)	32552	32553	Float	VA
52	CAP/IND P. F. Phase 1 (PF1)	32562	32563	Float	
56	CAP/IND P. F. Phase 2 (PF2)	32564	32565	Float	
60	CAP/IND P. F. Phase 3 (PF3)	32566	32567	Float	
64	CAP/IND P. F. Total (PFt)	32568	32569	Float	
68	Energy Counter 1	32604	32605	Float	kWh
72	Energy Counter 2	32606	32607	Float	kWh
76	Energy Counter 3	32608	32609	Float	kWh
80	Energy Counter 4	32610	32611	Float	kWh
84	Aktiv Tarif	32622	32623	Float	

MODULE 3: Inputs & Outputs (Input telegram)					
Profibus byte index inside the telegram	Description	Modbus address start	Modbus address end	Data Type	Data Unit
4	Alarm Status Flags (No. 1...16)	30191	32531	T1	
6	Alarm Status Flags (No. 17...32)	30192	32533	T1	
8	I/O 1 Value	30193	32535	T17	
10	I/O 2 Value	30194	32537	T17	
12	I/O 3 Value	30195	32539	T17	
14	I/O 4 Value	30196	32541	T17	

MODULE 4: Maximum demand measurements (Input telegram)					
Profibus byte index inside the telegram	Description	Modbus address start	Modbus address end	Data Type	Data Unit
	MAX DEMAND SINCE LAST RESET				
4	Active Power Total (Pt) - (positive)	32606	32607	Float	W
8	Active Power Total (Pt) - (negative)	32608	32609	Float	W
12	Reactive Power Total (Qt) - L	32610	32611	Float	var
16	Reactive Power Total (Qt) - C	32612	32613	Float	var
20	Apparent Power Total (St)	32614	32615	Float	VA
24	I1	32616	32617	Float	A
28	I2	32618	32619	Float	A
32	I3	32620	32621	Float	A
	DYNAMIC DEMAND VALUES			Float	
36	Active Power Total (Pt) - (positive)	32622	32623	Float	W
40	Active Power Total (Pt) - (negative)	32624	32625	Float	W
44	Reactive Power Total (Qt) - L	32626	32627	Float	var
48	Reactive Power Total (Qt) - C	32628	32629	Float	var
52	Apparent Power Total (St)	32630	32631	Float	VA
56	I1	32632	32633	Float	A
60	I2	32634	32635	Float	A
64	I3	32636	32637	Float	A


MODULE 5: Settings for alarms and outputs (Output telegram)					
Profibus byte index inside the telegram	Description	Modbus address start	Data Type	Values	Meaning
4	Alarm/Output 1 signal	40722	T1	Relay value	Relay function
				3	Always ON
				4	Always OFF
6	Alarm/Output 2 signal	40725	T1	Relay value	Relay function
				3	Always ON
				4	Always OFF

# APPENDIX D: M-BUS

The M-BUS interface fully complies with M-BUS European standard EN13757-2. The entire communication is ensured with 8 Data Bits, Even Parity, 1 Stop Bit and a Baud Rate from 300 to 9600 Bauds.

## Communication settings

The M-Bus communication settings could be done via LCD screen. In Main menu select Settings and then Communication. The LCD screen will show the following picture:

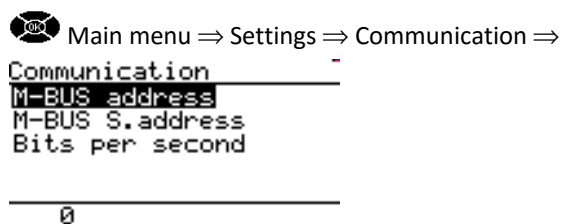

- M-BUS address represents primary address that is default set to 0. The primary address could takes numbers from 0 to 250. Higher address is used for special propose.
- M-BUS S.address represents secondary address that is default set to serial number of device. The secondary address could be any 8 digits number.
- Bits per seconds represent Baud rate of communication and could be in range from 300Bd to 9600Bd

## Command telegrams

### Initialize M-Bus (SNK\_NKE)

This Short Telegram initializes the M-BUS MC350. The M-BUS MC350 confirms correct receipt by Single Character Acknowledgement (ACK = E5). If the telegram was not correctly received the MC350 will not send an acknowledgement.

### Select M-BUS MC350 Using Secondary Address (SND\_UD)

This Telegram enables to select M-BUS MC350. The M-BUS MC350 confirms the correct receipt by ACK. If the telegram has not been correctly received the M-BUS MC350 will not send an Acknowledgement. After issue of the Single Character Acknowledgement the M-BUS MC350 is ready to transmit the entire Read-out Data within 3 seconds from receiving the Telegram „Transmit Read-out Data“. At the end of 3 seconds the M-BUS MC350 will switch back to normal mode.

### Transmit Read-out Data via Primary / Secondary Address (REQ\_UD2)

This Short Telegram enables to select the M-BUS MC350 and to command it to transmit the Read-out Data parameterized. The M-BUS MC350 confirms correct receipt by transmitting of the Read-out Data. If the Short Telegram has not been received correctly; no Data will be transmitted by the M-BUS MC350. The Read-out Data are sent within 35 – 75 ms from receipt of the Short Telegram by the M-BUS Meter. **Appendix D** shows M-Bus telegrams.

## Set Baud Rate via Primary / Secondary Address (SND\_UD)

This telegram enables to set the desired Baud Rate. The M-BUS MC350 confirms the correct receipt by ACK. If the telegram was not received correctly the M-BUS MC350 does not send an Acknowledgement. The (ACK) is sent by the M-BUS MC350 in the Old Baud Rate. As soon as ACK is transmitted the M-BUS Meter switches to the baud rate newly parameterized. If the MC350 now does not receive a new Telegram under the new baud rate within a period of 30 – 40 seconds, it automatically switches back to the old baud rate. This is apt to prevent that a faulty setting of the baud rate may interrupt communication.

## Set Primary Address via Primary / Secondary Address (SND\_UD)

This Telegram enables to set a new Primary Address. The M-BUS MC350 confirms the correct receipt by ACK. If the telegram has not been correctly received the M-BUS MC350 will not send an Acknowledgement.

## Set Secondary Address via Primary / Secondary Address (SND\_UD)

This Telegram enables to set a new Secondary Address. The M-BUS MC350 confirms the correct receipt by ACK. If the telegram has not been correctly received the M-BUS MC350 will not send an Acknowledgement.

Secondary Address (UD) consists of:

- Identification Number: 00000000 – 99999999 8-digit Secondary Address number
- Manufacturer's Code: 73 26 2 Byte Company Constant (Iskra = "73 26")
- Version Number: 01 – FF 1 Byte
- Medium: 02 1 Byte Constant Electricity

## Reset, Restart M-BUS MC350 via Primary / Secondary Address (SND\_UD)

This Telegram resets / restarts M-BUS MC350. The M-BUS MC350 confirms correct receipt by ACK. If the telegram was not correctly received the M-BUS MC350 will not send an acknowledgement.

## M-Bus Telegrams

### Total Energy counters 0,1,2,3

Energy counters could represent: +/- active energy, +/-reactive energy or apparent energy and one of 4-th tariff.

	DIF	DIFE	DIFE	VIF	VIFE	VIFE	VIFE	DATA
								XX.XX.XX.XX
T0:	04	none	none					
T1:	84	10	none					
T2:	84	20	none					
T3:	84	30	none					
T4:	84	80	10					
A+:				0n	none	none	none	*10 <sup>n-3</sup> Wh
A-:				8n	3C	none	none	*10 <sup>n-3</sup> Wh
R+:				FB	82	7n	none	*10 <sup>n-3</sup> varh
R-:				FB	82	Fn	3C	*10 <sup>n-3</sup> varh
App:				FB	84	7n	none	*10 <sup>n-3</sup> VAh

n - 0...7

### Active Tariff number

Tariff number in progress (1 to 4)

	DIF	DIFE	DIFE	VIF	VIFE	VIFE	VIFE	DATA
	01			FF	01			xx

DATA: value represent as 8-bit integer

## Active Power Total Pt (W)

Active power total in 32bit  $\times 10^{(nnn-3)}W$

	DIF	DIFE	DIFE	VIF	VIFE	DATA
	04			0010 1nnn <sub>b</sub>		xx.xx.xx.xx

n - 0...7

## Reactive Power Total (kvar)

Reactive power total in 32bit  $\times 10^{(nnn-3)}var$

	DIF	DIFE	VIF	VIFE	VIFE	VIFE	DATA
	04		FB	97	0111 0nnn <sub>b</sub>		xx.xx.xx.xx

n - 0...7

## Instant Apparent Power Total (VA)

Apparent power total in 32bit  $\times 10^{(nnn-6)}VA$

	DIF	DIFE	VIF	VIFE	VIFE	VIFE	DATA
	04		FB	B4	0111 0nnn <sub>b</sub>		xx.xx.xx.xx

n - 0...7

## Power Factor: -: leading et +: lagging: PF

Power factor as 32-bit integer  $\times 10^{-3}$

	DIF	DIFE	DIFE	VIF	VIFE	VIFE	VIFE	DATA
	04			A8	B4	35		xx.xx.xx.xx

Unit : W/V/A

## Current Total (A)

Total current as 32bit  $\times 10^{(nnnn-12)}A$

	DIF	DIFE	VIF	VIFE	VIFE	DATA
	04		FD	0101 nnnn <sub>b</sub>		xx.xx.xx.xx

n - 0...15

## System frequency (Hz/1000)

Contains the line frequency 32-bit integer in mHz.

	DIF	DIFE	DIFE	VIF	VIFE	VIFE	VIFE	DATA
	04			FB	2C			xx.xx.xx.xx

## Active Power in Phase 1,2,3 (W)

Active power in 32bit  $\times 10^{(nnn-3)}W$

	DIF	DIFE	DIFE	VIF	VIFE	VIFE	DATA
	04						xx.xx.xx.xx
P1:				1010 1nnn <sub>b</sub>	FC	01	
P2:				1010 1nnn <sub>b</sub>	FC	02	
P3:				1010 1nnn <sub>b</sub>	FC	03	

n - 0...7

## Current in Phase 1,2,3, Neutral (A)

Phase current as 32bit  $\times 10^{(nnnn-12)}$  A

	DIF	DIFE	VIF	VIFE	VIFE	VIFE	DATA
	04						xx.xx.xx.xx
I1:			FD	1101 nnnn <sub>b</sub>	FC	01	
I2:			FD	1101 nnnn <sub>b</sub>	FC	02	
I3:			FD	1101 nnnn <sub>b</sub>	FC	03	
In:			FD	1101 nnnn <sub>b</sub>	FC	04	

n - 0...15

## Voltages (V)

Voltage as 32bit  $\times 10^{(nnnn-9)}$  V

	DIF	DIFE	VIF	VIFE	VIFE	VIFE	DATA
	04						xx.xx.xx.xx
U1:			FD	1100 nnnn <sub>b</sub>	FC	01	
U2:			FD	1100 nnnn <sub>b</sub>	FC	02	
U3:			FD	1100 nnnn <sub>b</sub>	FC	03	
U12:			FD	1100 nnnn <sub>b</sub>	FC	05	
U23:			FD	1100 nnnn <sub>b</sub>	FC	06	
U31:			FD	1100 nnnn <sub>b</sub>	FC	07	

n - 0...15

# APPENDIX E: CALCULATIONS & EQUATIONS

## Calculations

### Definitions of symbols

No	Symbol	Definition
1	$M_v$	Sample factor
2	$M_p$	Average interval
3	$U_f$	Phase voltage (U1, U2 or U3)
4	$U_{ff}$	Phase-to-phase voltage (U12, U23 or U31)
5	$N$	Total number of samples in a period
6	$n$	Sample number ( $0 \leq n \leq N$ )
7	$x, y$	Phase number (1, 2 or 3)
8	$i_n$	Current sample $n$
9	$u_{fn}$	Phase voltage sample $n$
10	$u_{ffn}$	Phase-to-phase voltage sample $n$
11	$\phi_f$	Power angle between current and phase voltage $f$ ( $\phi_1, \phi_2$ or $\phi_3$ )

## Equations

### Voltage

$$U_f = \sqrt{\frac{\sum_{n=1}^N u_n^2}{N}}$$

#### Phase voltage

$N$  - 128 samples in one period (up to 65 Hz)

$N$  - 128 samples in  $M_v$  periods (above 65Hz)

Example: 400 Hz  $\rightarrow M_v = 7$

$$U_{xy} = \sqrt{\frac{\sum_{n=1}^N (u_{xn} - u_{yn})^2}{N}}$$

#### Phase-to-phase voltage

$u_x, u_y$  - phase voltages ( $U_f$ )

$N$  - a number of samples in a period



## Current

$$I_{\text{RMS}} = \sqrt{\frac{\sum_{n=1}^N i_{1n}^2}{N}}$$

### Phase current

N - 128 samples in a period (up to 65 Hz)

N - 128 samples in more periods (above 65 Hz)

$$I_n = \sqrt{\frac{\sum_{n=1}^N (i_{1n} + i_{2n} + i_{3n})^2}{N}}$$

### Neutral current

i - n sample of phase current (1, 2 or 3)

N - 128 samples in a period (up to 65 Hz)

## Power

$$P_f = \frac{1}{N} \cdot \sum_{n=1}^N (u_{fn} \cdot i_{fn})$$

### Active power by phases

N - a number of periods

n - index of sample in a period

f - phase designation

$$P_t = P_1 + P_2 + P_3$$

### Total active power

t - total power

1, 2, 3 - phase designation

$$\text{Sign}Q_f(\varphi)$$

$$\varphi \in [0^\circ - 180^\circ] \Rightarrow \text{Sign}Q_f(\varphi) = +1$$

$$\varphi \in [180^\circ - 360^\circ] \Rightarrow \text{Sign}Q_f(\varphi) = -1$$

### Reactive power sign

Q<sub>f</sub> - reactive power (by phases)

ϕ - power angle

$$S_f = U_f \cdot I_f$$

### Apparent power by phases

U<sub>f</sub> - phase voltage

I<sub>f</sub> - phase current

$$S_t = S_1 + S_2 + S_3$$

### Total apparent power

S<sub>f</sub> - apparent power by phases

$$Q_f = \text{Sign}Q_f(\varphi) \cdot \sqrt{S_f^2 - P_f^2}$$

### Reactive power by phases

S<sub>f</sub> - apparent power by phases

P<sub>f</sub> - active power by phases

$$Q_t = Q_1 + Q_2 + Q_3$$

### Total reactive power

Q<sub>f</sub> - reactive power by phases

$$\varphi_s = \arctan 2(P_t, Q_t)$$

$$\varphi_s = [-180^\circ, 179,99^\circ]$$

### Total power angle

P<sub>t</sub> - total active power

S<sub>t</sub> - total apparent power

$$\text{PF}_t = \frac{P_t}{S_t}$$

### 3 phase power factor

P<sub>t</sub> - phase active power

S<sub>t</sub> - phase apparent power

$$\text{PF}_f = \frac{P_f}{S_f}$$

### Power factor by phases

P<sub>f</sub> - phase active power

S<sub>f</sub> - phase apparent power

---

**THD**


---

$$I_f THD(\%) = \frac{\sqrt{\sum_{n=2}^{63} I_n^2}}{I_1} \cdot 100$$

**Current THD**

$I_1$  - value of first harmonic  
 $n$  - number of harmonic

$$U_f THD(\%) = \frac{\sqrt{\sum_{n=2}^{63} U_{fn}^2}}{U_{f1}} \cdot 100$$

**Phase voltage THD**

$U_1$  - value of first harmonic  
 $n$  - number of harmonic

$$U_{ff} THD(\%) = \frac{\sqrt{\sum_{n=2}^{63} U_{ffn}^2}}{U_{ff1}} \cdot 100$$

**Phase-to-phase voltage THD**

$U_1$  - value of first harmonic  
 $n$  - number of harmonic

---

*Printed in Slovenia • Subject to change without notice • GB K 22.444.000*



**Iskra, d.d.**

Stegne 21

SI-1000 Ljubljana

Slovenia

Tel.: +386 1 51 31 000

Fax: +386 1 51 11 532

[www.iskra.eu](http://www.iskra.eu)

[info@iskra.eu](mailto:info@iskra.eu)