

User's Manual

GB

Supervision Relay

SR100

This manual was produced using *ComponentOne Doc-To-Help*.™

Table of content

SUPERVISION RELAY SR100	1
SECURITY ADVICE AND WARNINGS	2
WARNINGS, INFORMATION AND NOTES REGARDING DESIGNATION OF PRODUCT	3
BEFORE SWITCHING THE DEVICE ON	4
HEALTH AND SAFETY	5
DISPOSAL	6
BASIC DESCRIPTION AND OPERATION	7
CONTENTS	7
DESCRIPTION OF THE SUPERVISION RELAY SR100	8
ABBREVIATION/GLOSSARY	9
PURPOSE AND USE OF SUPERVISION RELAY SR100	10
CONNECTION	11
MOUNTING.....	12
ELECTRICAL CONNECTION FOR SUPERVISION RELAY SR100	12
CONNECTION OF INPUT/OUTPUT MODULES	14
COMMUNICATION CONNECTION	15
RS232	15
RS485	15
CAN (CANopen)	15
Service USB	16
SURVEY OF COMMUNICATION CONNECTION	16
CONNECTION OF AUX. POWER SUPPLY	17

SETTINGS.....18

MIQEN SOFTWARE 18

 Devices management 19

 Settings 21

 Measurements..... 22

 My Devices..... 24

 Upgrade 24

 Software upgrading 24

 Setting procedure 24

GENERAL SETTINGS..... 25

 Connection..... 27

 Communication 27

 Security 31

ENERGY 32

 Counters 32

INPUTS AND OUTPUTS..... 34

 Start-up delay for outputs (s) 34

 Enabled protection groups 35

 Output signal 35

PROTECTION FUNCTIONS 36

 Overcurrent protection function (Over Current 1 & 2) ANSI# 50 (>I, >>I)..... 37

 Overcurrent protection function (Over Current IE 1 & 2) ANSI# 50 N/G (>IE) 38

 Overcurrent protection function (Over Current Idiff 1 & 2) ANSI# 87 (>I') 39

 Overvoltage protection functions (Over Voltage 1 & 2) ANSI# 59 (>U, >>U) 40

 Undervoltage protection functions (Under Voltage 1 & 2) ANSI# 27 (<U, <<U)..... 41

 Overfrequency protection functions (Over Frequency 1 & 2) ANSI# 81O (>f, >>f) 42

 Underfrequency protection functions (Under Frequency 1 & 2) ANSI# 81U (<f, <<f)..... 43

 Asymmetry protection functions: Voltage Unbalances ANSI# 47 (>U_{Un})..... 44

 Asymmetry protection functions: Phase Imbalance 1&2 ANSI# 46 (>I_{im}, >>I_{im}) 45

 Load protection functions: Directional power 1&2 ANSI# 32 (>P, >>P) 46

 Load protection functions: Power underrun 1&2 ANSI# 32R/U (<P, <<P)..... 47

 LoM (Loss of Mains) protection functions: Phase Shift ANSI# 78(> dPhi/dt) 48


 LoM (Loss of Mains) protection functions: ROCOF protection ANSI# 81R(> df/dt)..... 49

 Protection Functions in MiQEN - Setting and Acquisition Software..... 50

RESET 55

MEASUREMENTS.....	56
ONLINE MEASUREMENTS.....	56
AVAILABLE CONNECTIONS	57
SUPPORTED MEASUREMENTS.....	58
SELECTION OF AVAILABLE QUANTITIES.....	58
EXPLANATION OF BASIC CONCEPTS	60
Sample factor M_v	60
Average interval MP	60
Power and energy flow.....	60
CALCULATION AND DISPLAY OF MEASUREMENTS.....	61
PRESENT VALUES	61
Voltage	62
Current	62
Active, reactive and apparent power	62
Power factor and power angle	62
Frequency.....	63
Energy counters.....	63
THD – Total harmonic distortion	63
Average interval for min. max. values	63
TECHNICAL DATA	64
ACCURACY	64
MEASUREMENT INPUTS	64
CONNECTION.....	65
Connection table	66
COMMUNICATION.....	66
I/O MODULES	67
SAFETY	67
MECHANICAL.....	67
ENVIRONMENTAL CONDITIONS	68
DIMENSIONAL DRAWING	68
APPENDICES.....	69
APPENDIX A	69
APPENDIX B	79
APPENDIX C	86

SUPERVISION RELAY SR100

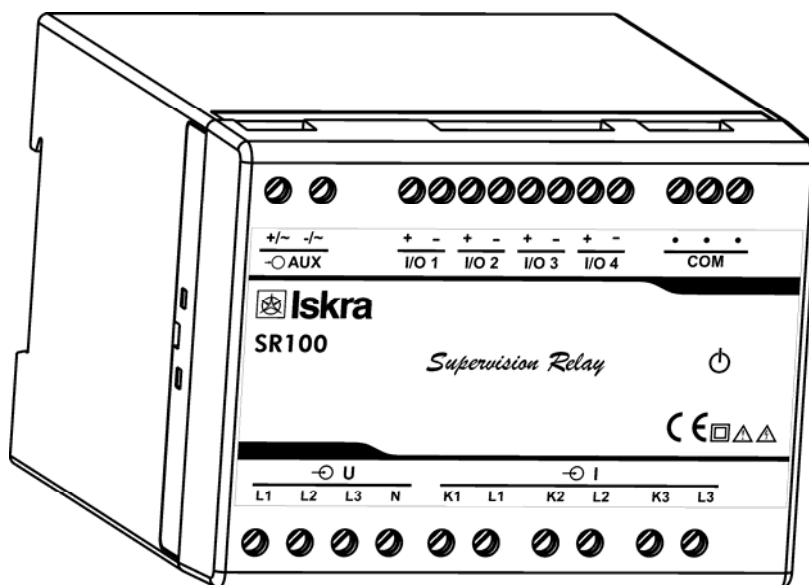

SECURITY ADVICE AND WARNINGS

Please read this chapter carefully and examine the equipment carefully for potential damages which might arise during transport and to become familiar with it before continue to install, energize and work with a measuring instrument.

This chapter deals with important information and warnings that should be considered for safe installation and handling with a device in order to assure its correct use and continuous operation.

Everyone using the product should become familiar with the contents of chapter »Security Advices and Warnings«.






If equipment is used in a manner not specified by the manufacturer, the protection provided by the equipment may be impaired.

 **PLEASE NOTE**

Installation and use of devices includes work with dangerous currents and voltages, therefore such work shall be carried out by qualified persons only. The ISKRA Company assumes no responsibility in connection with installation and use of the product. If there is any doubt, regarding installation and use of the system in which the instrument is used for measuring or protection, please contact a person who is responsible for installation of such system.

WARNINGS, INFORMATION AND NOTES REGARDING DESIGNATION OF PRODUCT

Used symbols:

	<p>See product documentation.</p>
	<p>Double insulation in compliance with the EN 61010-1 standard.</p>
	<p>Functional ground potential. Note: This symbol is also used for marking a terminal for protective ground potential if it is used as a part of connection terminal or auxiliary supply terminals.</p>
	<p>Compliance of the product with directive 2002/96/EC, as first priority, the prevention of waste electrical and electronic equipment (WEEE), and in addition, the reuse, recycling and other forms of recovery of such wastes so as to reduce the disposal of waste. It also seeks to improve the environmental performance of all operators involved in the life cycle of electrical and electronic equipment.</p>
	<p>Compliance of the product with European CE directives.</p>

BEFORE SWITCHING THE DEVICE ON

Check the following before switching on the device:

- nominal voltage,
- supply voltage,
- nominal frequency,
- voltage ratio and phase sequence,
- current transformer ratio and terminals integrity,
- protection fuse for voltage inputs (recommended maximal external fuse size is 6 A),
- external switch or circuit-breaker must be included in the installation for disconnection of the devices' aux. power supply. It must be suitably located and properly marked for reliable disconnection of the device when needed,
- integrity of earth terminal,
- proper connection and voltage level of I/O modules.



WARNING

A current transformer secondary should be short circuited before connecting the device.

HEALTH AND SAFETY

The purpose of this chapter is to provide a user with information on safe installation and handling with the product in order to assure its correct use and continuous operation.

We expect that everyone using the product will be familiar with the contents of chapter »Security Advices and Warnings«.

If equipment is used in a manner not specified by the manufacturer, the protection provided by the equipment may be impaired.

DISPOSAL

It is strongly recommended that electrical and electronic equipment is not deposit as municipal waste. The manufacturer or provider shall take waste electrical and electronic equipment free of charge. The complete procedure after lifetime should comply with the Directive 2002/96/EC about restriction on the use of certain hazardous substances in electrical and electronic equipment.

BASIC DESCRIPTION AND OPERATION

This chapter presents all relevant information about the instrument required to understand its purpose, applicability and basic features related to its operation.

Apart from this, it also contains navigational tips, description of used symbols and other useful information for understandable navigation through this manual.

Regarding the options of this instrument, different chapters should be considered since a particular sub variant might vary in functionality. More detailed description of device functions is given in chapters Main Features, Supported options and Functionality.

Supervision Relay SR100 is available in DIN rail mounting enclosure. Specifications of housing are specified in chapter [Connection – Mounting](#) on page 12.

Contents

Packaging contains the following items:

- Measuring instrument
- Quick Guide

All related documentation on this product can be found at [Iskra web page - https://www.iskra.eu](https://www.iskra.eu). The instrument desktop based setting software – MiQen2, together with accompanying drivers can be found on [Iskra web page - https://www.iskra.eu](https://www.iskra.eu). Due to environmental reasons, all this information is longer provided on a separate CD.

CAUTION


Please examine the equipment carefully for potential damage, which might have occurred during transport.

Description of the Supervision Relay SR100

Supervision Relay SR100 is intended for measuring and monitoring single-phase or three-phase electrical power network. It measures RMS network values and all significant deviations from the nominal values by means of fast sampling of voltage and current signals. There is an option in MiQen Settings Studio software to select also the measurements based only on positive sequence fundamental wave, which does not include harmonics measurements. This option can be found under MiQen Settings menu. With this option included, all corresponding values are replaced by IEC 61400-21 Annex C measurements. This makes Supervision Relay SR100 suitable for acquisition and validation of fast changes in the network. A built-in microcontroller calculates measured values (voltage, current, frequency, energy, power, power factor, THD phase angles and deviations) and sends these data over a reliable CANopen communication interface to the CAN master devices.

Lack of information regarding supplied voltage quality can lead to unexplained production problems and malfunction or can even damage equipment being used during factory production process. Therefore Supervision Relay SR100 can be used to detect predefined faults. With measuring 13 different network deviations, Supervision Relay SR100 could be used as simple but efficient supervision relay. Supervision Relay SR100 is delivered un-configured for customer configuration with user friendly setting software MIQEN. Supervision Relay SR100 supports standard serial communication RS232/RS485 with speed up to 115200 baud and CANopen communication for speeds up to 1 Mbit/s which is perfect for integration into large systems. Additional USB 2.0 interface can only be used for a fast set-up without the need for auxiliary power supply. This interface is provided with only BASIC insulation and can be used ONLY unconnected to power inputs.

Appearance

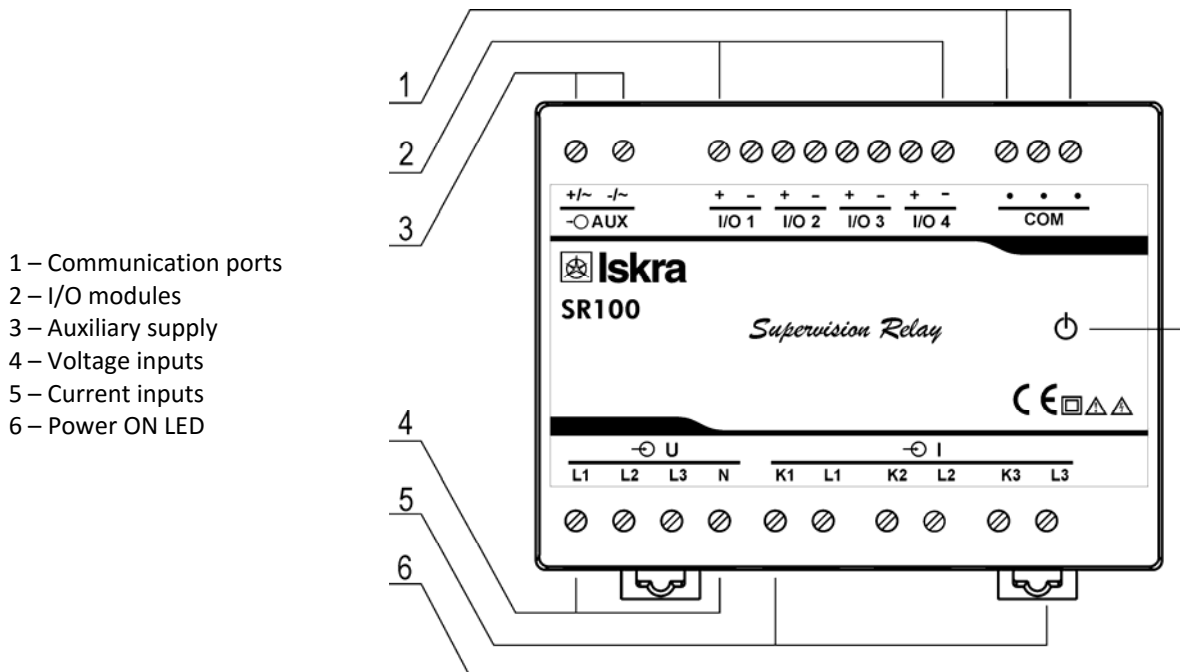

- 1 – Communication ports
- 2 – I/O modules
- 3 – Auxiliary supply
- 4 – Voltage inputs
- 5 – Current inputs
- 6 – Power ON LED

Communication ports and LED indicators

Serial communication can be connected by using screw-in connector (RS232 or RS485). CANopen communication is also connected using screw-in connector. USB can be connected through USB-mini type connector at the bottom of Supervision Relay SR100.

LED indicator is intended for POWER ON signaling (red LED).

⚠ WARNING

USB communication port is provided with only BASIC insulation and can ONLY be used unconnected to aux. supply AND power inputs!

I/O modules

Four I/O module slots are intended for electromechanical relay output modules.

Universal auxiliary supply

Auxiliary supply is connected by two screw-in connectors. For safety purposes it is important that all wires are firmly fastened. Auxiliary supply is wide range (20 ... 300 V DC; 48 ... 276 V AC).

Voltage inputs

Each voltage input is connected to measuring circuit through input resistor chain (3.3 M Ω per phase). Maximum value of input voltage is 600 V_{L-N} (1000 V_{L-L}).

Current inputs

Each current input is connected to measuring circuit through current transformer (0.01 Ω per phase). Maximum allowed thermal value of input current is 12.5 A (cont.).

Abbreviation/Glossary

Abbreviations are explained within the text where they appear the first time. Most common abbreviations and expressions are explained in the following table:

Term	Explanation
RMS	Root Mean Square value
MODBUS / DNP3	Industrial protocol for data transmission
MiQen	Setting Software for ISKRA instruments
AC	Alternating voltage
PA total	Power Angle calculated from total active and apparent power
PA _{phase}	Angle between fundamental phase voltage and phase current
PF _{phase}	Power factor, calculated from apparent and active power (affected by harmonics)
THD (U, I)	Total harmonic distortion
MD	Max. Demand; Measurement of average values in time interval
FFT graphs	Graphical display of presence of harmonics
Harmonic voltage – harmonic	Sine voltage with frequency equal to integer multiple of basic frequency
Sample factor	Defines a number of periods for measuring calculation on the basis of measured frequency
M _p – Average interval	Defines frequency of refreshing displayed measurements
Hysteresis [%]	Percentage specifies increase or decrease of a measurement from a certain limit after exceeding it.
RO	Relay output module

List of common abbreviations and expressions

Purpose and use of Supervision Relay SR100

Supervision Relay SR100 is used for measuring and monitoring single-phase or three-phase values and detecting predefined faults. With measuring 13 different network deviations, Supervision Relay SR100 can be used as simple but efficient supervision relay. Supervision Relay SR100 is delivered un-configured for customer configuration with user friendly setting software MiQEN. Supervision Relay SR100 supports standard serial communication RS232/RS485 with speed up to 115200 baud and CANopen communication for speeds up to 1 Mbit/s which is perfect for integration into large systems.

Additional USB 2.0 interface can only be used for a fast set-up without the need for auxiliary power supply. This interface is provided with only BASIC insulation and can be used ONLY unconnected to power inputs.

Supported measurements

Basic measurements	
Phase	Voltage U_1, U_2, U_3 and U_{\sim}
	Current I_1, I_2, I_3, I_n, I_t and I_a
	Active power $P_1, P_2, P_3,$ and P_t
	Reactive power $Q_1, Q_2, Q_3,$ and Q_t
	Apparent power $S_1, S_2, S_3,$ and S_t
	Power factor PF_1, PF_2, PF_3 and PF_{\sim}
	Power angle ϕ_1, ϕ_2, ϕ_3 and ϕ_{\sim}
	THD of phase voltage U_{f1}, U_{f2} and U_{f3}
	THD of power angle I_1, I_2 and I_3
	Phase Shift $L_1 \setminus L_2 \setminus L_3$
Phase-to-phase	Phase-to-phase voltage U_{12}, U_{23}, U_{31}
	Average phase-to-phase voltage U_{ff}
	Phase-to-phase angle $\phi_{12}, \phi_{23}, \phi_{31}$
	THD of phase-to-phase voltage
Energy	Counter 1
	Counter 2
	Counter 3
	Counter 4
	Active tariff
Inputs and outputs	Relay output 1
	Relay output 2
	Relay output 3
	Relay output 4
Other measurements	
MD values	Phase current I_1, I_2, I_3
	Active Power Total (Pt) - (positive)
	Active Power Total (Pt) - (negative)
	Reactive Power Total (Qt) - L
	Reactive Power Total (Qt) - C
	Apparent Power Total (St)
Measurements	Voltage Unbalances U_o
	Phase imbalance
	Frequency
	ROCOF df/dt
	Internal temperature

CONNECTION

This chapter deals with the instructions for measuring instrument connection. Both the use and connection of the device includes handling with dangerous currents and voltages. Only qualified personnel using an appropriate equipment shall therefore perform connections. ISKRA d.d. does not take any responsibility regarding the use and connection. If any doubt occurs regarding connection and use in the system which device is intended for, please contact a person who is responsible for such installations.

A person qualified for installation and connection of a device should be familiar with all necessary precaution measures described in this document prior to its connection.

Before use please check the following:

- Nominal voltage ($U_{P-Pmax} = 1000V_{ACrms}$; $U_{P-Nmax} = 600V_{ACrms}$),
- Supply voltage (rated value),
- Nominal frequency,
- Voltage ratio and phase sequence,
- Current transformer ratio and terminals integrity,
- Protection fuse for voltage inputs (recommended maximal external fuse size is 6 A)
- External switch or circuit-breaker must be included in the installation for disconnection of the devices' aux. power supply. It must be suitably located and properly marked for reliable disconnection of the device when needed. See CAUTION below.
- Integrity of earth terminal
- Proper connection and voltage level of I/O modules



WARNING

Wrong or incomplete connection of voltage or other terminals can cause non-operation or damage to the device.



CAUTION

Aux. Supply inrush current can be as high as 20A for short period of time (<1 ms). Please choose an appropriate MCB for disconnection of aux. supply.




PLEASE NOTE

After connection, settings have to be performed via communication using MiQen software.

Mounting

Supervision Relay SR100 is designed for DIN rail mounting. It should be mounted on a 35 mm DIN rail by means of two plastic fasteners. Before installation fasteners should be in open position (pulled). After device is in place, fasteners are locked (pushed) to close position.

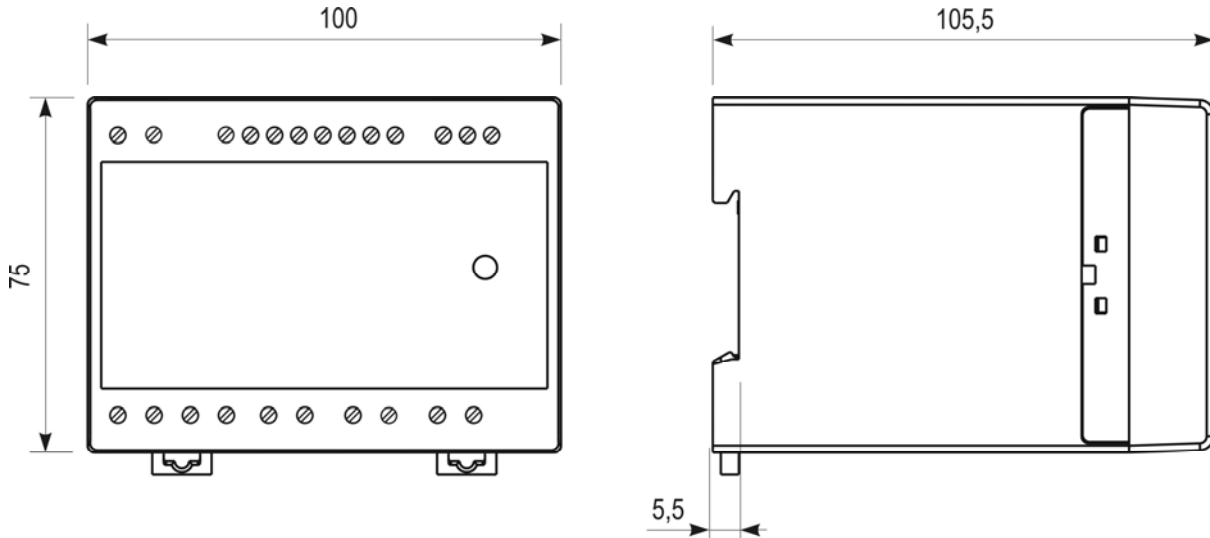

Dimensional drawing

Electrical connection for Supervision Relay SR100

Voltage inputs of a device can be connected directly to low-voltage network or via a voltage measuring transformer to a high-voltage network.

Current inputs of measuring transducer can be connected directly to low-voltage network or via a corresponding current transformer.

Choose corresponding connection from the figures below and connect corresponding voltages and currents. Information on electrical consumption of current and voltage inputs is given in a chapter [Technical Data – Measuring inputs](#) on page 64.

CAUTION

For accurate operation and to avoid measuring signal crosstalk it is important to avoid installation of voltage measuring wires close to current measuring transformers.


PLEASE NOTE

For proper connection wire diameters and other wiring requirements see chapter [Technical data – Connection](#) on page 65.

System/ connection

Connection 1b (1W)
Single phase connection


Terminal assignment

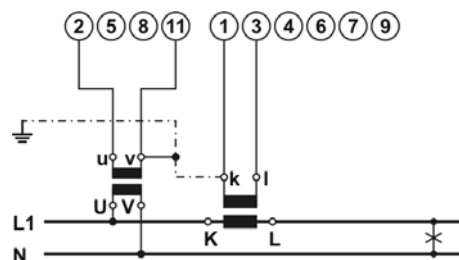


System/ connection

Terminal assignment


Connection 3b (1W3)
 Three phase, three wire connection
 with balanced load

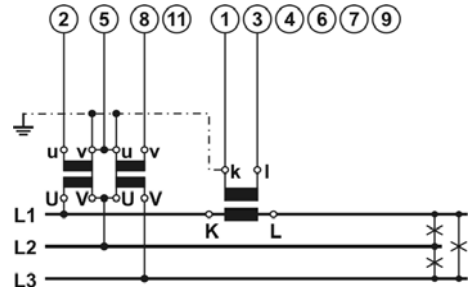


Connection 3u (2W3)
 Three phase, three wire connection
 with unbalanced load

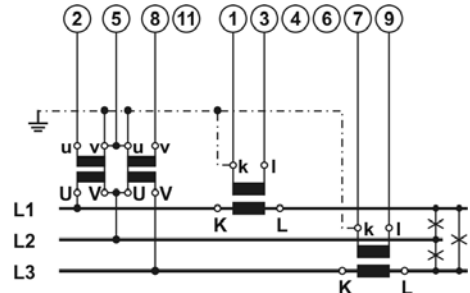


Direct connection 3u(2W3)
 Three phase, three wire direct connection
 with unbalanced load

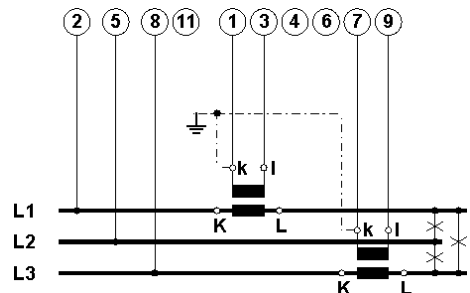

Connection 4b (1W4)
 Three phase, four wire connection
 with balanced load

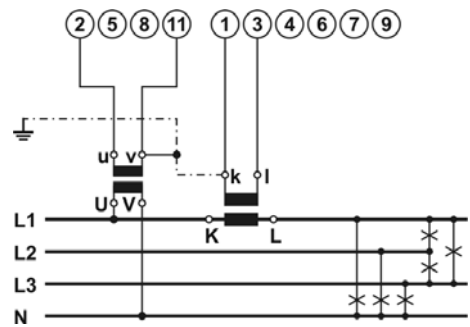


Connection 4u (3W4)
 Three phase, four wire connection
 with unbalanced load

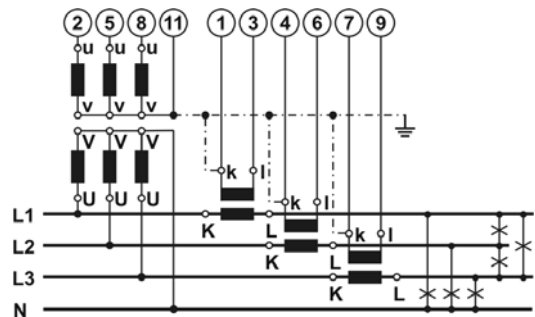


System/ connection

Terminal assignment

Connection Idiff
 Three phase, four wire connection
 with unbalanced load

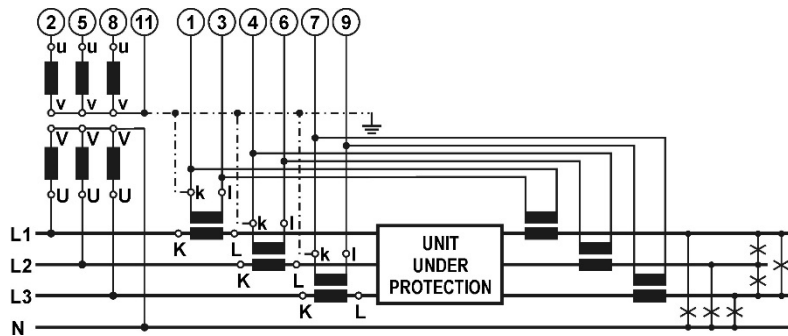

Connection IE
 Three phase, four wire connection
 with unbalanced load

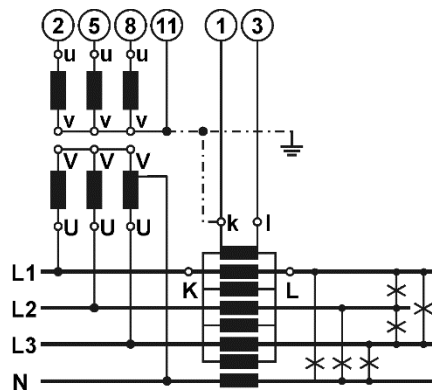

Connection of input/output modules

WARNING

Check the module features that are specified on the label, before connecting module contacts. Wrong connection can cause damage or destruction of module and/or device.

Connect module contacts as specified on the label. Examples of labels are given below and describe modules built in the device. Information on electrical properties of modules is given in a chapter [Technical Data – I/O modules](#) on page 67.

I/O module 1

I/O 1	
Relay output	
48 V DC/AC	15
1000 mA	16

Electromechanical relay output module. (Example of alarm module as I/O module 1)

Communication connection

Supervision Relay SR100 is equipped with one standard (COM1) RS232 / RS485 / CANopen communication port and one service communication port (USB).

WARNING

USB communication port is provided with only BASIC insulation and can ONLY be used unconnected to aux. supply AND power inputs!

Connect a communication line by means of corresponding terminals. Connection information is stated on the instrument label. Connector terminals are marked on the label on the upper side of the instrument.

USB connector is positioned on the bottom side of an instrument under removable plastic cover. Instrument will establish USB connection with PC approx. 3 seconds after physical connection to USB port.

More detailed information about communication is given in chapter [Communication](#) on page 27.

RS232

RS232 communication is intended for direct connection of the Device to the personal computer. For proper operation it is necessary to assure the corresponding connection of individual terminals (see table: [Survey of communication connection](#) on page 16).

RS485

RS485 communication is intended for connection of multiple devices to a network where devices with RS485 communication are connected to a common communication interface. We suggest using one of the *ISKRA, d.d.* communication interfaces! For proper operation it is necessary to assure the corresponding connection of individual terminals. See table: [Survey of communication connection](#) page 16.

CAN (CANopen)

CANopen communication is intended for connection of multiple devices to a fieldbus network systems where Supervision Relay SR100 is connected as slave device to the master device. *ISKRA* has some project examples for different master devices as Beckhoff PLC, Bachmann PLC, ... and the User could request for them. Supervision Relay SR100 implements CANopen communication protocol according to CiA 401 specification and implements most of the CANopen NMT standard commands. CAN connector emphasis CAN-L, CAN-H and also CAN-GND signal which is not necessary to be used. See table: Survey of communication connection page 16. For proper operation it is only necessary to assure the corresponding external termination of CAN-L/CAN-H lines with 120 Ohms resistance. Also 120 Ohms termination is highly recommended on the master side of the communication path. More information about the CANopen protocol could be found in the chapter [Settings – General settings – communication – CANopen](#) on page 28.


Service USB

Additionally, Supervision Relay SR100 has a USB communication port, located on the bottom under small circular plastic cover. It is intended for settings ONLY and requires NO auxiliary power supply. When connected to this communication port Supervision Relay SR100 is powered by USB.



The USB port should not remain open. It should be closed immediately after the initial setting through USB port was done and should remain closed during all time of storing & operation. In case the customer has not put the cover on the USB after the initial setting was done, before putting to store, mounting the unit on the DIN rail or the unit operates without USB cover the warranty is void.

Also unit returned back without USB cover or with clear indications that it was stored or operated without USB cover on the USB port it will be treated as out of the warranty.

⚠ WARNING
 USB communication port is provided with only BASIC insulation and can ONLY be used unconnected to aux. supply AND power inputs!

<table border="1"> <tr><th colspan="2">COM</th></tr> <tr><td>Rx</td><td>23</td></tr> <tr><td>⊥</td><td>24</td></tr> <tr><td>Tx</td><td>25</td></tr> </table> <p>RS232</p>	COM		Rx	23	⊥	24	Tx	25	COM1 serial communication port (RS232)
COM									
Rx	23								
⊥	24								
Tx	25								
<table border="1"> <tr><th colspan="2">COM</th></tr> <tr><td>A</td><td>23</td></tr> <tr><td>NC</td><td>24</td></tr> <tr><td>B</td><td>25</td></tr> </table> <p>RS485</p>	COM		A	23	NC	24	B	25	COM1 serial communication port (RS485)
COM									
A	23								
NC	24								
B	25								
<table border="1"> <tr><th colspan="2">COM</th></tr> <tr><td>CAN-H</td><td>23</td></tr> <tr><td>NC</td><td>24</td></tr> <tr><td>CAN-L</td><td>25</td></tr> </table> <p>CANopen</p>	COM		CAN-H	23	NC	24	CAN-L	25	CAN (CANopen) communication port
COM									
CAN-H	23								
NC	24								
CAN-L	25								
	SERVICE communication port (USB)								

Survey of communication connection

Connector	Terminals	Position	RS232	RS485	CAN (CANopen)
Screw terminals		23	Rx	A	CAN-H
		24	GND	NC	CAN-GND
		25	Tx	B	CAN-L
USB-mini B		Standard USB 2.0 compatible cable recommended (Type mini B plug)			

Connection of aux. Power supply

Device can be equipped with either of two types of universal (AC/DC) switching power supply.

Auxiliary Power Supply:	20 ... 300 V DC
	48 ... 276 V AC
	45 ... 65 Hz

Regarding power supply voltage specification on the label, choose and connect the power supply voltage:

AUX		
20...300 V DC	+~	13
48...276 V AC		
45...65 Hz	-~	14
< 8 VA		

Connection of auxiliary power supply type to terminals 13 and 14.

CAUTION


Aux. supply inrush current can be as high as 20A for short period of time (<1 ms). Please choose an appropriate MCB for connection of aux. supply.

SETTINGS

Settings of the device can be performed via communication with MiQen software. Complete setting of the device can be done using MiQen software.

MiQen software

MiQen software is a tool for a complete programming and monitoring of ISKRA measuring instruments. Remote operation is possible by means of serial (RS485 / RS232) or USB. A user-friendly interface consists of six segments: connection, settings, measurements, analysis, my devices and upgrades. These segments are easily accessed by means of six icons on the left side:

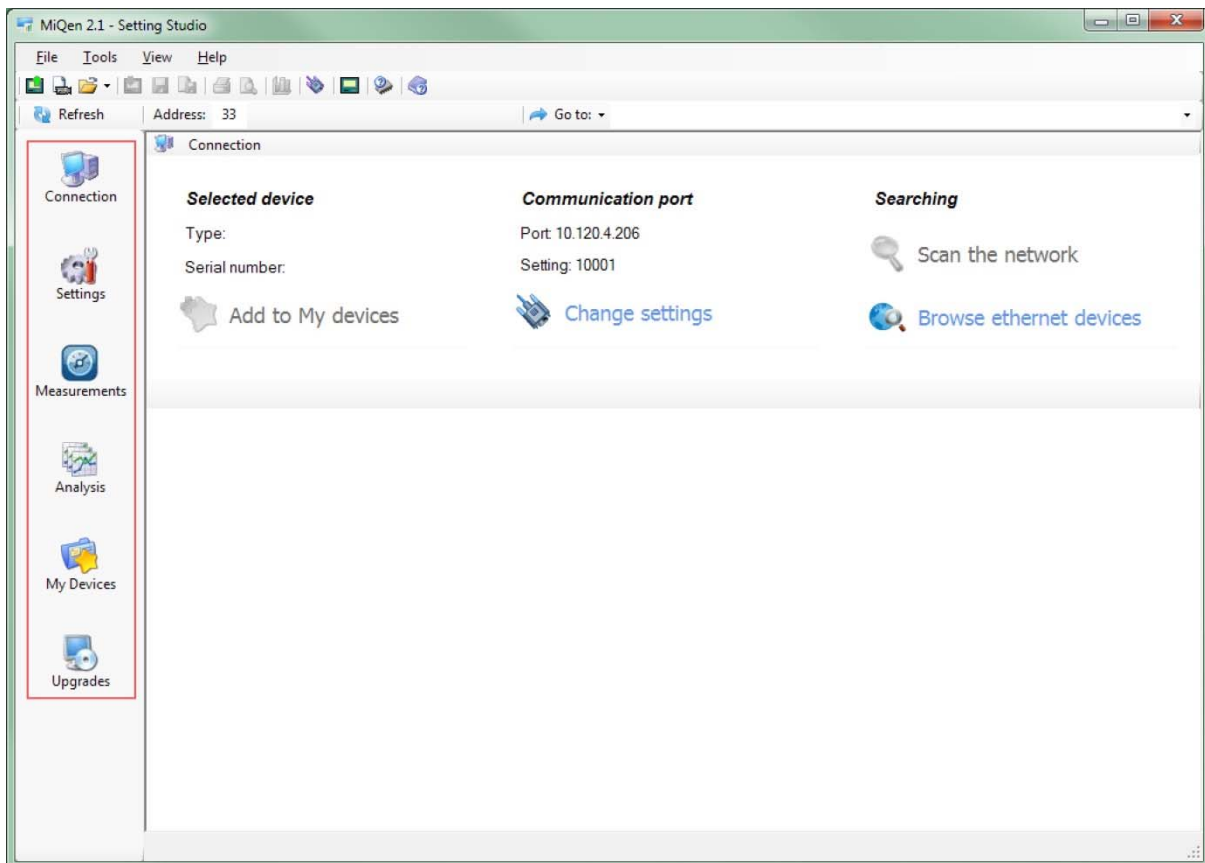


Latest version of MiQen software can be downloaded from ISKRA d.d. website www.iskra.eu.

PLEASE NOTE


MiQen has very intuitive help system. All functions and settings are described in Info window on the bottom of MiQen window. In MiQen Help file, detailed instructions about software usage, connection and communication with different type of devices, driver installation,... are described.

Devices management

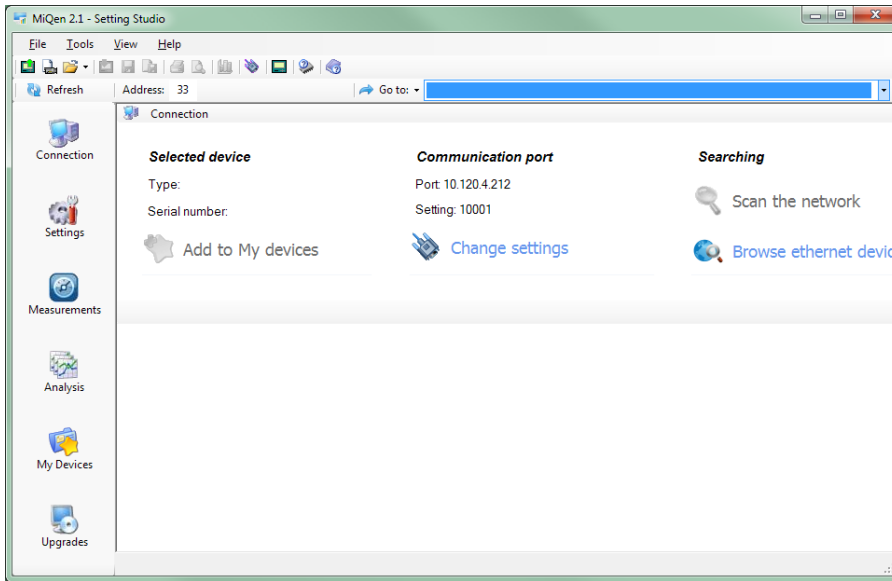

MiQen Device Management window

With MiQen it is very easy to manage devices. If dealing with the same device that has been accessed before, it can be easily selected from a favorites' line.

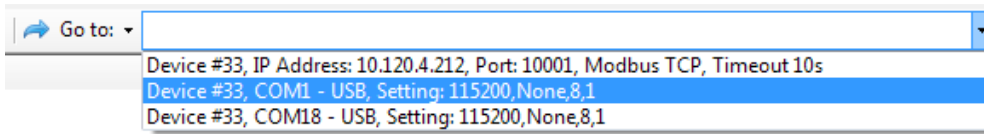


This way is Communication port set automatically as it was during last access.


To communicate with new device follow below instructions:

Connect a device to a communication interface (Depending on type of device):

- Directly to a PC using RS232 cable
- To comm. adapter RS485 / RS232
- Directly to a PC using USB cable

Set Communication port parameters

Under Communication port, current communication parameters are displayed. To change those parameters click on  [Change settings](#) button. A Communication port window opens with settings for different communication interfaces.

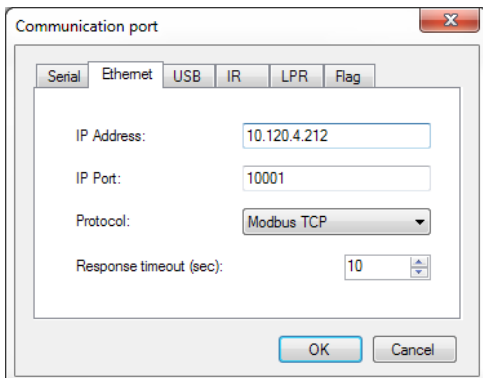

To activate desired communication select proper communication tab, set communication parameters and confirm selection with OK button.


PLEASE NOTE

When device with USB communication is connected to a computer for the first time, device driver will be installed automatically. If installation is correct device presents itself in an operating system -> Device manager - Ports (COM and LPT) as a Measuring device. If device is not recognized automatically or wrong driver is installed, valid installation drivers are located in MiQen installation directory, subdirectory Drivers.
 With this driver installed, USB is redirected to a serial port, which should be selected when using MiQen software.

For more information regarding communication parameters, please see chapter [Communications](#) on page 27.

Set device Modbus address number

Each device connected to a network has its unique Modbus address number. In order communicate with that device an appropriate address number should be set.

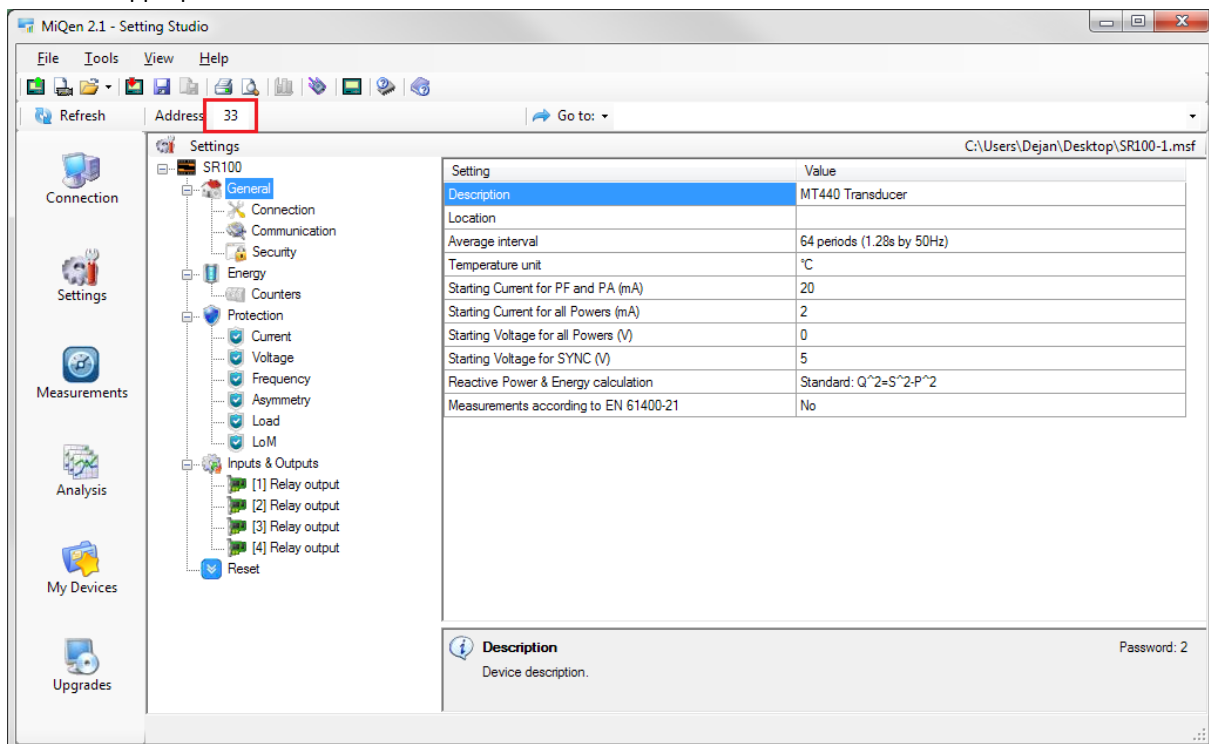

Factory default Modbus address for all devices is 33. If devices are connected in to communication network, all should have the same communication parameters, but each of them should have its own unique address.

Start communicating with a device

Click on  Refresh button and devices information will be displayed:

Selected device


Type: MC784, Soft. Ver.: 0.48

Serial number: M8000000

When devices are connected to a network and a certain device is required, it is possible to browse a network for devices. For this purpose, choose:

- **Scan the network** when device is connected to a RS485/RS232 bus
- **Browse Ethernet devices** when device is connected to the Ethernet

Searching




Settings


Programming devices can be performed ONLINE when device is connected to aux. power supply and is communicating with MiQen. When device is not connected, it is possible to adjust settings OFFLINE.

Online programming


After communication with a device is established, choose icon Settings from a list of MiQen functions on a left side.

MiQen Device Setting window:

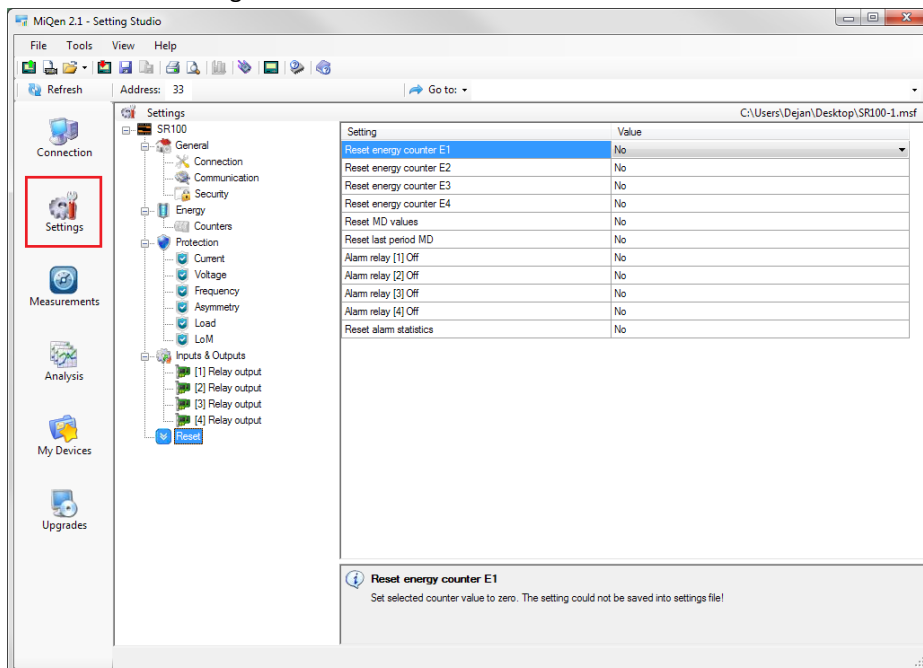

Choose Read settings  button to display all devices settings and begin adjusting them according to project requirement.

PLEASE NOTE

When finished programming, changes should be confirmed by pressing Download settings  button in MiQen menu bar or with a mouse right click menu.

PLEASE NOTE

When finished programming, all settings can be saved in a setting file (*.msf file). This way it is possible to archive settings in combination with a date. It is also possible to use saved settings for offline programming or to program other devices with same settings. For more information, see OFFLINE programming.

Offline programming

When device is not physically present or is unable to communicate, it is still possible to perform OFFLINE programming. From MiQen Device Setting window, choose Open setting file button. From a list of *.msf files choose either previously stored file (a setting file, which has been used for another device and stored) or a file SR100.msf, which holds default settings for this device. When confirmed all device settings are displayed similar as with ONLINE programming.

When finished programming, all settings can be saved in a setting file with a meaningful name (e.g. SR100_location_date.msf).

Settings are stored in the directory setting using two recording modes:

- With a type designation and a sequence number from 1 to 9
- With an device serial number


CAUTION

SR100.msf file or any other original device setting file should not be modified as it contains device default settings. Please save setting file under another name before adjusting it with your own project requirements.

Measurements

Measurements can be seen ONLINE when device is connected to aux. power supply and is communicating with MiQen. When device is not connected, it is possible to see OFFLINE measurements simulation. The latter is useful for presentations and visualization of measurements without presence of actual device.

In ONLINE mode, all supported measurements and protection functions can be seen in real time in a Table view. Presentation in graphical form is also supported.

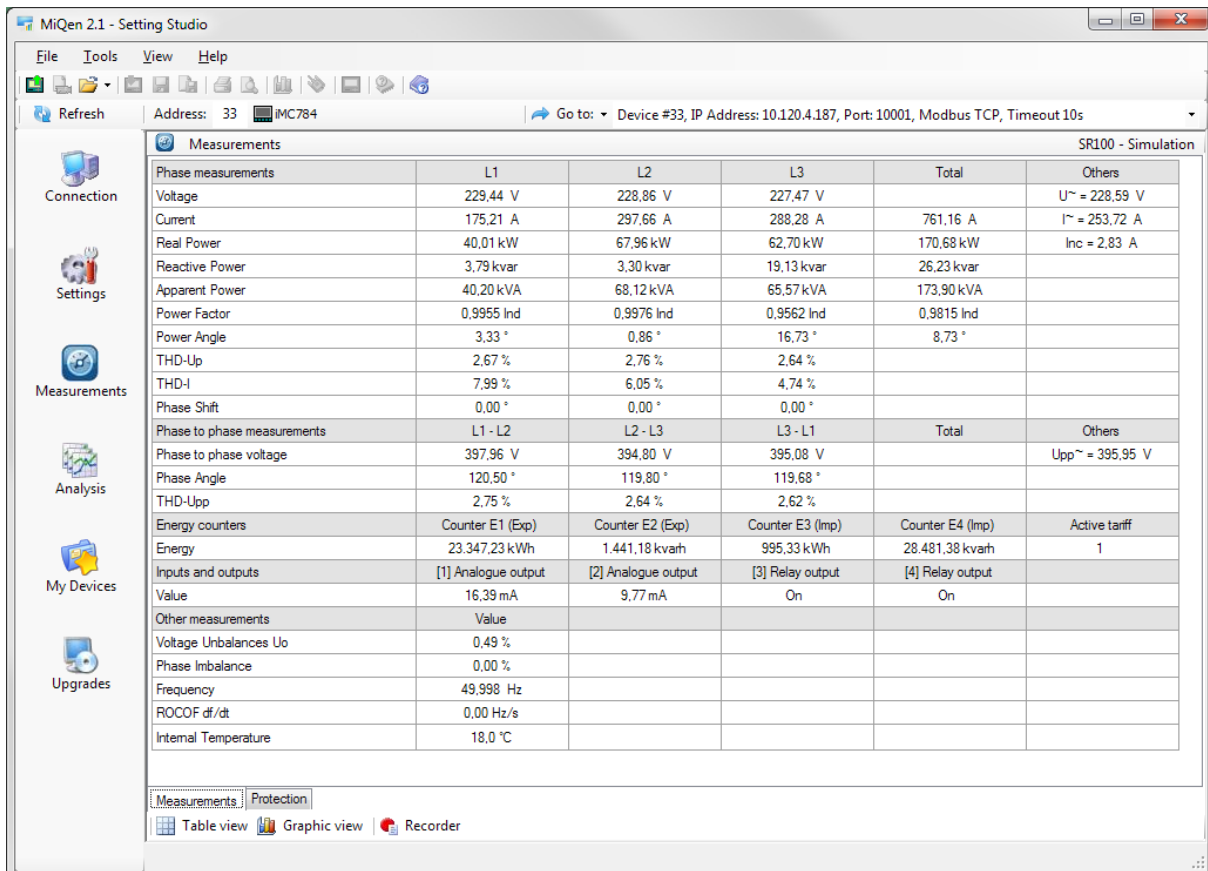


The screenshot shows the 'Measurements' window in the MiQen 2.1 - Setting Studio software. The window title is 'MiQen 2.1 - Setting Studio' and the address bar shows 'Address: 33' and 'Device #33, IP Address: 10.120.4.187, Port: 10001, Modbus TCP, Timeout 10s'. The main area displays a table of measurements for 'SR100 - Simulation'.

Phase measurements	L1	L2	L3	Total	Others
Voltage	229.44 V	228.86 V	227.47 V		U \sim = 228.59 V
Current	175.21 A	297.66 A	288.28 A	761.16 A	I \sim = 253.72 A
Real Power	40.01 kW	67.96 kW	62.70 kW	170.68 kW	Inc = 2.83 A
Reactive Power	3.79 kvar	3.30 kvar	19.13 kvar	26.23 kvar	
Apparent Power	40.20 kVA	68.12 kVA	65.57 kVA	173.90 kVA	
Power Factor	0.9955 Ind	0.9976 Ind	0.9562 Ind	0.9815 Ind	
Power Angle	3.33 °	0.86 °	16.73 °	8.73 °	
THD-Up	2.67 %	2.76 %	2.64 %		
THD-I	7.99 %	6.05 %	4.74 %		
Phase Shift	0.00 °	0.00 °	0.00 °		
Phase to phase measurements	L1 - L2	L2 - L3	L3 - L1	Total	Others
Phase to phase voltage	397.96 V	394.80 V	395.08 V		U $\text{pp}\sim$ = 395.95 V
Phase Angle	120.50 °	119.80 °	119.68 °		
THD-Upp	2.75 %	2.64 %	2.62 %		
Energy counters	Counter E1 (Exp)	Counter E2 (Exp)	Counter E3 (Imp)	Counter E4 (Imp)	Active tariff
Energy	23.347,23 kWh	1.441,18 kvarh	995,33 kWh	28.481,38 kvarh	1
Inputs and outputs	[1] Analogue output	[2] Analogue output	[3] Relay output	[4] Relay output	
Value	16.39 mA	9.77 mA	On	On	
Other measurements	Value				
Voltage Unbalances Uo	0.49 %				
Phase Imbalance	0.00 %				
Frequency	49.998 Hz				
ROCOF df/dt	0.00 Hz/s				
Internal Temperature	18.0 °C				

At the bottom of the window, there are tabs for 'Measurements' and 'Protection', and buttons for 'Table view', 'Graphic view', and 'Recorder'.

Online measurements in Table view

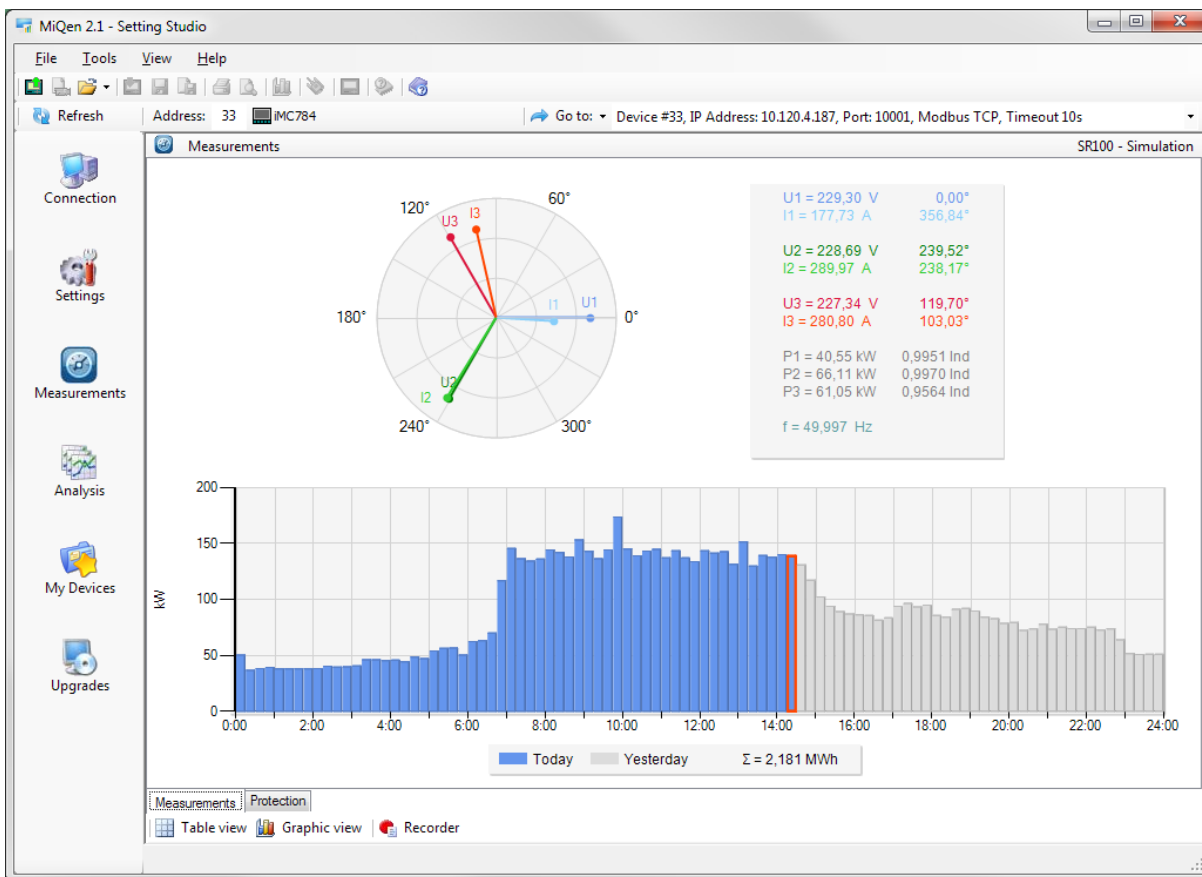

Online measurements in graphical form – phasor diagram and daily total active power consumption histogram

Different measuring data can be accessed by means of tabs (Measurements and Protection) in the lower part of MiQen window.

For further processing of real time measuring results, it is possible to set a recorder (Recorder button) on active device that will record and save selected measurements to MS Excel .csv file format. Data can then be analyzed and processed in any program that supports files in CSV format.

The 'Measurements Recorder' dialog box is shown. It has two tabs: 'Recorder' and 'Filter'. The 'Recorder' tab is active and contains the following fields:

- File name: MC014635.csv
- Path: C:\MiQen\Data
- File Type: Excel (*.csv)
- Data Type: Values & Units

There are three buttons: 'Start Recording' (with a red dot icon), 'Stop Recording' (with a grey square icon), and 'Close'. At the bottom, the status is 'Stopped' and the recording time is '0:00:00'.

Window for setting local database recording parameters

My Devices

In My Devices user can store connections to devices that are used more often. Each device can be assigned to user defined group and equipped with user defined description and location for easier recognition. By selecting device from the list, access to device settings and downloaded and recorded files is much easier.

Upgrade

In Upgrades section latest software, both for MiQen and ISKRA measuring devices can be found. The latest version should always be used to assure full functionality. Manual or automatic checking for upgrades is available. Internet connection is required.

List of available updates is divided in to various sections for easier navigation. Each section is named by software or family of devices (MiQen software, Measuring centers', Measuring transducers...). History file with data about corrections and added functionality is also available.

Software upgrading

PLEASE NOTE

MiQen cannot be used for execution of firmware upgrades of devices. It only informs that new version is available and offers link to download it from the server. Software for execution of firmware upgrades is included in downloaded zip file together with upgrade file, upgrade procedure description and revision history.

Setting procedure

Before configuring device with MiQen software, current settings should be read first. Reading is available either via communication or from a file (stored on a local disk). A setting structure that is similar to a file structure in an explorer is displayed in the left part of the MiQen setting window. Available settings of that segment are displayed in the right part by clicking any of the stated parameters.

PLEASE NOTE

Some settings may not be available due to unsupported measurements and/or functions that depend on the device type.

General Settings

General settings are essential for measuring instruments. They are divided into three additional sublevels (Connection, Communication and Security).

Description and Location

Description is intended for easier recognition of a certain unit in a network. It is especially used for identification of the device on which measurements are performed.

Average interval

The averaging interval defines a refresh rate of measurements on display, communication. It is used also as averaging interval for minimum and maximum values accessible on communication and actual alarm value calculation for alarm triggering.

Average interval for measurements

The averaging interval defines a refresh rate of measurements on display and communication. It also defines response time for alarms set to Normal response (see chapter Alarms).

- Shorter average interval means better resolution in minimum and maximum value in to recorded period detection. Also data presented in display will refresh faster.
- Longer average interval means lower minimum and maximum value in recorded period detection and slower alarm response (alarm response can be delayed also with Compare time delay setting – See chapter Alarms). Also data on display will refresh slower.

Interval can be set from 8 to 256 periods. Default value is 64 periods.

PLEASE NOTE

This setting applies only for min. and max. values displayed on LCD and accessible on communication. These values are not used for storing into internal recorder.

Temperature unit

Choose a unit for temperature display. Degrees Celsius or degrees Fahrenheit are available.

Starting Current for PF and PA (mA)

All measuring inputs are influenced by noise of various frequencies. It is more or less constant and its influence to the accuracy is increased by decreasing measuring signals. It is present also when measuring signals are not present or are very low. It causes very sporadic measurements.

This setting defines the lowest current that allows regular calculation of Power Factor (PF) and Power Angle (PA). The value for starting current should be set according to conditions in a system (level of noise, random current fluctuation ...)

Starting current for all power (mA)

Noise is limited with a starting current also at measurements and calculations of powers. The value for starting current should be set according to conditions in a system (level of noise, random current fluctuation ...)

Starting voltage for all powers (V)

Noise is limited with a starting voltage also at measurements and calculations of powers. Until voltage reaches user defined starting voltage threshold, all powers are set to 0. Using three wire electrical connections, virtual phase voltage is used in calculations.

Starting voltage for SYNC (V)

Device needs to synchronize its sampling with measuring signals period to accurately determine its frequency. For that purpose, input signal has to be large enough to be distinguished from a noise.

If all phase voltages are smaller than this (noise limit) setting, instrument uses current inputs for synchronization. If also all phase currents are smaller than Starting current for PF and PA setting, synchronization is not possible and frequency displayed is 0. The value for starting voltage should be set according to conditions in a system (level of noise, random voltage fluctuation ...)

Reactive power & energy calculations

Harmonic distortion can significantly influence reactive power and energy calculation. In absence of harmonic distortion both described methods will offer the same result. In reality harmonics are always present. Therefore it is up to project requirements, which method is applicable.

User can select between two different principles of reactive power and energy calculation:

Standard method:

With this method a reactive power and energy are calculated based on assumption that all power (energy), which is not active, is reactive.

$$Q^2 = S^2 - P^2$$

This means also that all higher harmonics (out of phase with base harmonic) will be measured as reactive power (energy).

Displacement method:

With this method, reactive power (energy) is calculated by multiplication of voltage samples and by 90° displaced current samples.

$$Q = U \times I | +90^\circ$$

With this method, reactive power (energy) represents only true reactive component of apparent power (energy).

Measurements according to EN 61400-21

Measurements based only on positive sequence fundamental wave, which is the one that produces torque in the rotating machines. Active power, reactive power, active current, reactive current and voltage are calculated according to requirements in EN61400-21. The negative sequence and the harmonics only cause losses.

Connection

CAUTION

Settings of connections shall reflect actual state otherwise measurements could not be valid.

Connection mode

When connection is selected, load connection and the supported measurements are defined.

Setting of current and voltage ratios

Before setting current and voltage ratios it is necessary to be familiar with the conditions in which device will be used. All other measurements and calculations depend on these settings. Aux CT transformer ratios can be set separately from phase CT ratios since Aux CT could differ from phase CTs.

Range of CT and VT ratios:

Settings range	VT primary	VT secondary	CT, Aux CT primary	CT, Aux CT secondary
Max value	1638,3 kV	13383 V	1638,3 kA	13383 A
Min value	0,1 V	0,1 V	0,1 A	0,1 A

Energy flow direction

This setting allows manual change of energy flow direction (IMPORT to EXPORT or vice versa) in readings tab. It has no influence on readings sent to communication or to memory.

CT connection

If this setting is set to REVERSED it has the same influence as if CT's would be reversely connected. All power readings will also change its sign.

This setting is useful to correct wrong CT connections.

Communication

Communication parameters (COM1)

Supervision Relay SR100 has one galvanically separated communication port (COM1), which can be equipped with RS232, RS485, CAN (CANopen) or left open (to be specified with order).

Different configurations are possible (to be specified with order):

Configuration	COM
Without	Service USB
RS232	RS232 + Service USB
RS485	RS485 + Service USB
CANopen	CANopen + Service USB

Serial communication:	RS232	RS485	CANopen
Connection type	Direct	Network	Network
Connection terminals	Screw terminals		
Function	Settings, measurements and FW upgrade		Measurements
Insulation	Protection class II, 3.3 kV _{ACRMS} 1 min		
Max. connection length	3 m	2000 m (at CAN depends on baudrate)	
Transfer mode	Asynchronous		Synchronous
Protocol	MODBUS RTU		CAN open
Transfer rate	2.4 kBaud to 115.2 kBaud		20 to 1000 kBaud
Number of nodes	/	≤ 32	≤ 127

CANopen

CANopen is a high-level communication protocol and device profile specification that is based on the CAN (Controller Area Network) protocol. The protocol was developed for embedded networking applications, such as in-vehicle networks. The CANopen umbrella covers a network programming framework, device descriptions, interface definitions and application profiles. CANopen provides a protocol which standardizes communication between devices and applications from different manufacturers. It has been used in a wide range of industries, with highlights in automation and motion applications. ISKRA Supervision Relay SR100 implements all standards CANopen features according to the CiA 401 specification. The bottom NMT telegrams are supported:

Specification of ISKRA CANopen message syntax - COB-Ids (SR100)				
Broadcast objects of the CANopen Predefined Master/Slave Connection Set				
Object	Function code (ID-bits 10-7)	COB-ID	Communication parameters at OD index	Comments
NMT Module Control	0000	000h	Start/stop node, Enter Pre-operational, Reset node, Reset communication	
SYNC	0001	080h	1005h, 1006h, 1007h	


Peer-to-Peer objects of the CANopen Predefined Master/Slave Connection Set				
Object	Function code (ID-bits 10-7)	COB-ID *	Communication parameters at OD index	
EMERGENCY	0001	081h - 0FFh	1024h, 1015h	EMCY at generic error
PDO 1 (transmit) TPDO1	0011	181h - 1FFh	1800h	Data structure Multiplexed
PDO 3 (transmit) TPDO3	0111	381h - 3FFh	1802h	Data structure Multiplexed
SDO (transmit/serve r)	1011	581h - 5FFh	1200h	Access of settings and data
SDO (receive/client)	1100	601h - 67Fh	1200h	Access of settings and data
NMT Heartbeat	1110	700h	(bott-up, stopped, operational, pre-operational)	Sent from SR100 as Producer to Master (Consumer)

Object Dictionary

One of the central themes of CANopen is the object dictionary (OD), which is essentially a table that stores configuration and process data. It is a requirement for all CANopen devices to implement an object dictionary. ISKRA Supervision Relay SR100 Object Dictionary is appended in Table 1 inside the [Appendix B](#) on page 79.

CANopen Message Format

The message format for a CANopen frame is based on the CAN frame format. In the CAN protocol, the data is transferred in frames consisting of an 11-bit or 29-bit CAN-ID, control bits such as the remote transfer bit (RTR), start bit and 4-bit data length field, and 0 to 8 bytes of data. The COB-ID, commonly referred to in CANopen, consists of the CAN-ID and the control bits. In CANopen, the 11-bit CAN ID is split into two parts: a 4-bit function code and a 7-bit CANopen node ID. The 7-bit size limitation restricts the amount of devices on a CANopen network to 127 nodes.

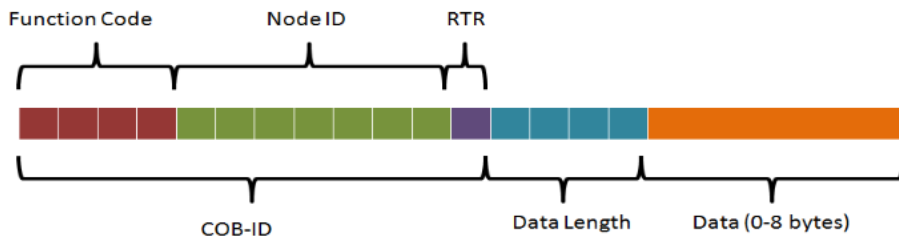

CANopen Frame Format (bits shown except for data field)

Service Data Objects (SDOs)

The CANopen protocol also specifies that each node on the network must implement a server that handles read/write requests to its object dictionary. This allows for a CANopen master to act as a client to that server. The mechanism for direct access (read/write) to the server’s object dictionary is the Service Data Object (SDO). The node whose object dictionary is accessed is referred to as the SDO server, and the node grabbing the data is referred to as the SDO client. The transfer is always started by the SDO client.

Process Data Objects (PDOs)

Process data represents data that can be changing in time, such as the inputs (i.e. sensors) and outputs (i.e. motor drives) of the node controller. ISKRA Supervision Relay SR100 uses PDOs as the basic mechanism to transfer measuring data to the Master. Measuring data are also stored in the object dictionary and could be accessed over a SDO requests. There are two types of PDOs: transfer PDOs (TPDOs) and receive PDOs (RPDOs). A TPDO is the data coming from the node (produced) and a RPDO is the data coming to the node (consumed). In addition, there are two types of parameters for a PDO: the configuration parameters and the mapping parameters. The section of the object dictionary reserved for PDO configuration parameters starts at address 1800h and the section reserved for mapping parameters starts at address 1A00h. ISKRA Supervision Relay SR100 uses TPDO1 and TPDO3 telegrams which are configured for Synchronous/Cyclic transmission according to received SYNC NMT messages from the Master/Producer. To increase the data efficiency ISKRA Supervision Relay SR100 uses multiplexed structure of the data being transmitted inside the TPDO 8-byte data field. The Multiplex data structure is clarified in pictures bellow.

BYTE 0	BYTE 1	BYTE 2	BYTE 3	BYTE 4	BYTE 5	BYTE 6	BYTE 7
MUX Index	Data byte	Data byte	Data byte	Data byte	Data byte	Data byte	Not used

Data being transferred inside the TPDO1 are of type 16-bit INTEGER, thus every TPDO1 it's caring 3 measured values/data. The first byte (BYTE 0) inside the data structure of the multiplexed TPDO1/3 is always sequential index of the telegram being transferred, thus the last byte (BYTE 7) could not be used in the data caring process and must be ignored at the Master side. Data which are transferred inside the TPDO3 are of 32-bit FLOAT type and also 16-bit INTEGER type and similar as in TPDO1 utilizes BYTES 1-6, where BYTE 7 must be ignored. TPDO1 messages are sent by default by every SYNC message being received from the Master and the TPDO3 messages are sent by every 10-th SYNC message by default. More information about the detailed TPDO1 and TPDO3 data structure could be found in the [Appendix B](#) on page 79.

Guarding and Heartbeats

The CANopen specification requires that nodes must use some method to check whether a node is "alive" or not. They are two methods available: node guarding and heartbeats, with the latter being the preferred method. Thus Supervision Relay SR100 prefer Heartbeat method because is more effective for the Master side. In the heartbeat protocol, Supervision Relay SR100 node periodically sends out a heartbeat message which lets the CANopen master or the Heartbeat Consumer, know that the node is still alive. If a heartbeat message does not arrive within a certain period of time, the master can take a specific action. Such an action might be to reset the node or to report an error to an operator. The heartbeat message is identified by a CAN-ID of 0x700 + the node ID. When a Supervision Relay SR100 boots up its first Heartbeat message It's Boot-up message with data byte value 0. After that each Heartbeat message contains the following mode of Supervision Relay SR100 operation:

Byte 0 value	Meaning
0	Boot-up
4	Stopped
5	Operational
127	Pre-operational

Serial communication

Communication parameters (only for main communication port COM1), which are important for the operation in RS485 network or connections with PC via RS232 communication.

Factory settings for serial communication are:

MODBUS Address	#33	address range is 1 to 247
Comm. speed	115200	speed range is 2400 to 115200
Parity	none	
data bits	8	
stop bits	2	

Service USB Communication

Has no setting. Device is automatically recognized in Windows environment if device driver has been correctly installed. For more detailed information how to handle device with USB communication use Help section in MiQen software.

PLEASE NOTE

USB communication port is provided with only BASIC insulation and can ONLY be used unconnected to aux. supply AND power inputs!

Service USB is intended only for parameterization of the meter and is not galvanic separated. Advantage is that in this case meter does not need a power supply to communicate. Communication via service port is time limited.

Security

Settings parameters are divided into four groups regarding security level: PLO >password level 0), PL1 >password level 1) and PL2 >password level 2).

Password - Level 0 >PLO)

Password is not required.

Available settings:

- language
- contrast and
- LCD back light.

Password - Level 1 >PL1)

Password for first level is required.

Available settings:

- RTC settings
- Energy meters reset
- Max. Demand reset
- Active tariff setting

Password - Level 2 >PL2)

Password for second level is required. Available settings:

- All settings are available

Password lock time >min)

Defines the time in minutes for the instrument to activate password protection. Enter value 0 if you want to use manual password activation.

Password setting

A password consists of four letters taken from the British alphabet from A to Z. A password of the first >PL1) and the second >PL2) level is entered, and time of automatic activation is set.

Password modification

A password is optionally modified; however, only that password can be modified to which the access is unlocked at the moment.

Password disabling

A password is disabled by setting the "AAAA" password.

PLEASE NOTE

A factory set password is "AAAA" at both access levels >L1 and L2). This password does not limit access.

Energy

WARNING

Before modification, all energy counters should be read with MiQen software to assure data consistency for the past.

After modification of energy parameters, the energy meters (counters) should be reset. All recorded measurements from this point back might have wrong values so they should not be transferred to any system for data acquisition and analysis. Data stored before modification should be used for this purpose.

Active Tariff

When active tariff is set, one of the tariffs is defined as active; switching between tariffs is done either with a tariff clock or a tariff input. For the operation of the tariff clock other parameters of the tariff clock that are accessible only via communication must be set correctly.

Common Energy Counter Resolution

Common energy exponent defines minimal energy that can be displayed on the energy counter. A common energy exponent also influences setting of impulses for pulse output or alarm output functioning as an energy meter.

Define common energy exponent as recommended in table below, where *Individual counter Resolution* is at default value 10. Values of primary voltage and current determine proper Common energy exponent.


Voltage \ Current	Current				
	1 A	5 A	50 A	100 A	1000 A
110 V	100 mWh	1 Wh	10 Wh	10 Wh	100 Wh
230 V	1 Wh	1 Wh	10 Wh	100 Wh	1 kWh
1000 V	1 Wh	10 Wh	100 Wh	1 kWh	10 kWh
30 kV	100 Wh	100 Wh	1 kWh	10 kWh	10 kWh *

* - Individual counter resolution should be at least 100.

Counters

Measured Energy

For each of four (4) counters different measured quantities can be selected. User can select from a range of predefined options referring to measured total energy or energy on single phase. Or can even select its own option by selecting appropriate quantity, quadrant, absolute or inverted value.

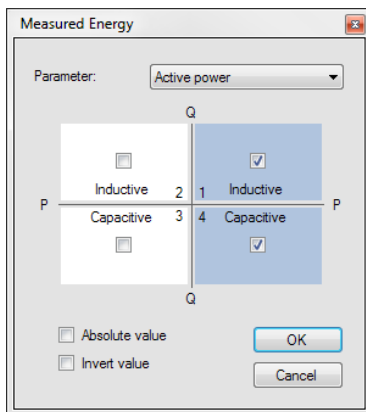

To energy counter also pulse / digital input can be attached. In this case Energy counter counts pulses from an outside source (water, gas, energy... meter).

Individual counter Resolution

The individual counter resolution additionally defines precision of a certain counter, according to settings of common energy counter resolution.

With individual counter resolution is possible to customize counter resolution by multiplying *Common Energy Counter Resolution* by chosen scale factor (x1 ... x10000).

Example:

Common Energy Counter Resolution is set to 10 Wh

Individual Counter Resolution is set to 100

Total resolution for counter is $10 \text{ Wh} \times 100 = 1 \text{ kWh}$

Tariff Selector


Defines tariffs where counter is active.

Inputs and outputs

Supervision Relay SR100 can be equipped with four relay output I/O modules. For relay output technical specifications see chapter [Technical data – I/O modules](#) on page 67.

Start-up delay for outputs (s)


When Supervision Relay SR100 is powered on, relay output modules stay in OFF state until expiration of start-up delay time. After expiration of start-up delay time, modules are set according to present network conditions. Compare time delay starts after expiration of start-up delay time. Please see diagram below for detailed explanation:

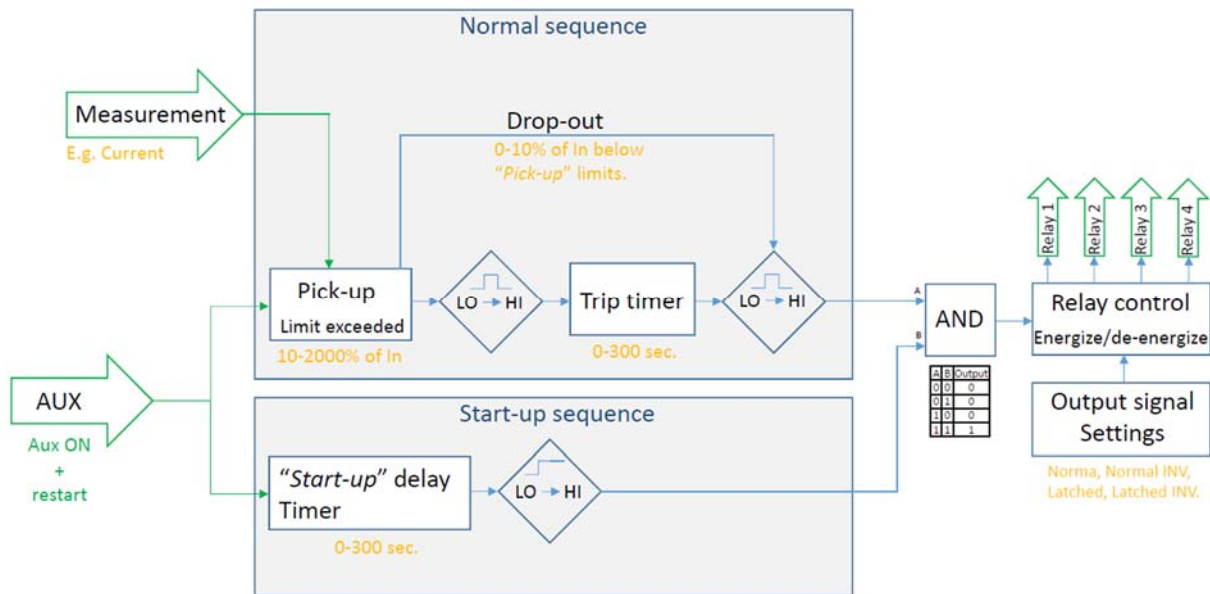

↔ – Input / Output simulations

Yellow – Setting range examples

◇ – “answer”

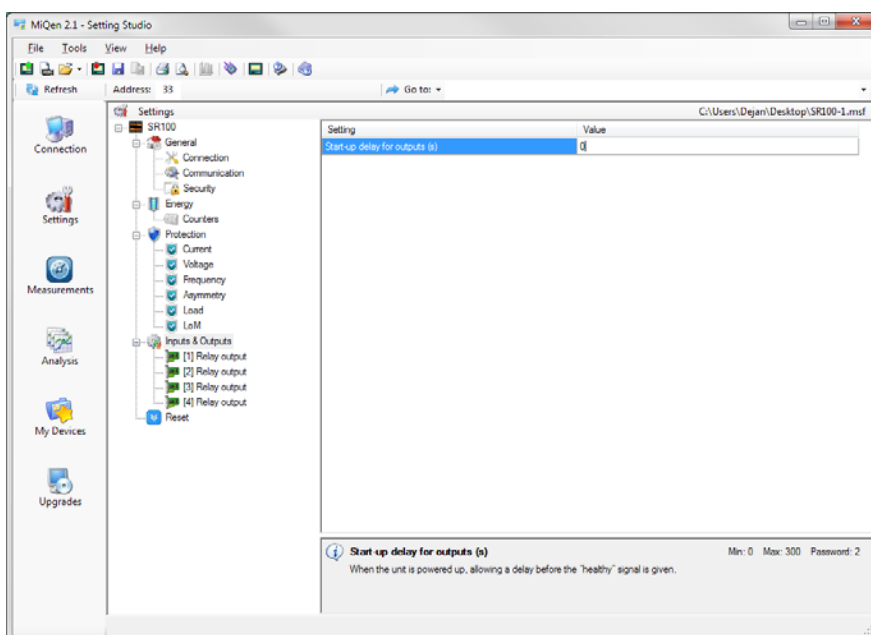

MiQen setting – Supervision Relay SR100 > Inputs & Outputs > Start-up delay for outputs


Enabled protection groups

Selection of logical groups for physical output control.

Output signal

8 different configurable relay output signal forms:

- normal,
- normal inverse,
- latched,
- latched inversed,
- pulsed (define pulse length in seconds),
- pulsed inversed (define pulse length in seconds),
- always on,
- always off

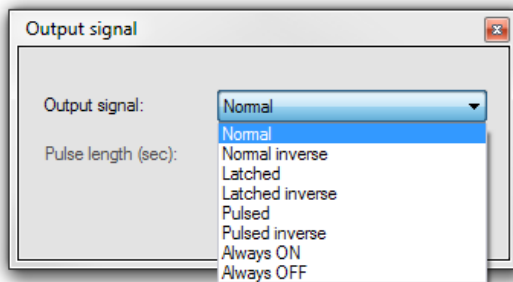

Options for I/O module 1/2/3/4

Outputs:

- Relay output
- Without

Relay output module

Relay output module has an alarm notification function. In case of any alarm occurrence, alarm output will trigger passive electromechanical relay or passive solid-state relay.

For each alarm output type of output signal (normal, normal inverse, latched, latched inverse, pulsed, pulsed inverse, Always ON, always OFF) when alarm is detected should be defined.

Protection Functions

Supervision Relay SR100 supports 13 different protection functions in 6 different logical categories:

- Current ([Overcurrent protection function \(Over Current 1 & 2\) ANSI# 50 \(>I, >>I\)](#) / [Overcurrent protection function \(Over Current IE 1 & 2\) ANSI# 50 N/G \(>IE\)](#) / [Overcurrent protection function \(Over Current Idiff 1 & 2\) ANSI# 87 \(>I'\)](#))
- Voltage ([Overvoltage protection functions \(Over Voltage 1 & 2\) ANSI# 59 \(>U, >>U\)](#) / [Undervoltage protection functions \(Under Voltage 1 & 2\) ANSI# 27 \(<U, <<U\)](#))
- Frequency ([Overfrequency protection functions \(Over Frequency 1 & 2\) ANSI# 81O \(>f, >>f\)](#) / [Underfrequency protection functions \(Under Frequency 1 & 2\) ANSI# 81U \(<f, <<f\)](#))
- Asymmetry ([Asymmetry protection functions: Voltage Unbalances ANSI# 47 \(>UUn\)](#) and [Asymmetry protection functions: Phase Imbalance 1&2 ANSI# 46 \(>I_{im}, >>I_{im}\)](#))
- Load ([Load protection functions: Directional power 1&2 ANSI# 32 \(>P, >>P\)](#), [Load protection functions: Power underrun 1&2 ANSI# 32R/U \(<P, <<P\)](#))
- LoM ([LoM \(Loss of Mains\) protection functions: Phase Shift ANSI# 78 \(> dPhi/dt\)](#), [LoM \(Loss of Mains\) protection functions: ROCOF protection ANSI# 81R \(> df/dt\)](#))

The general parameters represented in the following table can be defined in the Setting and acquisition Software MiQen to define the overall functioning of the protection functions which Supervision Relay SR100 provides:

Settings	Definition
Connection mode	Defines the connection mode for the voltage monitoring.
Nominal Voltage (V)	Defines the nominal voltage for all voltage related protection functions.
Nominal Frequency	Defines the nominal frequency for all frequency related protection functions.
Rated Current (A)	Defines the rated current for all current related protection functions.
Rated Active Power (W)	Defines the rated active power for all power related protection functions.
Phase rotation	Defines the phase rotation direction for correct phase imbalance monitoring. Clockwise (L1-L2-L3); Anticlockwise (L1-L3-L2).
Phase Shift monitoring mode	Defines the phase shift monitoring mode. '1- in 3 phase' – tripping occurs if the phase shift exceeds the threshold value (1 phase) in at least one phase or exceeds the threshold value (3 phase) in all three phases: '3 phase' – tripping occurs if the phase shift exceeds the threshold value (3phase) in all three phases.
Monitoring**	Defines if monitoring parameter protection function is enabled or not.
Parameter limit (%)*	Defines the threshold value for tripping. If the threshold value is reached or fallen below for the period of at least compare delay time, the alarm will be activated.
Compare time delay (s)* (In this document will be marked as: t _{cd})	Defines the compare time delay for tripping. If the threshold value is reached or fallen below for the period of at least compare delay time, the alarm will be activated.
Hysteresis (%)*	Defines the hysteresis for tripping. The hysteresis is calculated from nominal value and is used when output switch off.
Assigned group**	Defines the logical group assigned with the protection function. Use enabled protection groups setting (Relay output) to assign logical groups to physical outputs.
Parameter limit – 1 phase ()***	Defines the threshold value for tripping. If the threshold value is reached or fallen below for the period of at least compare delay time, the alarm will be activated.
Parameter limit – 3 phase ()***	Defines the threshold value for tripping. If the threshold value is reached or fallen below for the period of at least compare delay time, the alarm will be activated.

* Under every particular protection category except Phase Shift

** Under every particular protection category

*** Under category Phase Shift

See MiQen Settings overview for Supervision Relay SR100 in chapter [Protection Functions in MiQEN - Setting and Acquisition Software](#).

PLEASE NOTE

Supervision Relay SR100 response time:

Time from error detection to relay switching on/off is typically below 50ms.

Overcurrent protection function (Over Current 1 & 2) ANSI# 50 (>I, >>I)

⚠ PLEASE NOTE

Overcurrent protection function (>I, >>I) has to be used with [Three phase, four wire connection with unbalanced load \(4u\)](#) – please refer to chapter *Electrical connection for Supervision Relay SR100* on page 12. Since other current protection functions use different electrical connection mode, it is not possible to use them simultaneously.


If >I and >>I are chosen (4u electrical connection), monitoring of >IE and >I' will not work properly.

ANSI #50 – Overcurrent protection function detect abnormally high network current on each individual phase. If current exceeds predefined parameter limit, protection function will trigger relay. It is possible to define up to two overcurrent (>I, >>I) relay output limits with up to 2000% of nominal current.

The parameters represented in the table below can be defined within the Setting and acquisition Software MiQen (see MiQen: [SR100 > Protection > Current > Over Current 1/2 protection functions](#); description is identical for all limits; the limits may only differ in their setting ranges):

Limit	Text	Setting range	Standard value
Over Current 1	Monitoring	Yes/No	No
	Parameter limit (%)	10.0 – 2000.0	108
	Compare time delay (s)	0.00 – 60.00	0
	Hysteresis (%)	0.00 – 10.00	0
	Assigned Group	Protection Group 1, Protection Group 2, Protection Group 3, Protection Group 4	Protection Group 1
Over Current 2	Monitoring	Yes/No	Yes
	Parameter limit (%)	10.00 – 2000.00	112
	Compare time delay (s)	0.00 – 60.00	0.3
	Hysteresis (%)	0.00 – 10.00	0
	Assigned Group	Protection output 1, Protection output 2, Protection output 3, Protection output 4	Protection output 2

The figure below graphically represents the behavior of this particular protection function:

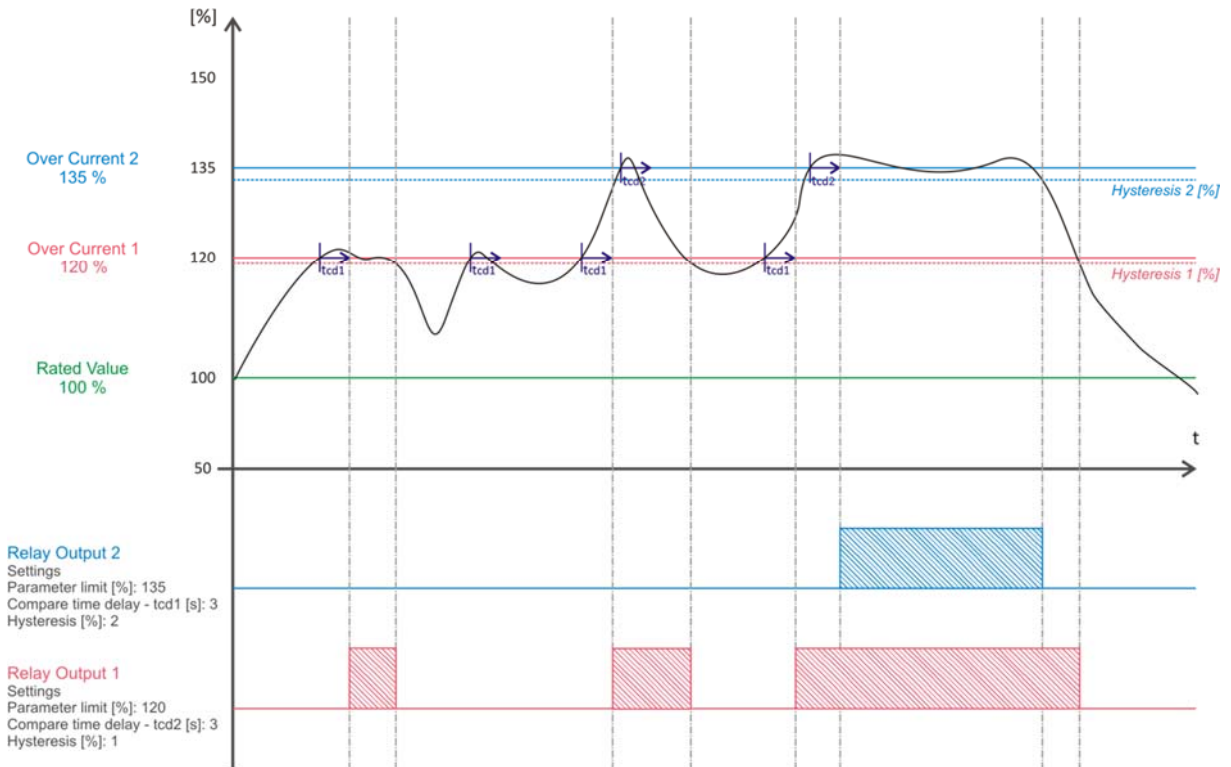

Monitoring – Over Current (>I, >>I)

Overcurrent protection function (Over Current IE 1 & 2) ANSI# 50 N/G (>IE)

⚠ PLEASE NOTE

Overcurrent protection function (>IE) has to be used with [IE electrical connection](#) – please refer to chapter *Electrical connection for Supervision Relay SR100* on page 12. Since other current protection functions use different electrical connection mode it is not possible to use them simultaneously.


If >IE is chosen (IE electrical connection), monitoring of >I, >>I and >I' will not work properly.

ANSI #50 N/G – Earth fault protection function (>IE) detects earth faults. >IE measurement is performed in a way that external currents are summed. In normal operation summation equals 0. Earth fault on one or more phases will result in abnormally high network current which will trigger Earth fault function. It is possible to define up to two overcurrent (>IE) relay output limits with up to 550% of nominal current.

The parameters represented in the table below can be defined within the Setting and acquisition Software MiQen (see MiQen: [SR100 > Protection > Current > Over Current IE 1/2 protection functions](#); description is identical for all limits; the limits may only differ in their setting ranges):

Limit	Text	Setting range	Standard value
Over Current 1	Monitoring	Yes/No	No
	Parameter limit (%)	0.40 – 550.00	108
	Compare time delay (s)	0.00 – 60.00	0
	Hysteresis (%)	0.00 – 10.00	0
	Assigned Group	Protection Group 1, Protection Group 2, Protection Group 3, Protection Group 4	Protection Group 1
Over Current 2	Monitoring	Yes/No	Yes
	Parameter limit (%)	0.40 – 550.00	112
	Compare time delay (s)	0.00 – 60.00	0.3
	Hysteresis (%)	0.00 – 10.00	0
	Assigned Group	Protection output 1, Protection output 2, Protection output 3, Protection output 4	Protection output 2

The figure below graphically represents the behavior of this particular protection function:

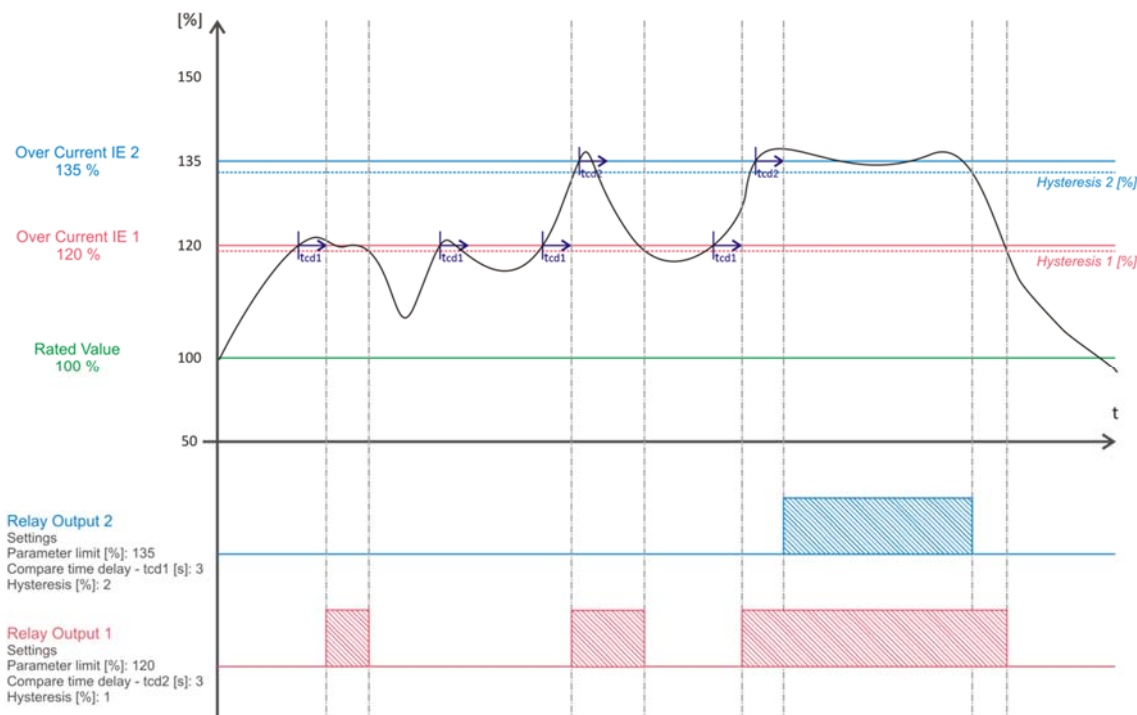

Monitoring – Over Current (>IE)

Overcurrent protection function (Over Current Idiff 1 & 2) ANSI# 87 (>I')

⚠ PLEASE NOTE

Overcurrent protection function (>I') has to be used with [Idiff electrical connection](#) – please refer to chapter *Electrical connection for Supervision Relay SR100* on page 12. Since other current protection functions use different electrical connection mode it is not possible to use them simultaneously.


If >I' is chosen (Idiff electrical connection), monitoring of >I, >>I and >IE will not work properly.

ANSI #87 – Over current Idiff protection function compares the differential current of each of the 3 phases, providing an RMS measurement at sinusoidal currents. When measurement exceeds predefined parameter limit, Idiff protection function triggers relay. It is possible to define up to two overcurrent (>I') relay output limits with up to 200% of nominal current.

The parameters represented in the table below can be defined within the Setting and acquisition Software MiQen (see MiQen: [SR100 > Protection > Current > Over Current Idiff 1/2 protection functions](#); description is identical for all limits; the limits may only differ in their setting ranges):

Limit	Text	Setting range	Standard value
Over Current 1	Monitoring	Yes/No	No
	Parameter limit (%)	0.80 – 200.00	108
	Compare time delay (s)	0.00 – 60.00	0
	Hysteresis (%)	0.00 – 10.00	0
	Assigned Group	Protection Group 1, Protection Group 2, Protection Group 3, Protection Group 4	Protection Group 1
Over Current 2	Monitoring	Yes/No	Yes
	Parameter limit (%)	0.80 – 200.00	112
	Compare time delay (s)	0.00 – 60.00	0.3
	Hysteresis (%)	0.00 – 10.00	0
	Assigned Group	Protection output 1, Protection output 2, Protection output 3, Protection output 4	Protection output 2

The figure below graphically represents the behavior of this particular protection function:

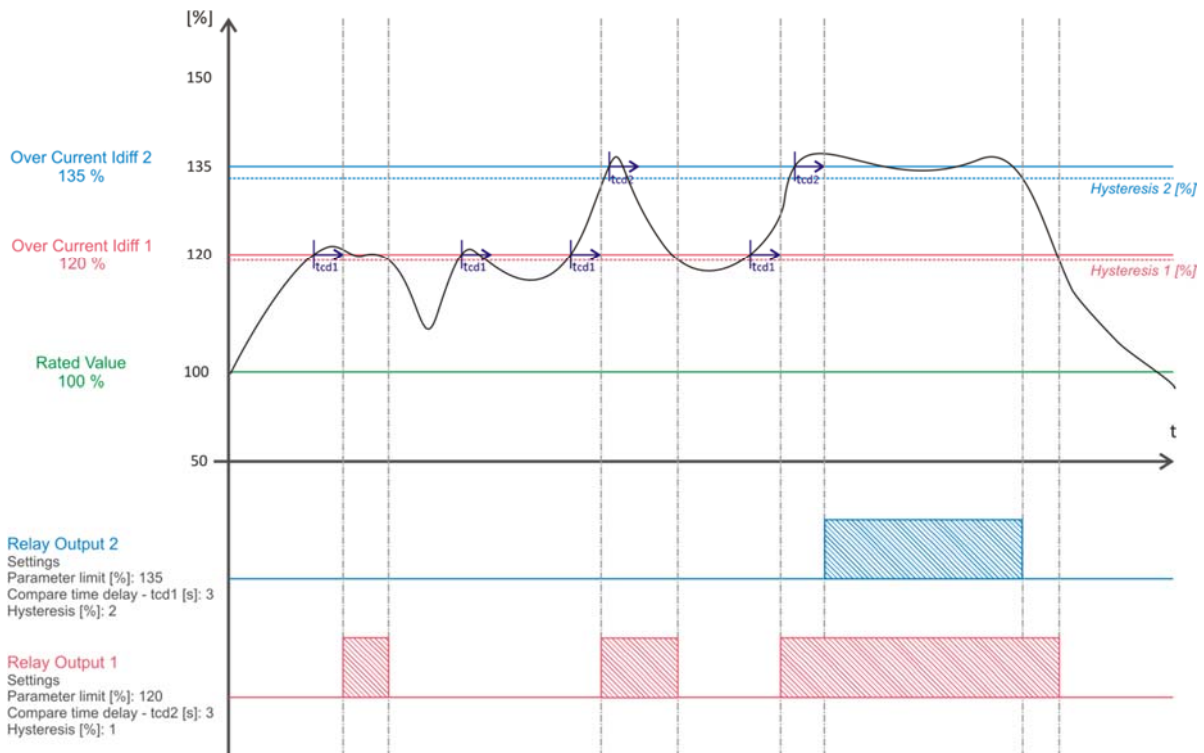

Monitoring – Over Current (>I')

Overvoltage protection functions (Over Voltage 1 & 2) ANSI# 59 (>U, >>U)


ANSI #59 – Overvoltage protection function detect abnormally high network voltage or checking for sufficient voltage to enable source transfer. This function works with phase-to-phase or phase-to-neutral voltage, each voltage being monitored separately. It is possible to define up to two overvoltage relay output limits with up to 150% of nominal voltage.

The parameters represented in the table below can be defined within the Setting and acquisition Software MiQen(see MiQen: [SR100 > Protection > Voltage > Over Voltage ½ protection functions](#); description is identical for all limits; the limits may only differ in their setting ranges):

Limit	Text	Setting range	Standard value
Over Voltage 1	Monitoring	Yes/No	Yes
	Parameter limit (%)	100.00 - 150.00	108
	Compare time delay (s)	0.00 – 60.00	5
	Hysteresis (%)	0.00 – 10.00	0
	Assigned Group	Protection output 1, Protection output 2, Protection output 3, Protection output 4	Protection output 1
Over Voltage 2	Monitoring	Yes/No	Yes
	Parameter limit (%)	100.00 - 150.00	112
	Compare time delay (s)	0.00 – 60.00	0.3
	Hysteresis (%)	0.00 – 10.00	0
	Assigned Group	Protection output 1, Protection output 2, Protection output 3, Protection output 4	Protection output 2

Monitoring – Over Voltage

The figure below graphically represents the behavior of this particular protection function:

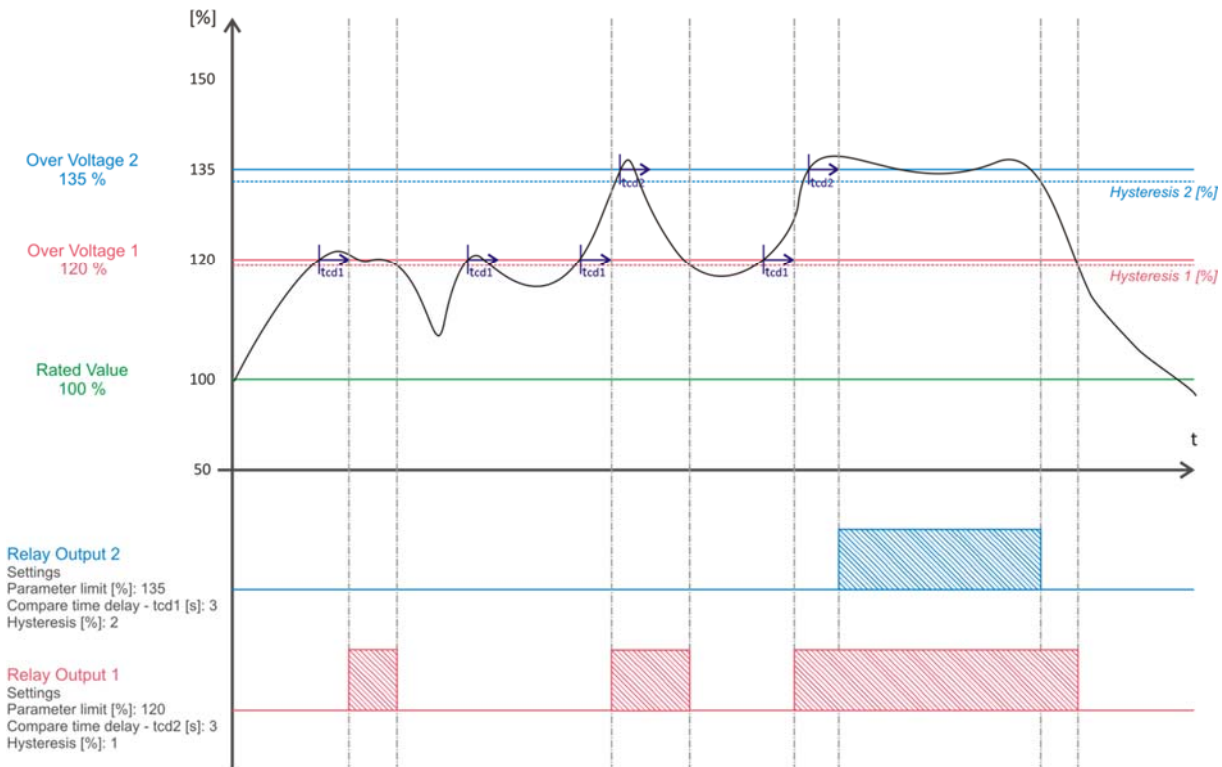

Monitoring – Over Voltage

Undervoltage protection functions (Under Voltage 1 & 2) ANSI# 27 (<U, <<U)


ANSI #27 - Undervoltage is used for protection of motors against voltage sags or detection of abnormally low network voltage to trigger automatic load shedding or source transfer. Works with phase-to-phase or phase-to-neutral voltage, each voltage being monitored separately. It is possible to define up to two undervoltage relay output limits with down to 50% of nominal voltage.

The parameters represented in the following table can be defined in the Setting and acquisition Software MiQen (see MiQen: [SR100 > Protection > Voltage > Under voltage 1/2 protection functions](#); description is identical for all limits; the limits may only differ in their setting ranges):

Limit	Text	Setting range	Standard value
Under Voltage 1	Monitoring	Yes/No	Yes
	Parameter limit (%)	50.00 – 100.00	92
	Compare time delay (s)	0.00 – 60.00	5
	Hysteresis (%)	0.00 – 10.00	0
	Assigned Group	Protection output 1, Protection output 2, Protection output 3, Protection output 4	Protection output 1
Under Voltage 2	Monitoring	Yes/No	Yes
	Parameter limit (%)	50.00 - 100.00	88
	Compare time delay (s)	0.00 – 60.00	0.3
	Hysteresis (%)	0.00 – 10.00	0
	Assigned Group	Protection output 1, Protection output 2, Protection output 3, Protection output 4	Protection output 2

Monitoring – Under Voltage

The figure below graphically represents the behavior of this particular protection function:

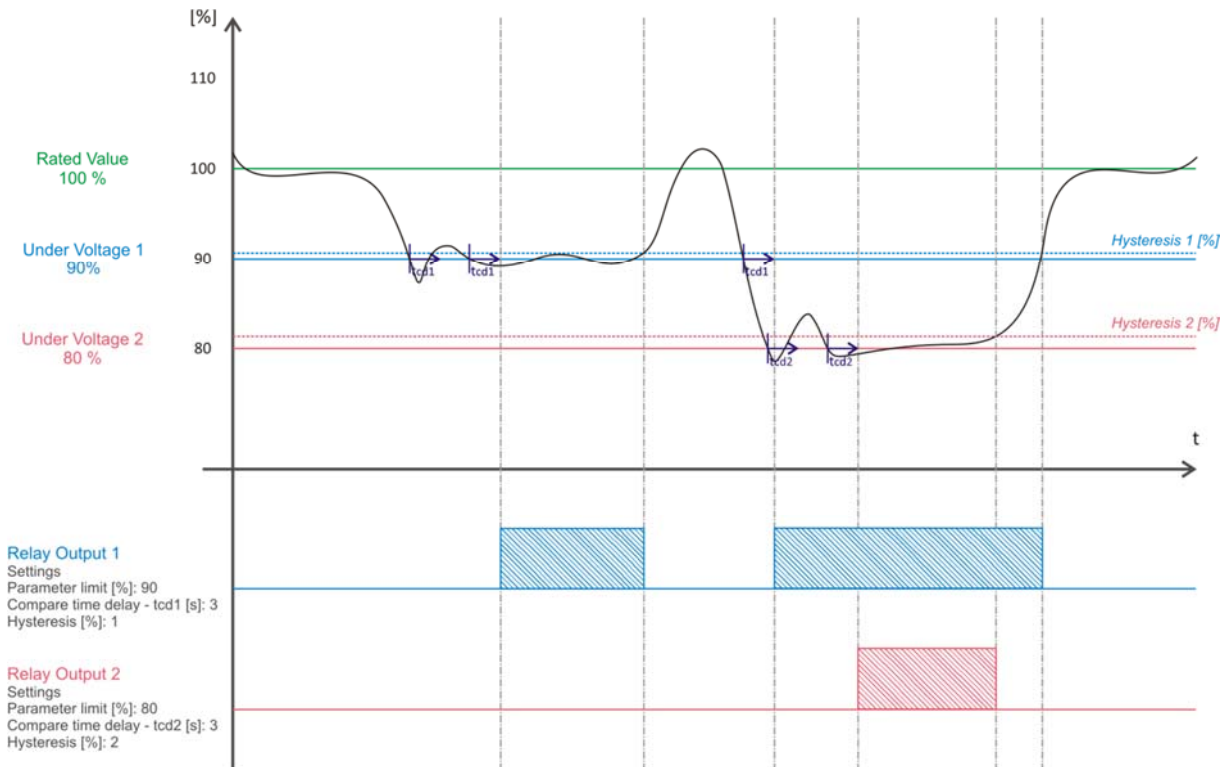

Monitoring – Under Voltage

Overfrequency protection functions (Over Frequency 1 & 2) ANSI# 810 (>f, >>f)


ANSI #810 – Overfrequency represents detection of abnormally high frequency compared to the rated frequency, to monitor power supply quality. Monitoring of the frequency is accomplished in two steps. It is possible to define up to two overfrequency relay output limits with up to 150% of nominal frequency.

The parameters represented in the following table can be defined in the Setting and acquisition Software MiQen (see MiQen: [SR100 > Protection > Frequency > Over Frequency 1/2 protection functions](#); description is identical for all limits; the limits may only differ in their setting ranges):

Limit	Text	Setting range	Standard value
Over Frequency 1	Monitoring	Yes/No	Yes
	Parameter limit (%)	100.00 – 150.00	110
	Compare time delay (s)	0.00 – 60.00	1.5
	Hysteresis (%)	0.00 – 10.00	0
	Assigned Group	Protection output 1, Protection output 2, Protection output 3, Protection output 4	Protection output 1
Over frequency 2	Monitoring	Yes/No	Yes
	Parameter limit (%)	100.00 - 150.00	115
	Compare time delay (s)	0.00 – 60.00	0.3
	Hysteresis (%)	0.00 – 10.00	0
	Assigned Group	Protection output 1, Protection output 2, Protection output 3, Protection output 4	Protection output 2

Monitoring – Over Frequency

The figure below graphically represents the behavior of this particular protection function:

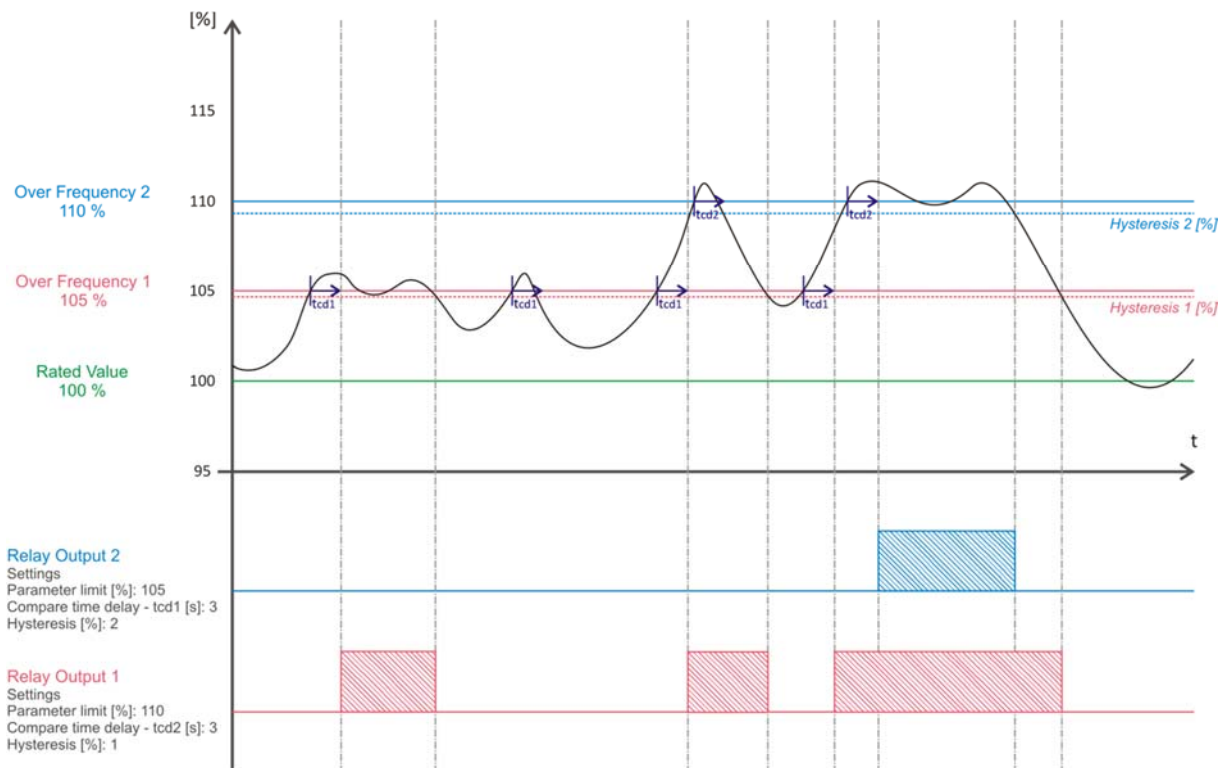

Monitoring – Over Frequency

Underfrequency protection functions (Under Frequency 1 & 2) ANSI# 81U (<f, <<f)


ANSI #81U – Underfrequency is detection of abnormally low frequency compared to the rated frequency, to monitor power supply quality. The protection may be used for overall tripping or load shedding. Protection stability is ensured in the event of the loss of the main source and presence of remnant voltage by a restraint in the event of a continuous decrease of the frequency, which is activated by parameter setting. Monitoring of the frequency is performed in two steps. It is possible to define up to two underfrequency relay output limits with down to 50% of nominal frequency.

The parameters represented in the following table can be defined in the Setting and acquisition Software MiQen (see MiQen: [SR100 > Protection > Frequency > Under Frequency 1/2 protection functions](#); description is identical for all limits; the limits may only differ in their setting ranges):

Limit	Text	Setting range	Standard value
Under Frequency 1	Monitoring	Yes/No	Yes
	Parameter limit (%)	50.00 – 100.00	90
	Compare time delay (s)	0.00 – 60.00	5
	Hysteresis (%)	0.00 – 10.00	0
	Assigned Group	Protection output 1, Protection output 2, Protection output 3, Protection output 4	Protection output 1
Under frequency 2	Monitoring	Yes/No	Yes
	Parameter limit (%)	50.00 – 100.00	84
	Compare time delay (s)	0.00 – 60.00	0.3
	Hysteresis (%)	0.00 – 10.00	0
	Assigned Group	Protection output 1, Protection output 2, Protection output 3, Protection output 4	Protection output 2

Monitoring – Under Frequency

The figure below graphically represents the behavior of this particular protection function:

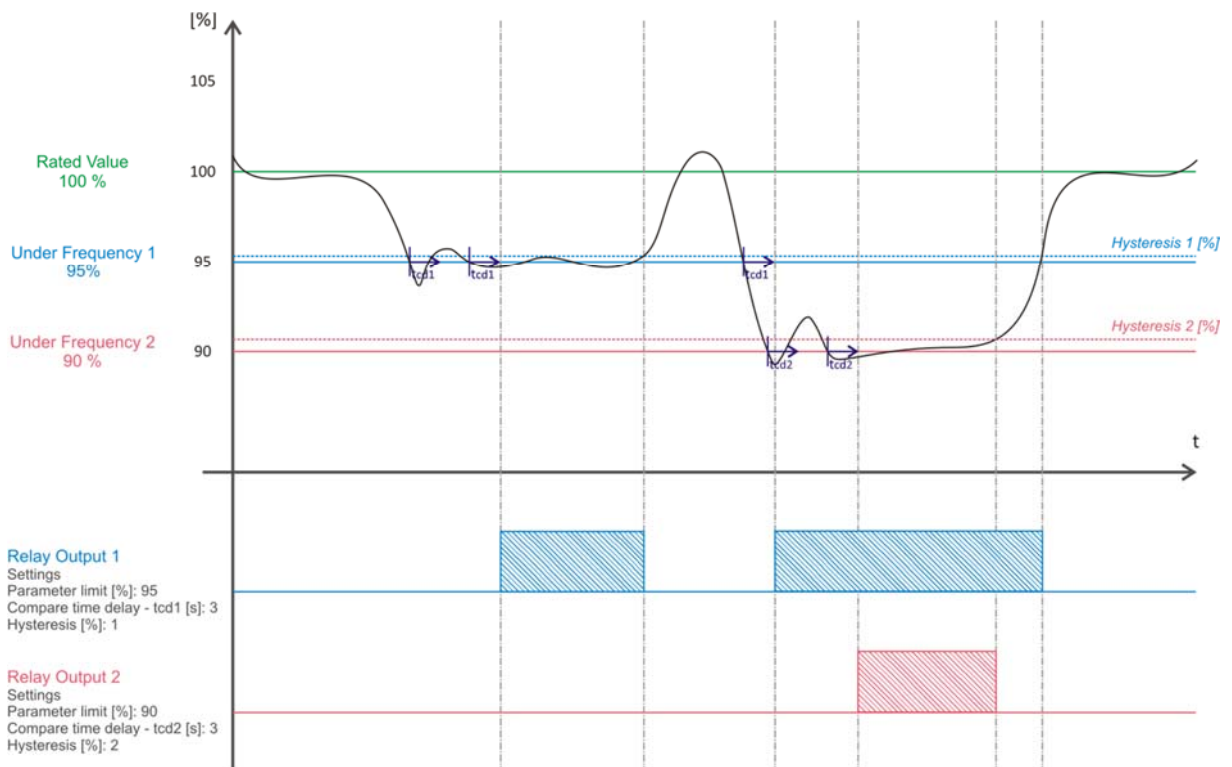

Monitoring – Under Frequency

Asymmetry protection functions: Voltage Unbalances ANSI# 47 ($>U_{Un}$)


Voltage unbalance is regarded as a power quality problem of significant concern at the electricity distribution level. Although the voltages are quite well balanced at the generator and transmission levels the voltages at the utilization level can become unbalanced due to the unequal system impedances and the unequal distribution of single-phase loads. An excessive level of voltage unbalance can have serious impacts on mains connected induction motors. The level of current unbalance that is present is several times the level of voltage unbalance. With this protection function Voltage Unbalance is supervised over phase resulting from phase inversion, unbalanced supply or distant fault, detected by the measurement of negative sequence voltage component of a three phase system. This parameter has a range of 0 to 100% of the rated nominal voltage.

The parameters represented in the following table can be defined in the Setting and acquisition Software MiQen (see MiQen: [SR100 > Protection > Asymmetry > Voltage unbalances protection functions](#); description is identical for all limits; the limits may only differ in their setting ranges):

Limit	Text	Setting range	Standard value
Voltage Unbalances	Monitoring	Yes/No	Yes
	Parameter limit (%)	0.00 – 100.00	100
	Compare time delay (s)	0.00 – 60.00	5
	Hysteresis (%)	0.00 – 10.00	0
	Assigned Group	Protection output 1, Protection output 2, Protection output 3, Protection output 4	Protection output 1

Monitoring – Voltage Unbalances

The figure below graphically represents the behavior of this particular protection function:

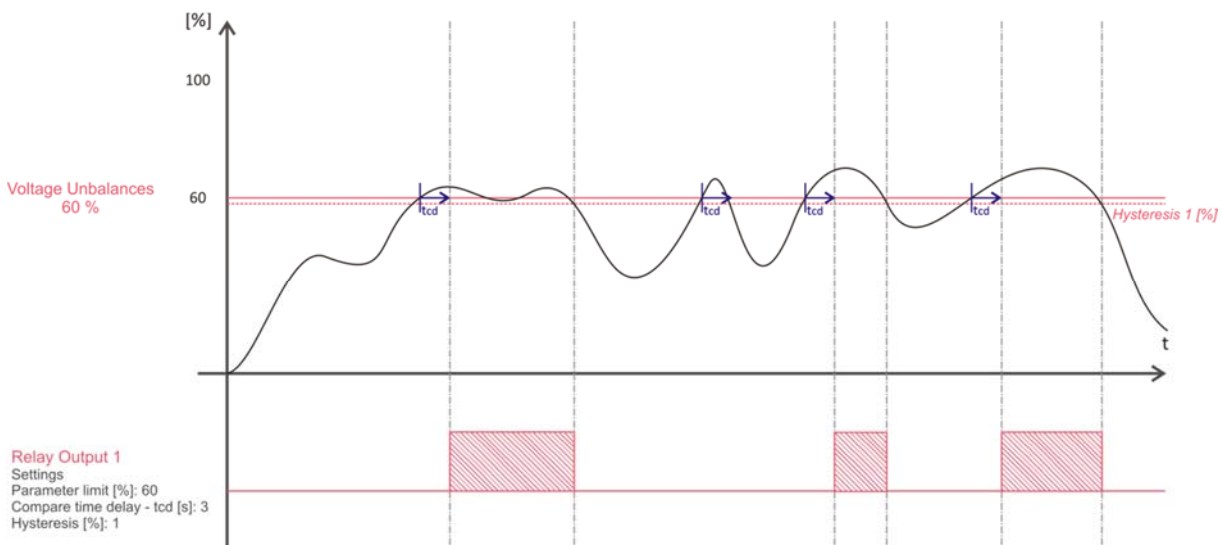

Monitoring – Voltage Unbalances

Asymmetry protection functions: Phase Imbalance 1&2 ANSI# 46 ($>I_{im}$, $>>I_{im}$)

ANSI #46 represents protection against phase unbalance, detected by the measurement of negative sequence currents. It can be used in the following practical examples:

- Sensitive protection to detect 2-phase faults at the ends of long lines
- Protection of equipment against temperature build-up, caused by an unbalanced power supply, phase inversion or loss of phase, and against phase current unbalance


The phase imbalance protection function is used for protection over phase imbalance resulting from phase inversion, unbalanced supply or distant fault, detected by the measurement of negative sequence voltage. This threshold is defined relative to the rated current and has a range between 0 and 100%.

The parameters represented in the following table can be defined in the Setting and acquisition Software MiQen (see MiQen: [SR100 > Protection > Asymmetry > Phase Imbalance 1/2 protection functions](#); description is identical for all limits; the limits may only differ in their setting ranges):

Limit	Text	Setting range	Standard value
Phase Imbalance 1	Monitoring	Yes/No	Yes
	Parameter limit (%)	0.00 – 100.00	10
	Compare time delay (s)	0.00 – 60.00	10
	Hysteresis (%)	0.00 – 10.00	0
	Assigned Group	Protection output 1, Protection output 2, Protection output 3, Protection output 4	Protection output 1
Phase Imbalance 2	Monitoring	Yes/No	Yes
	Parameter limit (%)	0.00 – 100.00	15
	Compare time delay (s)	0.00 – 60.00	1
	Hysteresis (%)	0.00 – 10.00	0
	Assigned Group	Protection output 1, Protection output 2, Protection output 3, Protection output 4	Protection output 2

Monitoring – Phase Imbalance

The figure below graphically represents the behavior of this particular protection function:

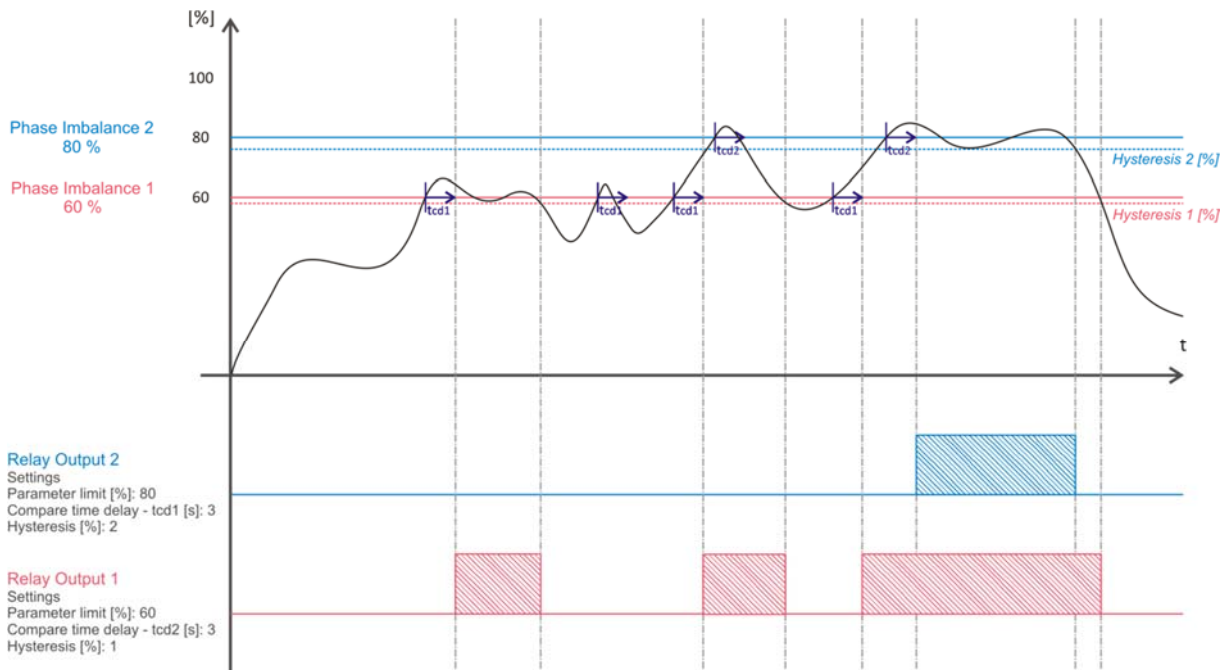

Monitoring – Phase Imbalance

Load protection functions: Directional power 1&2 ANSI# 32 (>P, >>P)

This protection function is a two-way protection based on calculated active power, for the following applications:

- active overpower protection to detect overloads and allow load shedding
- reverse active power protection:
 - against generators running like motors when the generators consume active power
 - against motors running like generators when the motors supply active power


Directional power protection is based on calculated active power. Active overpower monitoring is used to detect overloads and allow load shedding. It is possible to define up to two relay output limits within the range between -300% and 300% of the rated active power.

The parameters represented in the following table can be defined in the Setting and acquisition Software MiQen (see MiQen: [SR100 > Protection > Load > Directional power 1/2 protection functions](#); description is identical for all limits; the limits may only differ in their setting ranges):

Limit	Text	Setting range	Standard value
Directional power 1	Monitoring	Yes/No	Yes
	Parameter limit (%)	-300.00 – 300.00	110
	Compare time delay (s)	0.00 – 60.00	11
	Hysteresis (%)	0.00 – 10.00	0
	Assigned Group	Protection output 1, Protection output 2, Protection output 3, Protection output 4	Protection output 1
Directional power 2	Monitoring	Yes/No	Yes
	Parameter limit (%)	-300.00 – 300.00	120
	Compare time delay (s)	0.00 – 60.00	0.1
	Hysteresis (%)	0.00 – 10.00	0
	Assigned Group	Protection output 1, Protection output 2, Protection output 3, Protection output 4	Protection output 2

Monitoring – Directional power

The figure below graphically represents the behavior of this particular protection function:

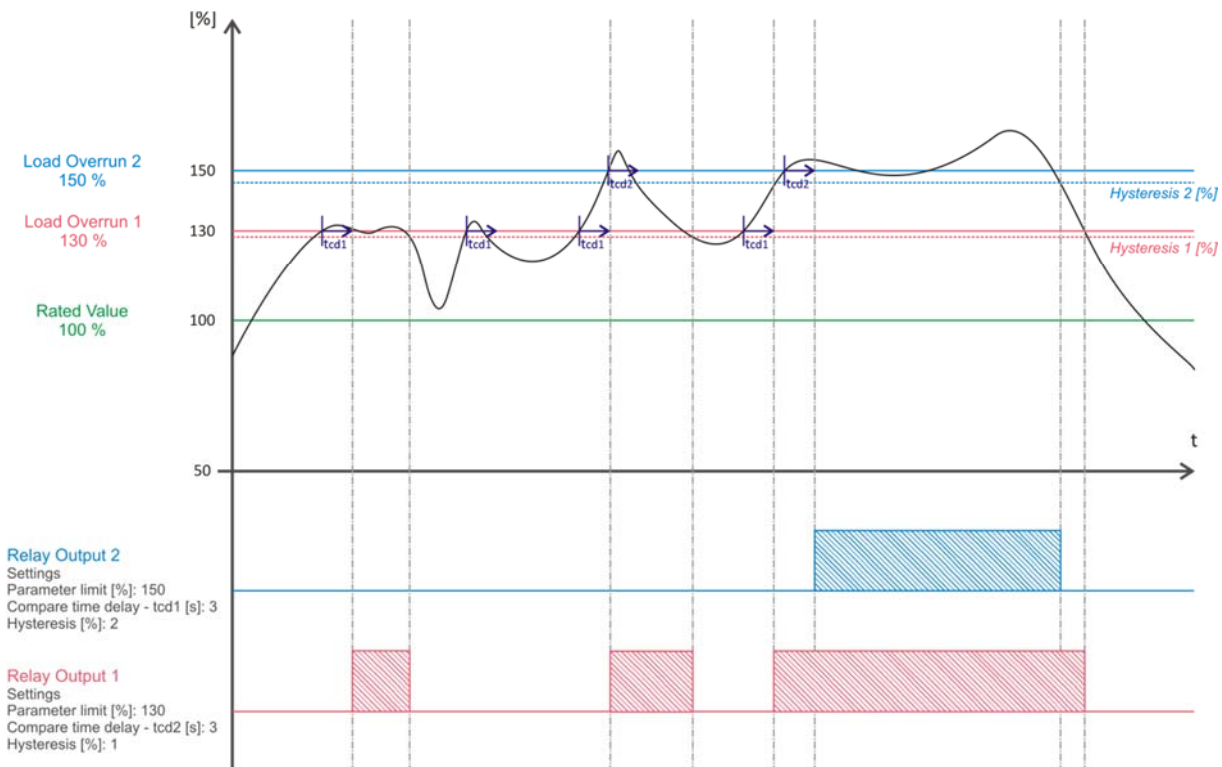

Monitoring – Directional power

Load protection functions: Power underrun 1&2 ANSI# 32R/U (<P, <<P)


Power underrun Protection is based on calculated active power. This user defined limit defines the permissible deviation of the load from defined thresholds. The function is triggered if the measured value falls below the rated active power limit and can be set between -300% and 300%.

The parameters represented in the following table can be defined in the Setting and acquisition Software MiQen (see MiQen: [SR100 > Protection > Load > Power underrun 1/2 protection functions](#); description is identical for all limits; the limits may only differ in their setting ranges):

Limit	Text	Setting range	Standard value
Power underrun 1	Monitoring	Yes/No	Yes
	Parameter limit (%)	-300.00 – 300.00	-3
	Compare time delay (s)	0.00 – 60.00	5
	Hysteresis (%)	0.00 – 10.00	0
	Assigned Group	Protection output 1, Protection output 2, Protection output 3, Protection output 4	Protection output 1
Power underrun 2	Monitoring	Yes/No	Yes
	Parameter limit (%)	-300.00 – 300.00	-5
	Compare time delay (s)	0.00 – 60.00	3
	Hysteresis (%)	0.00 – 10.00	0
	Assigned Group	Protection output 1, Protection output 2, Protection output 3, Protection output 4	Protection output 2

Monitoring – Power underrun

The figure below graphically represents the behavior of this particular protection function:

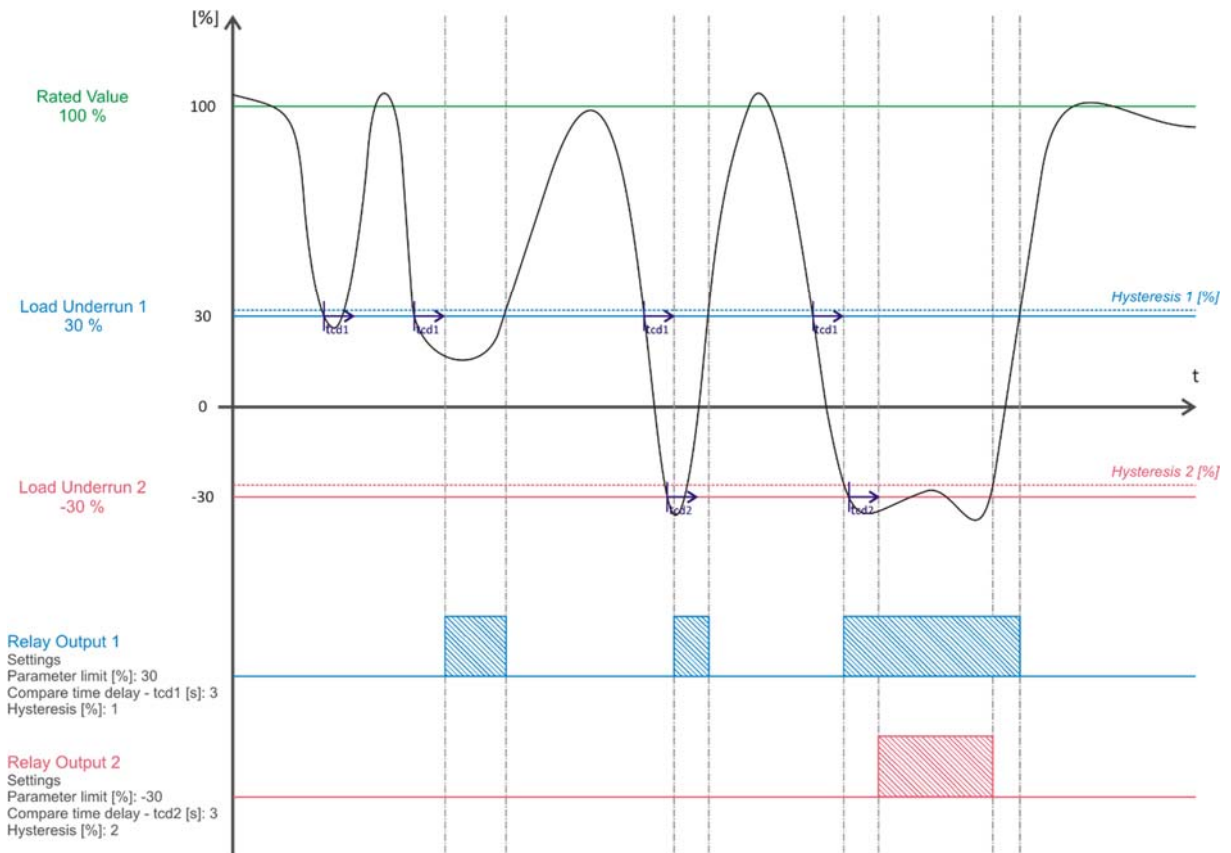

Monitoring – Power underrun

LoM (Loss of Mains) protection functions: Phase Shift ANSI# 78(> dPhi/dt)

Loss of Mains occurs when part of the public utility network loses connection with the rest of the system. If LOM is not detected, then the generator could remain connected, causing a safety hazard within the network. Automatic reconnection of the generator to the network may occur causing damage to the generator and the network.

One of LOM detection methods is Voltage Vector Shift/Phase Shift. The Vector Shift protection algorithm is based on voltage angle measurements performed on all three phase voltages. A measurement is taken from each of the 3 phase voltages after every half-cycle and the decision is made after a full cycle. The use of the three phases makes the algorithm less exposed to harmonic distortion, interference and imbalanced faults. This improves protection stability and decreases the probability of spurious tripping during nonsymmetrical faults. This limit for phases 1 and 3 can be set in the range between 0 and 90% respectively.


The monitoring may be carried out in three-phase or one-phase mode. The monitoring can be configured in different ways. The vector/phase shift monitor can also be used as an additional method to decouple from the grid. Vector/phase shift monitoring is only enabled after the monitored voltage exceeds 50% of the PT secondary rated voltage.

The parameters represented in the following table can be defined in the Setting and acquisition Software MiQen (see MiQen: [SR100 > Protection > LoM > Phase Shift protection functions](#); description is identical for all limits; the limits may only differ in their setting ranges):

Limit	Text	Setting range	Standard value
Phase Shift	Monitoring	Yes/No	Yes
	Parameter limit – 1 phase (°)	0.00 – 90.00	20
	Parameter limit – 3 phase (°)	0.00 – 90.00	8
	Assigned Output	Protection output 1, Protection output 2, Protection output 3, Protection output 4	Protection output 1

Monitoring – Phase Shift

The figure below graphically represents the behavior of this particular protection function:

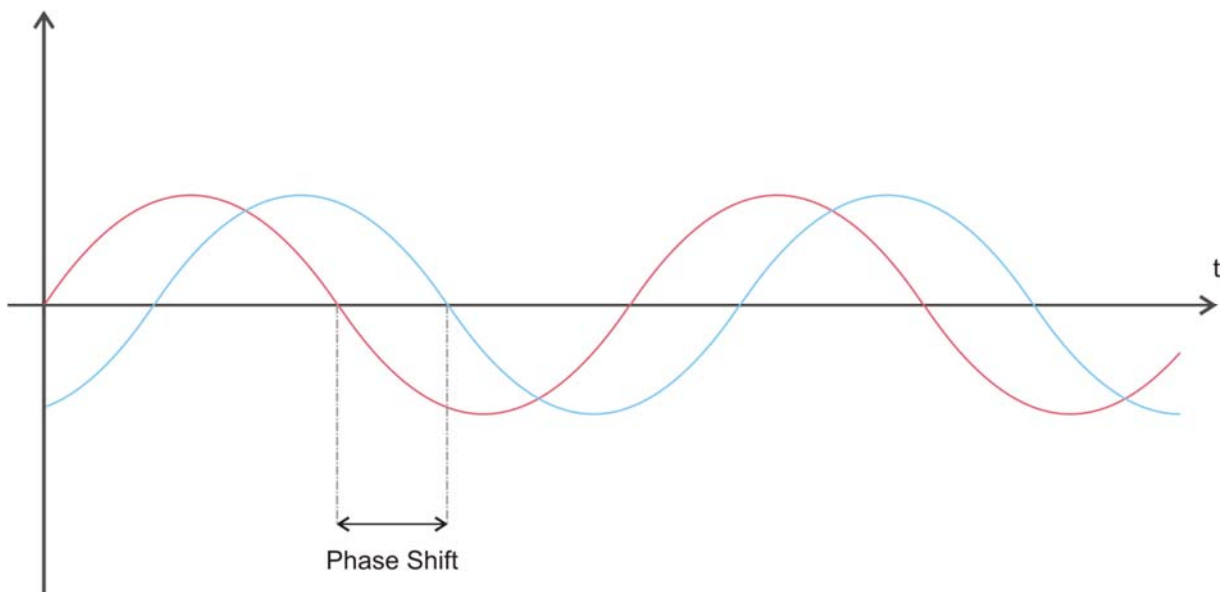

Monitoring – Phase Shift

LoM (Loss of Mains) protection functions: ROCOF protection ANSI# 81R(> df/dt)

Loss of Mains occurs when part of the public utility network loses connection with the rest of the system. If LOM is not detected, then the generator could remain connected, causing a safety hazard within the network. Automatic reconnection of the generator to the network may occur causing damage to the generator and the network. One of LOM detection methods is ROCOF (Rate Of Change Of Frequency). The ROCOF method is based on the local measurement of the generator voltage and estimation of the rate of change of frequency. The rate of change of frequency following an LOM event is directly proportional to the amount of active power imbalance between local load and the generator output. The ROCOF value is calculated in moving 60ms windows and two consecutive calculations are required to assess if this is a permanent change. When both give a result above the set threshold the trip signal is initiated. To provide additional stability against normal load switching events and other small scale system transients, an additional time delay can be applied.

ROCOF parameter has a permissible limit range between 0 and 10 Hz/s. The frequency of a source will vary due to changing loads and other effects. The rate of these frequency changes due to the load variances is relatively high compared to those of a large network. The control unit calculates the unit of measure per unit of time. The df/dt is measured over 4 sine waves to ensure that it is differentiated from a phase shift. This results in a minimum response time of approximately 100ms.

The parameters represented in the following table can be defined in the Setting and acquisition Software MiQen (see MiQen: [SR100 > Protection > LoM > ROCOF df/dt protection functions](#); description is identical for all limits; the limits may only differ in their setting ranges):

Limit	Text	Setting range	Standard value
ROCOF df/dt	Monitoring	Yes/No	Yes
	Parameter limit (Hz/s)	0.00 – 10.00	2.6
	Compare time delay (s)	0.00 – 60.00	0.1
	Hysteresis (%)	0.00 – 10.00	0
	Assigned Output	Protection output 1, Protection output 2, Protection output 3, Protection output 4	Protection output 1


Monitoring – ROCOF

Protection Functions in MiQEN - Setting and Acquisition Software

MiQEN software is intended for setting up the Supervision Relay SR100 and many other instruments through a PC. Network and the transducer setting, display of measured values are possible via the serial communication. The information and measurements can be exported in standard Windows formats. The software runs on Windows XP, Vista, Win7, Win8 and Win10 operating systems.

Main features of MiQEN Setting studio software:


- Setting all of the instruments parameters (online and offline)
- Viewing current measured readings
- Setting and resetting energy counters
- Complete relay Output modules configuration
- Searching the network for devices
- Virtual interactive instrument
- Comprehensive help support

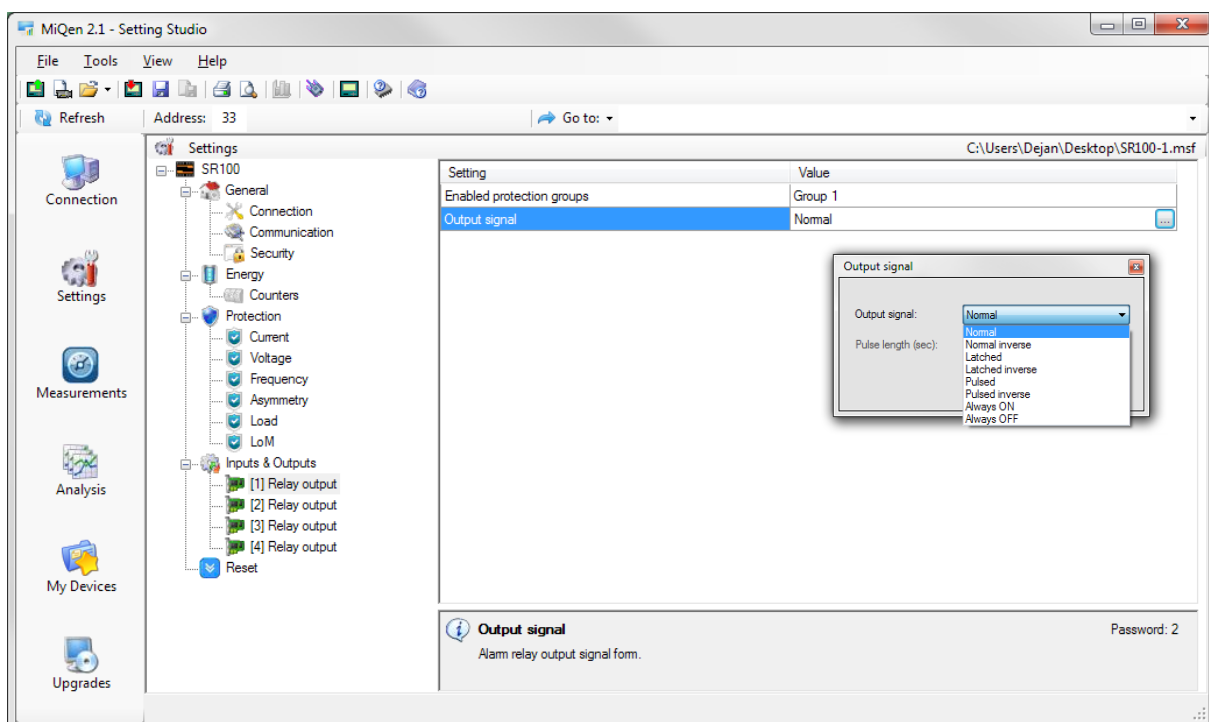

MiQEN Settings overview for Supervision Relay SR100 (example shows relay output module signal options)

Protection Functions

Current protection functions:

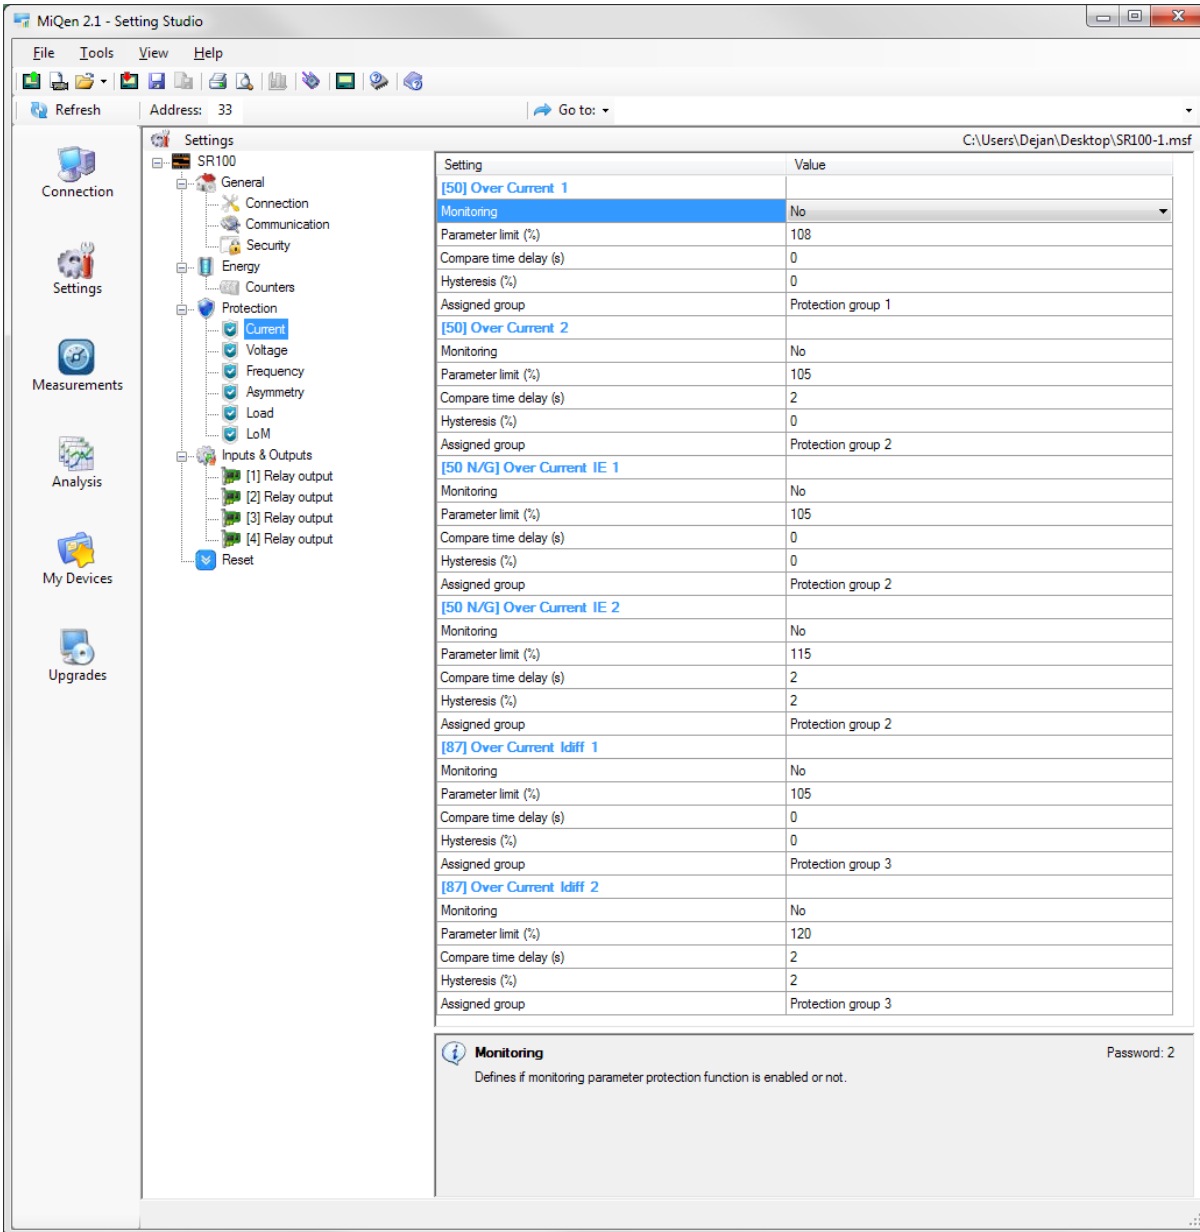

Setting	Value
[50] Over Current 1	
Monitoring	No
Parameter limit (%)	108
Compare time delay (s)	0
Hysteresis (%)	0
Assigned group	Protection group 1
[50] Over Current 2	
Monitoring	No
Parameter limit (%)	105
Compare time delay (s)	2
Hysteresis (%)	0
Assigned group	Protection group 2
[50 N/G] Over Current IE 1	
Monitoring	No
Parameter limit (%)	105
Compare time delay (s)	0
Hysteresis (%)	0
Assigned group	Protection group 2
[50 N/G] Over Current IE 2	
Monitoring	No
Parameter limit (%)	115
Compare time delay (s)	2
Hysteresis (%)	2
Assigned group	Protection group 2
[87] Over Current Idiff 1	
Monitoring	No
Parameter limit (%)	105
Compare time delay (s)	0
Hysteresis (%)	0
Assigned group	Protection group 3
[87] Over Current Idiff 2	
Monitoring	No
Parameter limit (%)	120
Compare time delay (s)	2
Hysteresis (%)	2
Assigned group	Protection group 3

Monitoring Password: 2
 Defines if monitoring parameter protection function is enabled or not.

MiQen: Setting – Current protection functions

Voltage protection functions:

Setting	Value
[59] Over Voltage 1	
Monitoring	Yes
Parameter limit (%)	110
Compare time delay (s)	0
Hysteresis (%)	0
Assigned group	Protection group 1
[59] Over Voltage 2 [59]	
Monitoring	Yes
Parameter limit (%)	110
Compare time delay (s)	5
Hysteresis (%)	0
Assigned group	Protection group 1
[27] Under Voltage 1	
Monitoring	No
Parameter limit (%)	92
Compare time delay (s)	5
Hysteresis (%)	0.7
Assigned group	Protection group 1
[27] Under Voltage 2	
Monitoring	No
Parameter limit (%)	88
Compare time delay (s)	0.3
Hysteresis (%)	0.7
Assigned group	Protection group 2

Monitoring
Defines if monitoring parameter protection function is enabled or not. Password: 2

MiQen: Setting – Voltage protection functions

Frequency protection functions:

Setting	Value
[810] Over Frequency 1	
Monitoring	Yes
Parameter limit (%)	103
Compare time delay (s)	0
Hysteresis (%)	0
Assigned group	Protection group 1
[810] Over Frequency 2	
Monitoring	No
Parameter limit (%)	115
Compare time delay (s)	0.3
Hysteresis (%)	0.1
Assigned group	Protection group 2
[81U] Under Frequency 1	
Monitoring	Yes
Parameter limit (%)	97
Compare time delay (s)	0
Hysteresis (%)	0
Assigned group	Protection group 1
[81U] Under Frequency 2	
Monitoring	No
Parameter limit (%)	84
Compare time delay (s)	0.3
Hysteresis (%)	0.1
Assigned group	Protection group 2

Monitoring
Defines if monitoring parameter protection function is enabled or not. Password: 2

MiQen: Setting – Frequency protection functions

Asymmetry protection functions:

The screenshot shows the 'Settings' window for SR100 in MiQen 2.1. The left sidebar shows a tree view with 'Asymmetry' selected under the 'Protection' category. The main area displays a table of settings for three protection functions: [47] Voltage Unbalances, [46] Phase Imbalance 1, and [46] Phase Imbalance 2. Below the table is a 'Monitoring' section with a password field set to '2'.

Setting	Value
[47] Voltage Unbalances	
Monitoring	No
Parameter limit (%)	10
Compare time delay (s)	5
Hysteresis (%)	0.7
Assigned group	Protection group 1
[46] Phase Imbalance 1	
Monitoring	No
Parameter limit (%)	10
Compare time delay (s)	10
Hysteresis (%)	0.5
Assigned group	Protection group 1
[46] Phase Imbalance 2	
Monitoring	No
Parameter limit (%)	15
Compare time delay (s)	1
Hysteresis (%)	0.5
Assigned group	Protection group 2

Monitoring Password: 2
Defines if monitoring parameter protection function is enabled or not.

MiQen: Setting – Asymmetry protection functions

Load protection functions:


The screenshot shows the 'Settings' window for SR100 in MiQen 2.1. The left sidebar shows a tree view with 'Load' selected under the 'Protection' category. The main area displays a table of settings for four protection functions: [32] Load Overrun 1, [32] Load Overrun 2, [32R/U] Load Underrun 1, and [32R/U] Load Underrun 2. Below the table is a 'Monitoring' section with a password field set to '2'.

Setting	Value
[32] Load Overrun 1	
Monitoring	No
Parameter limit (%)	105
Compare time delay (s)	1
Hysteresis (%)	1
Assigned group	Protection group 1
[32] Load Overrun 2	
Monitoring	No
Parameter limit (%)	120
Compare time delay (s)	0.1
Hysteresis (%)	1
Assigned group	Protection group 2
[32R/U] Load Underrun 1	
Monitoring	No
Parameter limit (%)	-3
Compare time delay (s)	5
Hysteresis (%)	1
Assigned group	Protection group 1
[32R/U] Load Underrun 2	
Monitoring	No
Parameter limit (%)	-5
Compare time delay (s)	3
Hysteresis (%)	1
Assigned group	Protection group 2

Monitoring Password: 2
Defines if monitoring parameter protection function is enabled or not.


MiQen: Setting – Load protection functions

LoM protection functions:

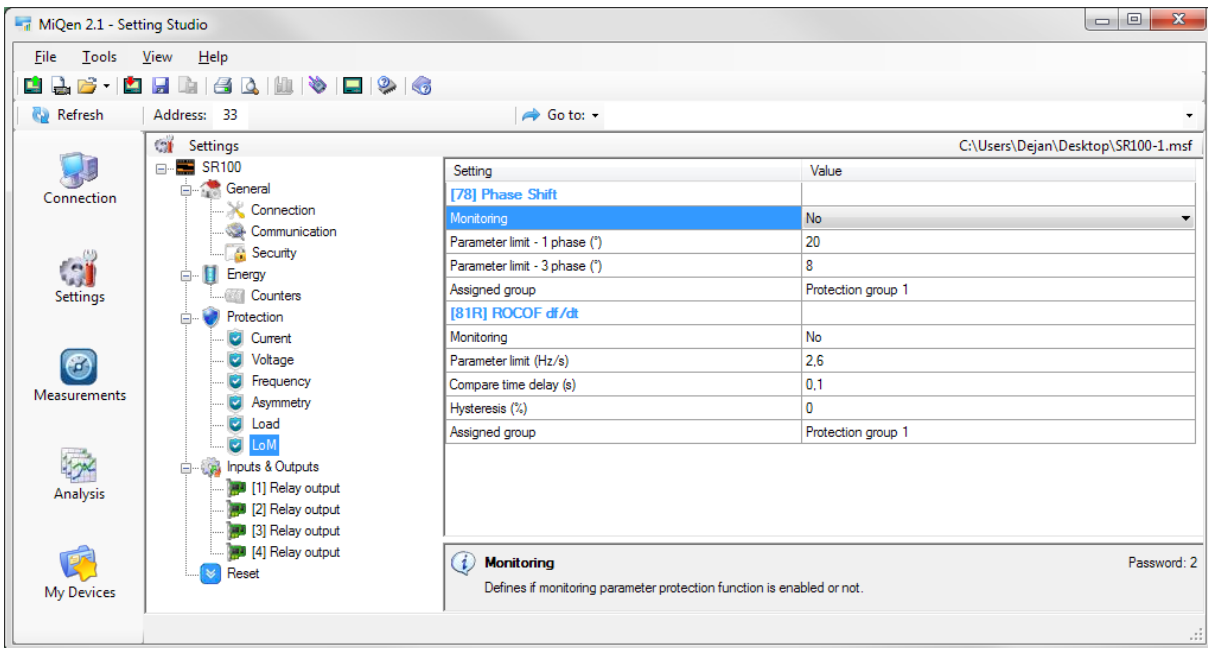

MiQen: Setting – LoM protection functions

On-line data monitoring

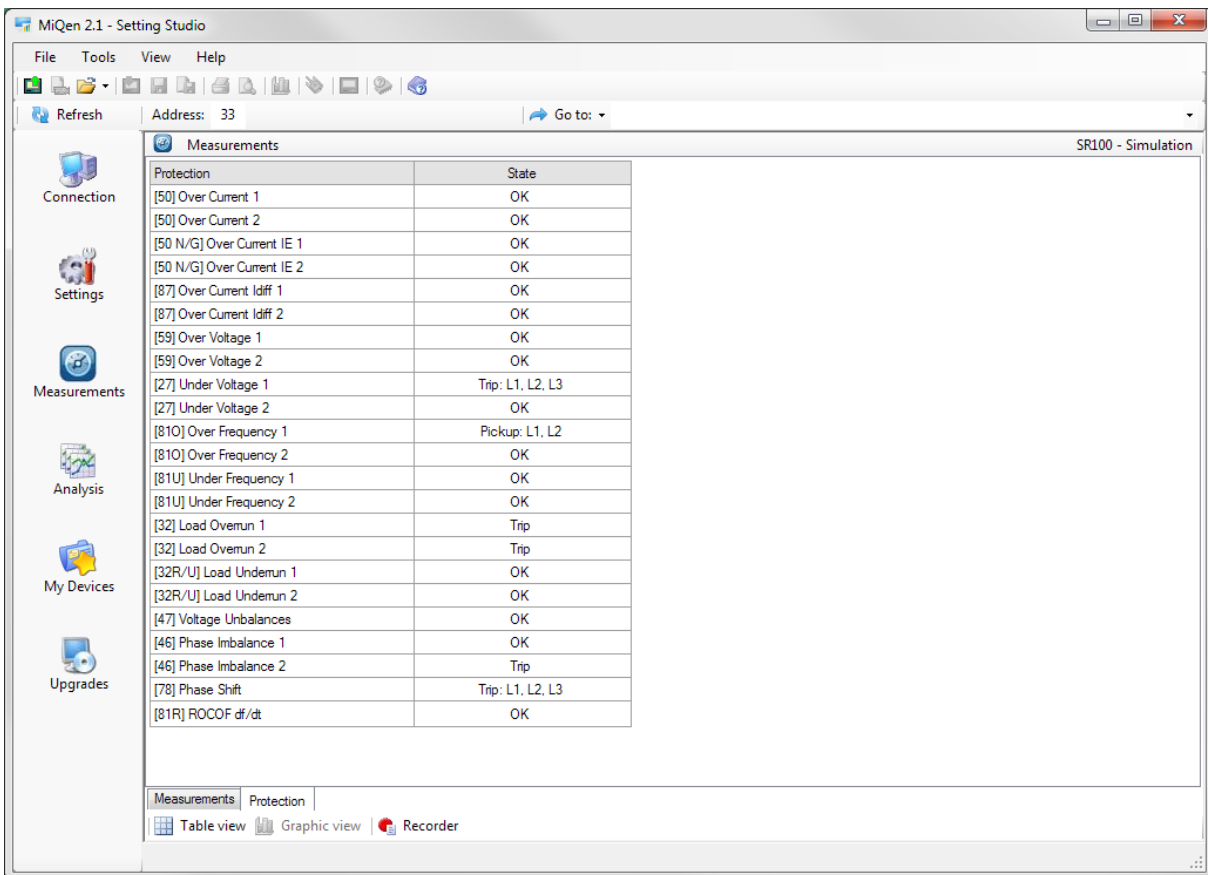

On-line data monitoring in Supervision Relay SR100 with MiQEN (example shows actual protection states)

On-line data monitoring for Supervision Relay SR100 with MiQen provides us with states of protection functions. Three different states are possible over communication (not on relay):

- Ok – normal operation without alarms
- Pickup – parameter limit has been reached
- Trip – alarm

Pickup state example:

- Over Voltage parameter limit is set to 110%; Time delay is set to 3s
- When voltage reaches parameter limit of 110%, Pickup state is displayed in MiQen.
- After 3s (time delay), pickup state changes to Trip (presuming that voltage stayed over 110% the entire time)

Reset

During normal operation of a device different counter values need to be reset from time to time.

Reset energy counter [E1/E2/E3/E4]

All or individual energy meters (counters) are reset.

Reset MD values

Set maximum demand values to zero. At the same time MD synchronization is performed.

Reset Last period MD

Set maximum demand last period values to zero. At the same time MD synchronization is performed.

Alarm relay [1/2/3/4] Off

When using MiQen, each alarm output can be reset separately.

Reset alarm statistic

Clears alarm statistic. It can be made by MiQen software under Alarm settings. This setting is only for resetting online alarms statistics displayed in MiQen software.

MEASUREMENTS

Online measurements


Online measurements can be monitored with setting and monitoring software MiQen.

Refresh rate of readings is fixed to approx. one second in MiQen.


For better overview over numerous readings, they are divided into two groups:

- Measurements
- Protection

Measurements group can represent data in visually favored graphical form or detailed tabelaric form. Latter allows freezing readings and/or copying data into various report generation software tools. Protection group can only present data in tabelaric form.

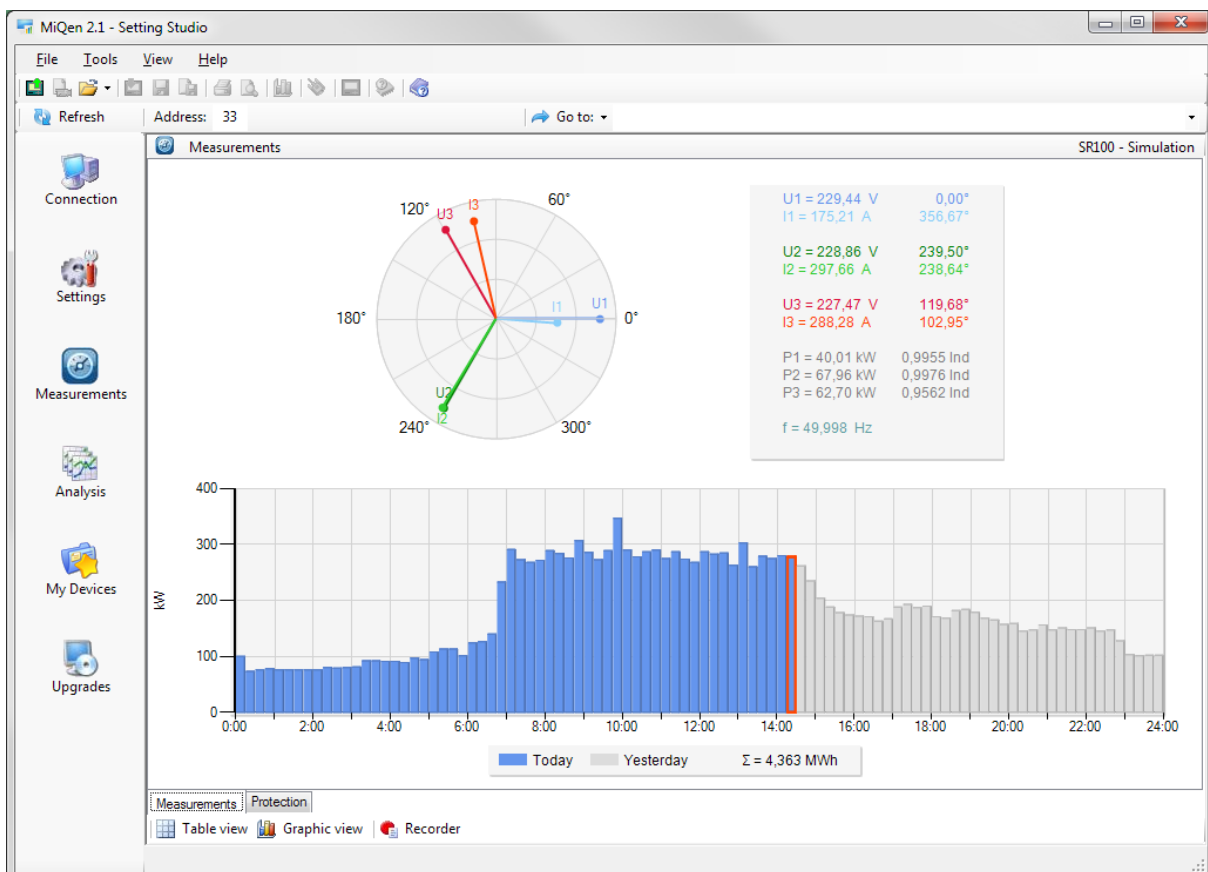

Example: Online measurements in graphical form - phasor diagram and daily total active power consumption histogram

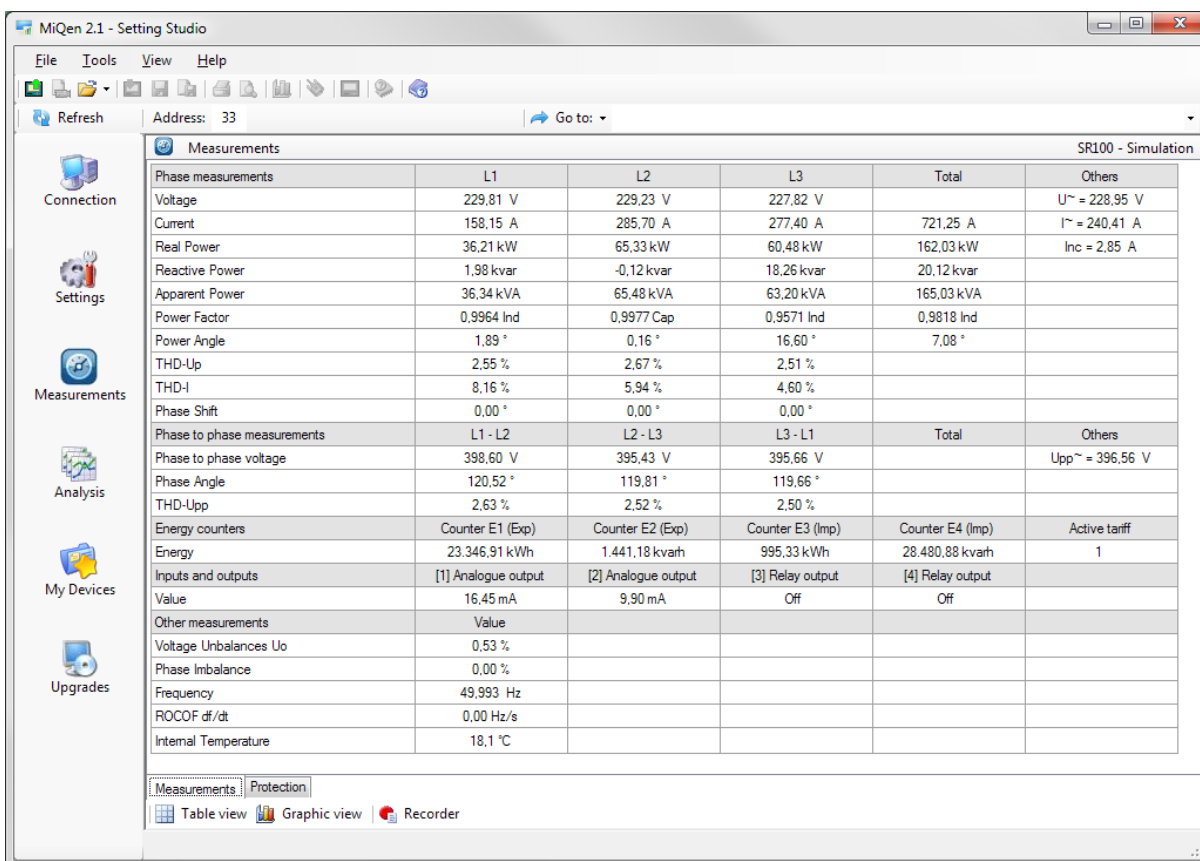

Phase measurements	L1	L2	L3	Total	Others
Voltage	229,81 V	229,23 V	227,82 V		U [~] = 228,95 V
Current	158,15 A	285,70 A	277,40 A	721,25 A	I [~] = 240,41 A
Real Power	36,21 kW	65,33 kW	60,48 kW	162,03 kW	Inc = 2,85 A
Reactive Power	1,98 kvar	-0,12 kvar	18,26 kvar	20,12 kvar	
Apparent Power	36,34 kVA	65,48 kVA	63,20 kVA	165,03 kVA	
Power Factor	0,9964 Ind	0,9977 Cap	0,9571 Ind	0,9818 Ind	
Power Angle	1,89 °	0,16 °	16,60 °	7,08 °	
THD-Up	2,55 %	2,67 %	2,51 %		
THD-I	8,16 %	5,94 %	4,60 %		
Phase Shift	0,00 °	0,00 °	0,00 °		
Phase to phase measurements	L1 - L2	L2 - L3	L3 - L1	Total	Others
Phase to phase voltage	398,60 V	395,43 V	395,66 V		U _{pp} [~] = 396,56 V
Phase Angle	120,52 °	119,81 °	119,66 °		
THD-Upp	2,63 %	2,52 %	2,50 %		
Energy counters	Counter E1 (Exp)	Counter E2 (Exp)	Counter E3 (Imp)	Counter E4 (Imp)	Active tariff
Energy	23.346,91 kWh	1.441,18 kvarh	995,33 kWh	28.480,88 kvarh	1
Inputs and outputs	[1] Analogue output	[2] Analogue output	[3] Relay output	[4] Relay output	
Value	16,45 mA	9,90 mA	Off	Off	
Other measurements	Value				
Voltage Unbalances U _o	0,53 %				
Phase Imbalance	0,00 %				
Frequency	49,993 Hz				
ROCOF df/dt	0,00 Hz/s				
Internal Temperature	18,1 °C				

Example: Online measurements in tabelaric form

Available connections

Different electric connections are described in more detail in chapter Electrical connection.

Connections are marked as follows:

- Connection 1b (1W) – Single phase connection
- Connection 3b (1W3) – Three phase, three wire connection with balanced load
- Connection 4b (1W4) – Three phase, four wire connection with balanced load
- Connection 3u (2W3) – Three phase, three wire connection with unbalanced load
- Connection 4u (3W4) – Tree phase, four wire connection with unbalanced load
- Connection IE – Tree phase, four wire connection with unbalanced load
- Connection Idiff – Tree phase, four wire connection with unbalanced load

PLEASE NOTE

Measurements and protection functions support depends on connection mode. Each current protection function uses different electrical connection mode. When specific current protection function in correlation to its connection mode is used, it is not possible to activate other two current protection functions.

If >I and >>I are chosen (4u electrical connection), monitoring of >IE and >I' is not allowed.

If >IE is chosen (IE electrical connection), monitoring of >I, >>I and >I' is not allowed.

If >I' is chosen (Idiff electrical connection), monitoring of >I, >>I and >IE is not allowed.

Please refer to chapter [Electrical connection for Supervision Relay SR100](#) on page 12 for more information/details regarding electrical wiring.

Supported measurements

Selection of supported measurements and protection functions of individual instrument is changed within the connection settings. All supported measurements can be read via communication (through MiQen) or displayed on the device display (not supported no Supervision Relay SR100).

Selection of available quantities

Available online measuring quantities and their appearance can vary according to the setup type of power network and other settings such as; average interval, maximum demand mode and reactive power calculation method. A complete list of available online measuring quantities is shown in the table below.

PLEASE NOTE

Measurements support depends on connection mode as well as the device type (built-in options). Calculated measurements (for example voltages U_1 and U_2 when 3-phase, 4-wire connection with a balanced load is used) are only informative.

PLEASE NOTE

For 3b and 3u connection mode, only phase to phase voltages are measured. The factor $\sqrt{3}$ is then applied to calculate the nominal phase voltage. For 4u connection mode the same measurements are supported as for 1b.

	<i>Basic measurements</i>	<i>Designat.</i>	<i>Unit</i>	1b	3b	3u	4b	4u
Phase	Voltage U1	U1	V	●	×	×	●	●
	Voltage U2	U2	V	×	×	×	○	●
	Voltage U3	U3	V	×	×	×	○	●
	Average voltage U \sim	U	V	×	×	×	○	●
	Current I1	I1	A	●	●	●	●	●
	Current I2	I2	A	×	○	●	○	●
	Current I3	I3	A	×	○	●	○	●
	Current In	Inc	A	×	○	○	○	●
	Total current It	I	A	●	○	○	○	●
	Average current I \sim	Iavg	A	×	○	○	○	●
	Frequency	F	Hz	●	●	●	●	●
	Active power P1	P1	W	●	×	×	●	●
	Active power P2	P2	W	×	×	×	○	●
	Active power P3	P3	W	×	×	×	○	●
	Total active power Pt	P	W	●	●	●	○	●
	Reactive power Q1	Q1	var	●	×	×	●	●
	Reactive power Q2	Q2	var	×	×	×	○	●
	Reactive power Q3	Q3	var	×	×	×	○	●
	Total reactive power Qt	Q	var	●	●	●	○	●
	Apparent power S1	S1	VA	●	×	×	●	●
	Apparent power S2	S2	VA	×	×	×	○	●
	Apparent power S3	S3	VA	×	×	×	○	●
	Total apparent power St	S	VA	●	●	●	○	●
	Power factor PF1	PF1		●	×	×	●	●
	Power factor PF2	PF2		×	×	×	○	●
	Power factor PF3	PF3		×	×	×	○	●
	Total power factor PFt	PF		●	●	●	○	●
	Power angle ϕ 1	ϕ 1	°	●	×	×	●	●
	Power angle ϕ 2	ϕ 2	°	×	×	×	○	●
	Power angle ϕ 3	ϕ 3	°	×	×	×	○	●
	Total power angle ϕ t	ϕ	°	●	●	●	○	●
	THD of phase voltage Up1	U1%	%THD	●	×	×	●	●
THD of phase voltage Up2	U2%	%THD	×	×	×	○	●	
THD of phase voltage Up3	U3%	%THD	×	×	×	○	●	
THD of phase current I1	I1%	%THD	●	●	●	●	●	
THD of phase current I2	I2%	%THD	×	○	●	○	●	
THD of phase current I3	I3%	%THD	×	○	●	○	●	

● – supported ○ – calculated × – not supported

	<i>Basic measurements</i>	<i>Designat.</i>	<i>Unit</i>	<i>1b</i>	<i>3b</i>	<i>3u</i>	<i>4b</i>	<i>4u</i>
Phase-to-phase	Phase-to-phase voltage U12	U12	V	×	●	●	○	●
	Phase-to-phase voltage U23	U23	V	×	●	●	○	●
	Phase-to-phase voltage U31	U31	V	×	●	●	○	●
	Average phase-to-phase voltage Upp~	U	V	×	●	●	○	●
	Phase-to-phase angle ϕ_{12}	ϕ_{12}	°	×	×	×	○	●
	Phase-to-phase angle ϕ_{23}	ϕ_{23}	°	×	×	×	○	●
	Phase-to-phase angle ϕ_{31}	ϕ_{31}	°	×	×	×	○	●
	THD of phase-to-phase voltage THDU12	U12%	%THD	×	●	●	○	●
	THD of phase-to-phase voltage THDU23	U23%	%THD	×	●	●	○	●
	THD of phase-to-phase voltage THDU31	U31%	%THD	×	●	●	○	●
Energy	Counters 1–4	E1, E2,	Wh VAh	●	●	●	●	●
		E3, E4	varh					
	Active tariff	Atar		●	●	●	●	●
MD Values	MD current I1	I1	A	●	●	●	●	●
	MD current I2	I2	A	×	○	●	○	●
	MD current I3	I3	A	×	○	●	○	●
	Active power total (Pt) - (positive)	Pt	W	●	●	●	●	●
	Active power total (Pt) - (negative)	Pt	W	●	●	●	●	●
	Reactive power total (Qt) - L	Qt	var	●	●	●	●	●
	Reactive power total (Qt) - C	Qt	var	●	●	●	●	●
	Apparent power total (St)	St	VA	●	●	●	●	●

● – supported ○ – calculated × – not supported

Explanation of basic concepts

Sample factor M_V

A meter measures all primary quantities with sample frequency which cannot exceed a certain number of samples in a time period. Based on these limitations (128 sample/per at 65Hz) a sample factor is calculated. A sample factor (M_V), depending on frequency of a measured signal, defines a number of periods for a measurement calculation and thus a number of harmonics considered in calculations.


Average interval MP

Due to readability of measurements from communication or LCD (not supported on Supervision Relay SR100), an Average interval (MP) is calculated with regard to the measured signal frequency. The Average interval (see chapter Average interval) defines refresh rate of displayed measurements based on a sampling factor.

Power and energy flow

Figures below show the flow of active power, reactive power and energy for 4u connection.

Display of energy flow direction can be adjusted according to connection and operation requirements by changing the Energy flow direction settings.

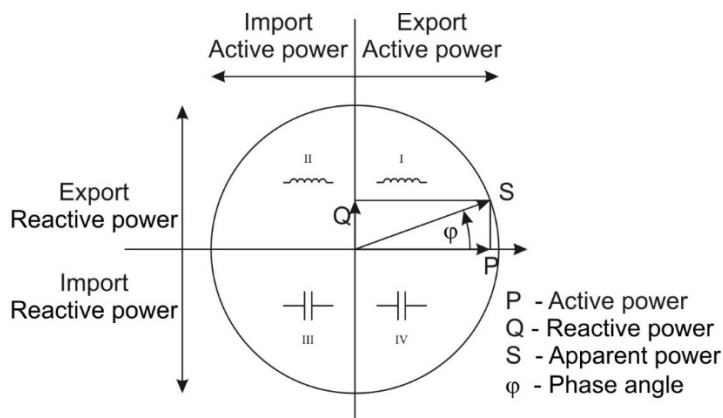

Explanation of energy flow direction

Calculation and display of measurements

This chapter deals with capture, calculation and display of all supported quantities of measurement. Only the most important equations are described; however, all of them are shown in a chapter *Equations* with additional descriptions and explanations.

PLEASE NOTE

Calculation and display of measurements depend on the connection used. For more detailed information see chapter *Survey of supported measurements*.

Present values

PLEASE NOTE

Since measurement support depends on connection mode some display groups can be combined in to one, within Measurements menu.

PLEASE NOTE

Display of present values depends on connection mode. Therefore display organization slightly differs from one connection mode to another.

All measuring instruments may not support all the measurements. For overview of supportive instruments please see Chapter [Selection of available quantities](#) on page 61

Voltage

The device measurements:

- real effective (rms) value of all phase voltages (U1, U2, U3), phase-to-phase voltages (U12, U23, U31) and neutral to earth voltage (Un).
- Average phase voltage (U_{Δ}) and average phase-to-phase voltage (U_{Δ})
- Negative and zero sequence unbalance ratio (Uu, U0)
- Phase and phase-to-phase voltage angles (φ_{1-3} , φ_{12} , φ_{13} , φ_{23})

$$U_f = \sqrt{\frac{\sum_{n=1}^N u_n^2}{N}} \quad U_{xy} = \sqrt{\frac{\sum_{n=1}^N (u_{xn} - u_{yn})^2}{N}}$$

All voltage measurements are available on communication.

Current

Device measures

- real effective (rms) value of phase currents and neutral measured current (Inm), connected to current inputs
- Neutral calculated current (Inc), Neutral error current ($I_e = |I_{nm} - I_{nc}|$),
- Phase angle between Neutral voltage and Neutral Current (ϕ_{In}), Average current (Ia) and a sum of all phase currents (It)

$$I_{RMS} = \sqrt{\frac{\sum_{n=1}^N i_n^2}{N}}$$

All current measurements are available on communication.

Active, reactive and apparent power

Active power is calculated from instantaneous phase voltages and currents. All measurements are seen on communication. For more detailed information about calculation see chapter [Appendix C - Equations](#) on page 79. There are two different methods of calculating reactive power. See chapter [Reactive power and energy calculation](#) on page 26.


Power factor and power angle

Power angle (or displacement Power Factor) is calculated as quotient of active and apparent power for each phase separately ($\cos\varphi_1$, $\cos\varphi_2$, $\cos\varphi_3$) and total power angle ($\cos\varphi_T$). It represents angle between first (base) voltage harmonic and first (base) current harmonic for each individual phase. Total power angle is calculated from total active and reactive power (see equation for Total power angle, chapter *Equations*). A symbol for a coil (positive sign) represents inductive load and a symbol for a capacitor (negative sign) represents capacitive load.

Presentation of PF:

Load	C	→		←	L
Angle [°]	-180	-90	0	+90	+180 (179.99)
PF	-1	0	1	0	-1

Example of analogue output for PF:

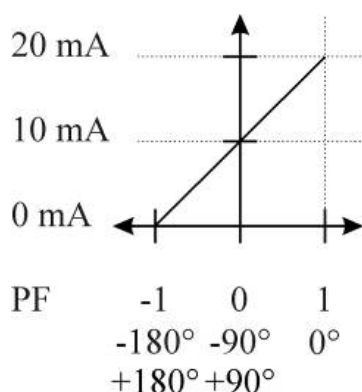

Frequency

Network frequency is calculated from time periods of measured voltage. Instrument uses synchronization method, which is highly immune to harmonic disturbances.

Device always synchronizes to a phase voltage $U1$. If signal on that phase is too low it (re)synchronizes to next phase. If all phase voltages are low (e.g. short circuit) device synchronizes to phase currents. If there is no signal present on any voltage or current channels, device shows frequency 0 Hz.

Energy counters

Three ways of Energy - counters display are available:

- by individual counter,
- by tariffs for each counter separately and

At a display of measured counter by tariffs, the sum in the upper line depends on the tariffs set in the instrument. There are two different methods of calculating reactive energy. See chapter [Reactive power and energy calculation](#) on page 26.

Additional information, how to set and define a counter quantity is explained in chapter [Energy](#) on page 32.

THD – Total harmonic distortion

THD is calculated for phase currents, phase and phase-to-phase voltages and is expressed as percent of high harmonic components regarding RMS value or relative to first harmonic.

Instrument uses measuring technique of true RMS values that assures exact measurements with the presence of high harmonics up to 63st harmonic.

Average interval for min. max. values

Min. and max. values often require special averaging period, which enables or disables detection of short measuring spikes. With this setting is possible to set averaging from 1 period to 256 periods.

TECHNICAL DATA

In following chapter all technical data regarding operation of device is presented.

Accuracy

Accuracy is presented as percentage of reading of the measured value except when it is stated as an absolute value.

Measured values	Accuracy (\pm % of range)
Current Rms	0.5
Voltage Rms P-N and P-P	0.5
Power (P, Q, S)	0.5
Power factor (PF)	0.5
Frequency (f)	10 mHz
P-N and P-P angle	0.5°
THD (U), THD (I) (0 ... 400 %)	0.5
Active energy	Class 1
Reactive energy	Class 2

Measurement inputs

Frequency

Nominal frequency range	45 ... 65 Hz, 400 Hz
Measuring frequency range	16 ... 400 Hz *

* For frequency measurement only

Voltage measurements

Measuring range (auto)	10 ... 500 V_{LN}
Nominal value (U_N)	500 V_{LN} , 866 V_{LL}
Min. voltage for sync.	Settings from starting voltage for all SYNC *
Min. measurement	Settings from starting voltage for all powers *
Max. measured value (cont.)	600 V_{LN} ; 1000 V_{LL}
Max. allowed value	1.2 $\times U_N$ permanently 2 $\times U_N$; 10 s
Consumption	$< U^2 / 3.3 \text{ M}\Omega$ per phase
Input impedance	3.3 $\text{M}\Omega$ per phase

* Starting voltage is set by setting software `MiQen>settings>general`

Current measurements

Measuring range (auto)	0.01 ... 12.5 A
Nominal current (I_N)	1 A / 5 A (defined by software setting)
Min. measurement	Settings from starting current for all powers *
Max. measured value	20 I_N ($I_N = 1$ A) 4 I_N ($I_N = 5$ A) sinusoidal
Max. allowed value (thermal) (acc. to IEC/EN 60 688)	12.5 A; continuous 20 A; 60 s 100A; 1 s
Consumption	$< I^2 \times 0.01 \Omega$ per phase

*Starting current is set by setting software `MiQen>settings>general`

Power supply

Nominal voltage AC	48 ... 276 V
Nominal frequency	45 ... 65 Hz
Nominal voltage DC	20 ... 300 V
Consumption	< 8 VA
Power-on transient current	< 20 A; 1 ms

System:

Voltage inputs can be connected either directly to low-voltage network or via a VT to higher voltage network. Current inputs can be connected either directly to low-voltage network or shall be connected to network via a corresponding CT (with standard 1 A or 5 A outputs).

Connection



Supervision relay SR100 is equipped with screw terminals for measuring voltages/current, auxiliary power supply, communication and I/O modules.

PLEASE NOTE

Stranded wire must be used with insulated end sleeve to assure firm connection.

Terminals	Max. conductor cross-sections	
Voltage inputs (4)	2.5 mm ² 4 mm ²	with pin terminal solid wire
Current inputs (6)	2.5 mm ² 4 mm ²	with pin terminal solid wire
Supply (2)	2.5 mm ² 4 mm ²	with pin terminal solid wire
Com (3), I/O (8)	2.5 mm ² 4 mm ²	with pin terminal solid wire

Connection table

Function			Connection	Comment
Measuring input	AC current	IL1	1/3	 CAT III 600V
		IL2	4/6	
		IL3	7/9	
	AC voltage	UL1	2	 CAT III 600V
		UL2	5	
		UL3	8	
UN		11		
Inputs / outputs	I/O 1	+ / ~	15	Relay output 48V DC/AC 1000 mA
		- / ~	16	
	I/O 2	+ / ~	17	
		- / ~	18	
	I/O 3	+ / ~	19	
		- / ~	20	
	I/O 4	+ / ~	21	
		- / ~	22	
Auxiliary power supply	+ / ~ (L)	13		
	- / ~ (N)	14		
Communication	RS232/RS485/CANopen	Rx / A / CAN-H	23	
		GND / NC / NC	24	
		Tx / B / CAN-L	25	

Communication

<i>Serial communication:</i>	RS232	RS485	CAN
Connection type	Direct	Network	Network
Connection terminals	screw terminals		
Function	Settings, measurements and FW upgrade		Measurements
Insulation	Protection class II, 3.3 kV _{ACRMS} 1 min		
Max. connection length	3 m	2000 m (at CAN depends on baudrate)	
Transfer mode	Asynchronous		Synchronous
Protocol	MODBUS RTU		CAN open
Transfer rate	2.4 kBaud to 115.2 kBaud		20 to 1000 kBaud
Number of nodes	/	≤ 32	≤ 127

Additionally, Supervision Relay SR100 has a USB communication port, located on the bottom under small circular plastic cover. It is intended for settings ONLY and requires NO auxiliary power supply. When connected to this communication port Supervision Relay SR100 is powered by USB.

WARNING

USB communication port is provided with only BASIC insulation and can ONLY be used unconnected to aux. supply AND power inputs.

I/O Modules

Electromechanical relay output module

Purpose	alarm, pulse, general purpose digital output
Type	Electromechanical Relay switch
Rated voltage	48 V AC/DC (+40% max)
Max. switching current	1000 mA
Contact resistance	≤ 100 mΩ (100 mA, 24 V)
Pulse (if used as pulse output)	Max. 4000 imp/hour Min. length 100 ms
Insulation voltage	
Between coil and contact	4000 VDC
Between contacts	1000 VDC
Response time	≤ 50ms

PLEASE NOTE

Supervision Relay SR100 response time:

Time from error detection to relay switching on/off is typically below 50ms.

Safety

Protection	protection class II
Pollution degree	2
Installation category	CAT III ; 600 V (meas. inputs) CAT III ; 300 V (aux. supply) Acc. to EN 61010-1
Test voltages	UAUX↔I/O, COM1: 3510 VACrms UAUX↔U, I inputs: 3510 VACrms U, I inputs↔I/O, COM1: 3510 VACrms
Enclosure material	PC/ABS Acc. to UL 94 V-0


Mechanical

Dimensions	W100 × H75 × D105 mm
Max. conductor cross section for terminals	2.5 mm ² with pin terminal 4 mm ² solid wire
Vibration withstand	7 g, 3 ... 100 Hz, 1 oct/min 10 cycles in each of three axes
Shock withstand	300 g, 8 ms pulse 6 shocks in each of three axes
Mounting	Rail mounting 35 × 15 mm acc. to DIN EN 50 022
Enclosure material	PC/ABS
Flammability	Acc. to UL 94 V-0
Housing protection	IP20
Weight	370 g

Environmental conditions

Ambient temperature	usage group III
	-10 ... 0 ... 45 ... 55 °C
	Acc. to IEC/EN 60 688
Operating temperature	-30 to +70 °C
Storage temperature	-40 to +70 °C
Average annual humidity	≤ 93% r.h.
Altitude	≤ 2000 m

Dimensional drawing

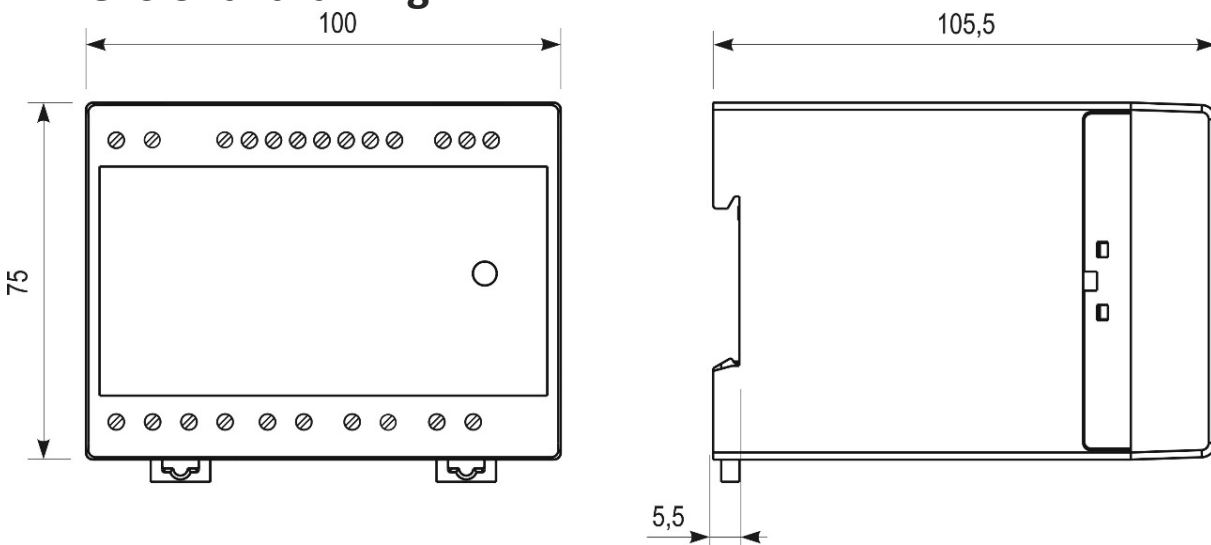

APPENDICES

Appendix A

Modbus communication protocol

Modbus is enabled via RS232 and RS485 or USB. The response is the same type as the request.

Two versions of MODBUS register tables are available:

- VERSION 1.0: Compatibility with advanced family of transducers (MT400)
- VERSION 2.0: Compatibility with previous family of transducers (MI500)

Modbus

Modbus protocol enables operation of device on Modbus networks. For device with serial communication the Modbus protocol enables point to point (for example Device to PC) communication via RS232 communication and multi drop communication via RS485 communication. Modbus protocol is a widely supported open interconnect originally designed by Modicon.

The memory reference for input and holding registers is 30000 and 40000 respectively.

VERSION 2.0:

Register table for the actual measurements

Parameter	MODBUS		
	Register		Type
	Start	End	
Reserved	30101	30104	
Frequency	30105	30106	T5
U1	30107	30108	T5
U2	30109	30110	T5
U3	30111	30112	T5
Uavg (phase to neutral)	30113	30114	T5
φ 12 (angle between U1 and U2)	30115		T17
φ 23 (angle between U2 and U3)	30116		T17
φ 31 (angle between U3 and U1)	30117		T17
U12	30118	30119	T5
U23	30120	30121	T5
U31	30122	30123	T5
Uavg (phase to phase)	30124	30125	T5
I1	30126	30127	T5
I2	30128	30129	T5
I3	30130	30131	T5
INc	30132	30133	T5
INm - reserved	30134	30135	T5
Iavg	30136	30137	T5
Σ I	30138	30139	T5
Active Power Total (Pt)	30140	30141	T6
Active Power Phase L1 (P1)	30142	30143	T6
Active Power Phase L2 (P2)	30144	30145	T6
Active Power Phase L3 (P3)	30146	30147	T6

Parameter	MODBUS		
	Register		Type
	Start	End	
Reactive Power Total (Qt)	30148	30149	T6
Reactive Power Phase L1 (Q1)	30150	30151	T6
Reactive Power Phase L2 (Q2)	30152	30153	T6
Reactive Power Phase L3 (Q3)	30154	30155	T6
Apparent Power Total (St)	30156	30157	T5
Apparent Power Phase L1 (S1)	30158	30159	T5
Apparent Power Phase L2 (S2)	30160	30161	T5
Apparent Power Phase L3 (S3)	30162	30163	T5
Power Factor Total (PFt)	30164	30165	T7
Power Factor Phase 1 (PF1)	30166	30167	T7
Power Factor Phase 2 (PF2)	30168	30169	T7
Power Factor Phase 3 (PF3)	30170	30171	T7
Power Angle Total (atan2(Pt,Qt))	30172		T17
φ 1 (angle between U1 and I1)	30173		T17
φ 2 (angle between U2 and I2)	30174		T17
φ 3 (angle between U3 and I3)	30175		T17
Internal Temperature	30181		T17
THD HARMONIC DATA			
U1 THD%	30182		T16
U2 THD%	30183		T16
U3 THD%	30184		T16
U12 THD%	30185		T16
U23 THD%	30186		T16
U31 THD%	30187		T16
I1 THD%	30188		T16
I2 THD%	30189		T16
I3 THD%	30190		T16
I/O STATUS			
Alarm Status Flags (No. 1 ... 16)	30191		T1
Alarm Status Flags (No. 17 ... 32)	30192		T1
I/O 1 Value	30193		T17
I/O 2 Value	30194		T17
I/O 3 Value	30195		T17
I/O 4 Value	30196		T17
ENERGY			
Energy Counter 1 Exponent	30401		T2
Energy Counter 2 Exponent	30402		T2
Energy Counter 3 Exponent	30403		T2
Energy Counter 4 Exponent	30404		T2
Current Active Tariff	30405		T1
Energy Counter 1	30406	30407	T3
Energy Counter 2	30408	30409	T3
Energy Counter 3	30410	30411	T3
Energy Counter 4	30412	30413	T3

Actual counter value is calculated:
Counter*10^{Exponent}

Parameter	MODBUS		
	Register		Type
	Start	End	
DEMAND VALUES			
DYNAMIC DEMAND VALUES			
Time Into Period (minutes)	30501		T1
I1	30502	30503	T5
I2	30504	30505	T5
I3	30506	30507	T5
Apparent Power Total (St)	30508	30509	T5
Active Power Total (Pt) - (positive)	30510	30511	T6
Active Power Total (Pt) - (negative)	30512	30513	T6
Reactive Power Total (Qt) - L	30514	30515	T6
Reactive Power Total (Qt) - C	30516	30517	T6
MAX DEMAND SINCE LAST RESET			
I1	30518	30519	T5
I2	30524	30525	T5
I3	30530	30531	T5
Apparent Power Total (St)	30536	30537	T5
Active Power Total (Pt) - (positive)	30542	30543	T6
Active Power Total (Pt) - (negative)	30548	30549	T6
Reactive Power Total (Qt) - L	30554	30555	T6
Reactive Power Total (Qt) - C	30560	30561	T6

Register table for the normalized actual measurements

Parameter	MODBUS		100% value
	Register	Type	
U1	30801	T16	Un
U2	30802	T16	Un
U3	30803	T16	Un
Uavg (phase to neutral)	30804	T16	Un
U12	30805	T16	Un
U23	30806	T16	Un
U31	30807	T16	Un
Uavg (phase to phase)	30808	T16	Un
I1	30809	T16	In
I2	30810	T16	In
I3	30811	T16	In
ΣI	30812	T16	It
I neutral (calculated)	30813	T16	In
I neutral (measured)	30814	T16	In
Iavg	30815	T16	In
Active Power Phase L1 (P1)	30816	T17	Pn
Active Power Phase L2 (P2)	30817	T17	Pn
Active Power Phase L3 (P3)	30818	T17	Pn
Active Power Total (Pt)	30819	T17	Pt
Reactive Power Phase L1 (Q1)	30820	T17	Pn
Reactive Power Phase L2 (Q2)	30821	T17	Pn
Reactive Power Phase L3 (Q3)	30822	T17	Pn
Reactive Power Total (Qt)	30823	T17	Pt

Parameter	MODBUS		100% value
	Register	Type	
Apparent Power Phase L1 (S1)	30824	T16	Pn
Apparent Power Phase L2 (S2)	30825	T16	Pn
Apparent Power Phase L3 (S3)	30826	T16	Pn
Apparent Power Total (St)	30827	T16	Pt
Power Factor Phase 1 (PF1)	30828	T17	1
Power Factor Phase 2 (PF2)	30829	T17	1
Power Factor Phase 3 (PF3)	30830	T17	1
Power Factor Total (PFt)	30831	T17	1
CAP/IND P. F. Phase 1 (PF1)	30832	T17	1
CAP/IND P. F. Phase 2 (PF2)	30833	T17	1
CAP/IND P. F. Phase 3 (PF3)	30834	T17	1
CAP/IND P. F. Total (PFt)	30835	T17	1
φ 1 (angle between U1 and I1)	30836	T17	100°
φ 2 (angle between U2 and I2)	30837	T17	100°
φ 3 (angle between U3 and I3)	30838	T17	100°
Power Angle Total (atan2(Pt,Qt))	30839	T17	100°
φ 12 (angle between U1 and U2)	30840	T17	100°
φ 23 (angle between U2 and U3)	30841	T17	100°
φ 31 (angle between U3 and U1)	30842	T17	100°
Frequency	30843	T17	Fn+10Hz
I1 THD%	30845	T16	100%
I2 THD%	30846	T16	100%
I3 THD%	30847	T16	100%
U1 THD%	30848	T16	100%
U2 THD%	30849	T16	100%
U3 THD%	30850	T16	100%
U12 THD%	30851	T16	100%
U23 THD%	30852	T16	100%
U31 THD%	30853	T16	100%
MAX DEMAND SINCE LAST RESET			
Active Power Total (Pt) - (positive)	30854	T16	Pt
Active Power Total (Pt) - (negative)	30855	T16	Pt
Reactive Power Total (Qt) - L	30856	T16	Pt
Reactive Power Total (Qt) - C	30857	T16	Pt
Apparent Power Total (St)	30858	T16	Pt
I1	30859	T16	In
I2	30860	T16	In
I3	30861	T16	In

Parameter	MODBUS		100% value
	Register	Type	
DYNAMIC DEMAND VALUES			
Active Power Total (Pt) - (positive)	30862	T16	Pt
Active Power Total (Pt) - (negative)	30863	T16	Pt
Reactive Power Total (Qt) - L	30864	T16	Pt
Reactive Power Total (Qt) - C	30865	T16	Pt
Apparent Power Total (St)	30866	T16	Pt
I1	30867	T16	In
I2	30868	T16	In
I3	30869	T16	In
ENERGY			
Energy Counter 1	30870	T17	Actual counter value MOD 20000 is returned
Energy Counter 2	30871	T17	
Energy Counter 3	30872	T17	
Energy Counter 4	30873	T17	
Active Tariff	30879	T1	
Internal Temperature	30880	T17	100°
DIRECTIONAL CURRENTS			
Directional Iavg	30881	T17	
Directional I1	30882	T17	
Directional I2	30883	T17	
Directional I3	30884	T17	
Frequency (wide range) 0.00 – 655.35 Hz	30891	T16	

VERSION 1.0:**Register table for the actual measurements**

Parameter	MODBUS		
	Register		Type
	Start	End	
Frequency	30049	30050	T5
U1	30057	30058	T5
U2	30059	30060	T5
U3	30061	30062	T5
Uavg (phase to neutral)	30063	30064	T5
φ 12 (angle between U1 and U2)	30065		T17
φ 23 (angle between U2 and U3)	30066		T17
φ 31 (angle between U3 and U1)	30067		T17
U12	30068	30069	T5
U23	30070	30071	T5
U31	30072	30073	T5
Uavg (phase to phase)	30074	30075	T5
I1	30076	30077	T5
I2	30078	30079	T5
I3	30080	30081	T5
INc	30082	30083	T5
INm - reserved	30084	30085	T5
Iavg	30086	30087	T5
Σ I	30088	30089	T5
Active Power Total (Pt)	30090	30091	T6
Active Power Phase L1 (P1)	30092	30093	T6
Active Power Phase L2 (P2)	30094	30095	T6
Active Power Phase L3 (P3)	30096	30097	T6

Parameter	MODBUS		
	Register		Type
	Start	End	
Reactive Power Total (Qt)	30098	30099	T6
Reactive Power Phase L1 (Q1)	30100	30101	T6
Reactive Power Phase L2 (Q2)	30102	30103	T6
Reactive Power Phase L3 (Q3)	30104	30105	T6
Apparent Power Total (St)	30106	30107	T5
Apparent Power Phase L1 (S1)	30108	30109	T5
Apparent Power Phase L2 (S2)	30110	30111	T5
Apparent Power Phase L3 (S3)	30112	30113	T5
Power Factor Total (PFt)	30114	30115	T7
Power Factor Phase 1 (PF1)	30116	30117	T7
Power Factor Phase 2 (PF2)	30118	30119	T7
Power Factor Phase 3 (PF3)	30120	30121	T7
Power Angle Total (atan2(Pt,Qt))	30122		T17
φ 1 (angle between U1 and I1)	30123		T17
φ 2 (angle between U2 and I2)	30124		T17
φ 3 (angle between U3 and I3)	30125		T17
Internal Temperature	30126		T17
THD HARMONIC DATA			
U1 THD%	30639		T16
U2 THD%	30640		T16
U3 THD%	30641		T16
U12 THD%	30642		T16
U23 THD%	30643		T16
U31 THD%	30644		T16
I1 THD%	30645		T16
I2 THD%	30646		T16
I3 THD%	30647		T16
ENERGY			
Energy Counter 1 Exponent	30037		T2
Energy Counter 2 Exponent	30038		T2
Energy Counter 3 Exponent	30039		T2
Energy Counter 4 Exponent	30040		T2
Current Active Tariff	30133		T1
Energy Counter 1	30134	30135	T3
Energy Counter 2	30136	30137	T3
Energy Counter 3	30138	30139	T3
Energy Counter 4	30140	30141	T3

Actual counter value
is calculated:
Counter * 10^{Exponent}

Parameter	MODBUS		
	Register		Type
	Start	End	
DEMAND VALUES			
DYNAMIC DEMAND VALUES			
Time Into Period (minutes)	30174		T1
I1	30175	30176	T5
I2	30177	30178	T5
I3	30179	30180	T5
Apparent Power Total (St)	30181	30182	T5
Active Power Total (Pt) - (positive)	30183	30184	T6
Active Power Total (Pt) - (negative)	30185	30186	T6
Reactive Power Total (Qt) - L	30187	30188	T6
Reactive Power Total (Qt) - C	30189	30190	T6
MAX DEMAND SINCE LAST RESET			
I1	30207	30208	T5
Time Stamp	30209	30212	T_Time
I2	30213	30214	T5
Time Stamp	30215	30218	T_Time
I3	30219	30220	T5
Time Stamp	30221	30224	T_Time
Apparent Power Total (St)	30225	30226	T5
Time Stamp	30227	30230	T_Time
Active Power Total (Pt) - (positive)	30231	30232	T6
Time Stamp	30233	30236	T_Time
Active Power Total (Pt) - (negative)	30237	30238	T6
Time Stamp	30239	30242	T_Time
Reactive Power Total (Qt) - L	30243	30244	T6
Time Stamp	30245	30248	T_Time
Reactive Power Total (Qt) - C	30249	30250	T6
Time Stamp	30251	30254	T_Time

Register table for the normalized actual measurements

Parameter	MODBUS		100% value
	Register	Type	
U1	30801	T16	Un
U2	30802	T16	Un
U3	30803	T16	Un
Uavg (phase to neutral)	30804	T16	Un
U12	30805	T16	Un
U23	30806	T16	Un
U31	30807	T16	Un
Uavg (phase to phase)	30808	T16	Un
I1	30809	T16	In
I2	30810	T16	In
I3	30811	T16	In
ΣI	30812	T16	It
I neutral (calculated)	30813	T16	In
I neutral (measured)	30814	T16	In
Iavg	30815	T16	In
Active Power Phase L1 (P1)	30816	T17	Pn
Active Power Phase L2 (P2)	30817	T17	Pn
Active Power Phase L3 (P3)	30818	T17	Pn
Active Power Total (Pt)	30819	T17	Pt

Parameter	MODBUS		100% value
	Register	Type	
Reactive Power Phase L1 (Q1)	30820	T17	Pn
Reactive Power Phase L2 (Q2)	30821	T17	Pn
Reactive Power Phase L3 (Q3)	30822	T17	Pn
Reactive Power Total (Qt)	30823	T17	Pt
Apparent Power Phase L1 (S1)	30824	T16	Pn
Apparent Power Phase L2 (S2)	30825	T16	Pn
Apparent Power Phase L3 (S3)	30826	T16	Pn
Apparent Power Total (St)	30827	T16	Pt
Power Factor Phase 1 (PF1)	30828	T17	1
Power Factor Phase 2 (PF2)	30829	T17	1
Power Factor Phase 3 (PF3)	30830	T17	1
Power Factor Total (PFt)	30831	T17	1

All other MODBUS registers are a subject to change. For the latest MODBUS Register definitions go to ISKRA's web page www.ISKRA.eu.

100% values calculations for normalized measurements

Un =	(R40147 / R40146) * R30015 * R40149
In =	(R40145 / R40144) * R30017 * R40148
Pn =	Un*In
It =	In Connection Mode: 1b
It =	3*In Connection Modes: 3b, 4b, 3u, 4u
Pt =	Pn Connection Mode: 1b
Pt =	3*Pn Connection Modes: 3b, 4b, 3u, 4u
Fn =	R40150

Parameter	MODBUS		Values/Dependencies
	Register	Type	
Calibration voltage	30015	T4	mV
Calibration current	30017	T4	mA

Register table for the basic settings

Register	Content	Type	Ind	Values / Dependencies	Min	Max	P. Level
40143	Connection Mode	T1	0	No mode	1	5	2
			1	1b - Single Phase			
			2	3b - 3 phase 3 wire balanced			
			3	4b - 3 phase 4 wire balanced			
			4	3u - 3 phase 3 wire unbalanced			
			5	4u - 3 phase 4 wire unbalanced			
40144	CT Secondary	T4		mA			2
40145	CT Primary	T4		A/10			2
40146	VT Secondary	T4		mV			2
40147	VT Primary	T4		V/10			2
40148	Current input range (%)	T16		10000 for 100%	5.00	200.00	2
40149	Voltage input range (%)	T16		10000 for 100%	2.50	100.00	2
40150	Frequency nominal value	T1		Hz	10	1000	2

EXAMPLE of calculation using MODBUS registers and their data types:

CT Primary = R40145 (Type T4) = $10^2 \times 40 = 8028_{(16)}$ → **4000 A/10 = 400 A**
 CT Secondary = R40144 (Type T4) = $10^2 \times 50 = 8032_{(16)}$ → **5000 mA**
 Cal. Current = R30017 (Type T4) = $10^2 \times 50 = 8032_{(16)}$ → **5000 mA**
 Input range = R40148 (Type T16) = 10000 = **2710₍₁₆₎** → **100.00 %**

$I_n = (R40145 / R40144) * R30017 * R40148 = (400 / 5) * 5A * 100\% = 400A$

Data types decoding

Type	Bit mask	Description
T1		Unsigned Value (16 bit) Example: 12345 = 3039(16)
T2		Signed Value (16 bit) Example: -12345 = CFC7(16)
T3		Signed Long Value (32 bit) Example: 123456789 = 075B CD 15(16)
T4	bits # 15...14 bits # 13...00	Short Unsigned float (16 bit) Decade Exponent(Unsigned 2 bit) Binary Unsigned Value (14 bit) Example: 10000*102 = A710(16)
T5	bits # 31...24 bits # 23...00	Unsigned Measurement (32 bit) Decade Exponent(Signed 8 bit) Binary Unsigned Value (24 bit) Example: 123456*10 ⁻³ = FD01 E240(16)
T6	bits # 31...24 bits # 23...00	Signed Measurement (32 bit) Decade Exponent (Signed 8 bit) Binary Signed value (24 bit) Example: - 123456*10 ⁻³ = FDFE 1DC0(16)
T7	bits # 31...24 bits # 23...16 bits # 15...00	Power Factor (32 bit) Sign: Import/Export (00/FF) Sign: Inductive/Capacitive (00/FF) Unsigned Value (16 bit), 4 decimal places Example: 0.9876 CAP = 00FF 2694(16)
T9	bits # 31...24 bits # 23...16 bits # 15...08 bits # 07...00	Time (32 bit) 1/100s 00 - 99 (BCD) Seconds 00 - 59 (BCD) Minutes 00 - 59 (BCD) Hours 00 - 24 (BCD) Example: 15:42:03.75 = 7503 4215(16)
T10	bits # 31...24 bits # 23...16 bits # 15...00	Date (32 bit) Day of month 01 - 31 (BCD) Month of year 01 - 12 (BCD) Year (unsigned integer) 1998..4095 Example: 10, SEP 2000 = 1009 07D0(16)
T16		Unsigned Value (16 bit), 2 decimal places Example: 123.45 = 3039(16)
T17		Signed Value (16 bit), 2 decimal places Example: -123.45 = CFC7(16)
T_Str4		Text: 4 characters (2 characters for 16 bit register)
T_Str6		Text: 6 characters (2 characters for 16 bit register)
T_Str8		Text: 8 characters (2 characters for 16 bit register)
T_Str16		Text: 16 characters (2 characters for 16 bit register)
T_Str20		Text: 20 characters (2 characters for 16 bit register)

Type	Bit mask	Description
T_Str40		Text: 40 characters (2 characters for 16 bit register)
T_Time	bits # 63..56 bits # 55..48 bits # 47..40 bits # 39..32 bits # 31..24 bits # 23..16 bits # 15..00	Time and Date (64 bit) 1/100s 00 - 99 (BCD) Seconds 00 - 59 (BCD) Minutes 00 - 59 (BCD) Hours 00 - 24 (BCD) Day of month 01 - 31 (BCD) Month of year 01 - 12 (BCD) Year (unsigned integer) 1998..4095 Example: 15:42:03.75, 10. SEP 2000 stored as 7503 4215 1009 07D0(16)

APPENDIX B

OBJECT DICTIONARY OF Supervision Relay SR100

Index (hex)	Sub Index (dec)	Name	Type	Attr	Default	Comment
1000	0	Device type	U32	R	0x400191	Device with analog outputs (CiA 401)
1001	0	Error register	U8	R	0	Error bits (generic error and heartbeat error supported at EMCY message)
1002	0	Manufacturer Status register	U31	RW	0	
1005	0	COB-ID SYNC	U32	R	00000080	Device doesn't generate SYNC, 11-bit CAN-ID
1008	0	Manufacturer device name	Str	R	"ISKRA SR100"	"ISKRA SR100"
1009	0	Manufacturer hardware version	Str	R	SR100_HW0001"	126-byte ASCII string
100A	0	Manufacturer software version	Str	R	"SR100_SW0001"	126-byte ASCII string
100B	0	NODE ID	U32	RW	31	Defines Node ID of the Device
1014	0	COB-ID emergency message	U32	RW	80h + Node ID	COB-ID of the Emergency message
1016	0	Consumer heartbeat time	U32	RW	20000	The value given in multiples of 1 ms (20 s)
1017	0	Producer heartbeat time	U32	RW	10000	The value given in multiples of 1 ms (10 s)
1018	0	Identity object - Highest sub-index supported	U8	R	4	Provides general identification information of the CANopen device
	1	Vendor-ID	U32	R	1234AAAAh	Assigned uniquely to manufacturers by CiA
	2	Product code	U32	R	00000001h	Profile- or manufacturer-specific
	3	Revision number	U32	R	00000001h	Profile- or manufacturer-specific
	4	Serial number	U32	R	00000001h	Profile- or manufacturer-specific
1800		TPDO1 communication parameter				Transmit PDO used for short measurements on SR100
	0	Highest sub-index supported	U8	R	02h	
	1	COB-ID used by TPDO1	U32	W	0000 01A0	0000 0180h + Node ID (32 - 0x20 default)
	2	Transmission type	U8	R	01h	Synchronous (cyclic every sync)
1802		TPDO3 communication parameter				Transmit PDO used for long measurements on SR100
	0	Highest sub-index supported	U8	R	02h	
	1	COB-ID used by PDO	U32	W	0000 03A0	0000 0380h + Node ID (32 - 0x20 default)
	2	Transmission type	U8	RW	0Ah	Synchronous (cyclic every 10th sync)
1A00		TPDO1 mapping parameters				
	0	Number of mapped application objects in TPDO1	U8	R	2	
	1	1st application object	U32	R	23000140h	Object 0x2300, subindex 0x01, consisting of 64 bits

Index (hex)	Sub Index (dec)	Name	Type	Attr	Default	Comment
1A02		TPDO3 mapping parameters				
	0	Number of mapped application objects in TPDO3	U8	R	2	
	1	1st application object	U32	R	24000140h	Object 02400, subindex 0x01, consisting of 64 bits
2300		TPDO1 Multiplex data structure				SR100 defined entry which is transferring TPDO1 multiplexed data
	0	Number of elements	U8	R	1	Number of elements
	1	TPDO1 Mux	U64	R		8 Bytes Multiplex data for TPDO1 transfer (Byte 0 is Index, Bytes 1-6 contains multiplexed data, Byte 7 not used)
2400		TPDO3 Multiplex data structure				SR100 defined entry which is transferring TPDO1 multiplexed data
	0	Number of elements	U8	R	1	Number of elements
	1	TPDO1 Mux	U64	R		8 Bytes Multiplex data for TPDO1 transfer (Byte 0 is Index, Bytes 1-6 contains multiplexed data, Byte 7 not used)
2A00		Manufacturer specific area				CAN Open device settings area
	0	Baudrate	U8	RW	7	0=20kBd, 1=50kBd, 2=100kBd, 3=125kBd, 4=250kBd, 5=500kBd, 6=800kBd, 7=1000kBd
2B00		SDO OD Settings entries				
	0	Number of entries	U16	R	5	SR100 Protection data
	1	16 bit value	U16	R/W		Nominal Voltage (%)
	2	16 bit value	U16	R/W		Connection mode
	3	16 bit value	U16	R/W		Nominal Frequency
	4	16 bit value	U16	R/W		Assigned Output
	5	16 bit value	U16	R/W		Reserved
6400		6400h: Read analogue input 8-bit.				SR100 Alarms presented as 8-bit integer analogue input sent over TPDO1
	0	Number of entries	U8	R		
	1	analogue input 8-bit	INT8	R		Alarm: Over/under voltage 1/2
	2	analogue input 8-bit	INT8	R		Alarm: Over/under frequency 1/2
	3	analogue input 8-bit	INT8	R		Alarm: Directional power/Power underrun
	4	analogue input 8-bit	INT8	R		Imbalances
	5	analogue input 8-bit	INT8	R		Other asymmetry

Index (hex)	Sub Index (dec)	Name	Type	Attr	Default	Comment
6401		6401h: Read analogue input 16-bit				SR100 measured (normalized) data are presents as 16-bit integer analogue input sent over TPDO1 and TPDO3
	0	Number of entries	U8	R	53	
	1	analogue input 16-bit	INT16	R		U1
	2	analogue input 16-bit	INT16	R		U2
	3	analogue input 16-bit	INT16	R		U3
	4	analogue input 16-bit	INT16	R		U12
	5	analogue input 16-bit	INT16	R		U23
	6	analogue input 16-bit	INT16	R		U31
	7	analogue input 16-bit	INT16	R		I1
	8	analogue input 16-bit	INT16	R		I2
	9	analogue input 16-bit	INT16	R		I3
	10	analogue input 16-bit	INT16	R		Active Power Total (Pt)
	11	analogue input 16-bit	INT16	R		Reactive Power Total (Qt)
	12	analogue input 16-bit	INT16	R		Apparent Power Total (St)
	13	analogue input 16-bit	INT16	R		Power Factor Total (PFt)
	14	analogue input 16-bit	INT16	R		U1 THD%
	15	analogue input 16-bit	INT16	R		U2 THD%
	16	analogue input 16-bit	INT16	R		U3 THD%
	17	analogue input 16-bit	INT16	R		U12 THD%
	18	analogue input 16-bit	INT16	R		U23 THD%
	19	analogue input 16-bit	INT16	R		U31 THD%
	20	analogue input 16-bit	INT16	R		I1 THD%
	21	analogue input 16-bit	INT16	R		I2 THD%
	22	analogue input 16-bit	INT16	R		I3 THD%
	23	analogue input 16-bit	INT16	R		Voltage Unbalances
	24	analogue input 16-bit	INT16	R		Phase Imbalance
	25	analogue input 16-bit	INT16	R		Phase Shift L1
	26	analogue input 16-bit	INT16	R		Phase Shift L2
	27	analogue input 16-bit	INT16	R		Phase Shift L3
	28	analogue input 16-bit	INT16	R		ROCOF df/dt
	29	analogue input 16-bit	INT16	R		I/O 1 Value
	30	analogue input 16-bit	INT16	R		I/O 2 Value
	31	analogue input 16-bit	INT16	R		I/O 3 Value
	32	analogue input 16-bit	INT16	R		I/O 4 Value
	33	analogue input 16-bit	INT16	R		Alarm: Overvoltage 1
	34	analogue input 16-bit	INT16	R		Alarm: Overvoltage 2
	35	analogue input 16-bit	INT16	R		Alarm: Under voltage 1
	36	analogue input 16-bit	INT16	R		Alarm: Under voltage 2
	37	analogue input 16-bit	INT16	R		Alarm: Over frequency 1
	38	analogue input 16-bit	INT16	R		Alarm: Over frequency 2
	39	analogue input 16-bit	INT16	R		Alarm: Under frequency 1
	40	analogue input 16-bit	INT16	R		Alarm: Under frequency 2
	41	analogue input 16-bit	INT16	R		Alarm: Directional power 1
	42	analogue input 16-bit	INT16	R		Alarm: Directional power 2
	43	analogue input 16-bit	INT16	R		Alarm: Power underrun 1
	44	analogue input 16-bit	INT16	R		Alarm: Power underrun 2
	45	analogue input 16-bit	INT16	R		Alarm: Voltage Unbalances
	46	analogue input 16-bit	INT16	R		Alarm: Phase imbalance 1
	47	analogue input 16-bit	INT16	R		Alarm: Phase imbalance 2
	48	analogue input 16-bit	INT16	R		Reserved Alarm: Phase shift
	49	analogue input 16-bit	INT16	R		Reserved Alarm: ROCOF df/dt
	50	analogue input 16-bit	INT16	R		Reserved Alarm: Time-dependent under voltage A
	51	analogue input 16-bit	INT16	R		Reserved Alarm: Time-dependent under voltage B

Index (hex)	Sub Index (dec)	Name	Type	Attr	Default	Comment
6404		Read manufacturer specific analogue input				SR100 measured (absolute) data are represented as 32-bit float (IEEE754) analogue input sent over TPDO3
	0	Number of entries	U8	R	0x80	0-199 entries
	1	32-bit float analog input	float	R		Frequency
	2	32-bit float analog input	float	R		U1
	3	32-bit float analog input	float	R		U2
	4	32-bit float analog input	float	R		U3
	5	32-bit float analog input	float	R		Uavg (phase to neutral)
	6	32-bit float analog input	float	R		U12
	7	32-bit float analog input	float	R		U23
	8	32-bit float analog input	float	R		U31
	9	32-bit float analog input	float	R		Uavg (phase to phase)
	10	32-bit float analog input	float	R		fi12 (angle between U1 and U2)
	11	32-bit float analog input	float	R		fi23 (angle between U2 and U3)
	12	32-bit float analog input	float	R		fi31 (angle between U3 and U1)
	13	32-bit float analog input	float	R		I1
	14	32-bit float analog input	float	R		I2
	15	32-bit float analog input	float	R		I3
	16	32-bit float analog input	float	R		Active Power Phase L1 (P1)
	17	32-bit float analog input	float	R		Active Power Phase L2 (P2)
	18	32-bit float analog input	float	R		Active Power Phase L3 (P3)
	19	32-bit float analog input	float	R		Active Power Total (Pt)
	20	32-bit float analog input	float	R		Reactive Power Phase L1 (Q1)
	21	32-bit float analog input	float	R		Reactive Power Phase L2 (Q2)
	22	32-bit float analog input	float	R		Reactive Power Phase L3 (Q3)
	23	32-bit float analog input	float	R		Reactive Power Total (Qt)
	24	32-bit float analog input	float	R		Apparent Power Phase L1 (S1)
	25	32-bit float analog input	float	R		Apparent Power Phase L2 (S2)
	26	32-bit float analog input	float	R		Apparent Power Phase L3 (S3)
	27	32-bit float analog input	float	R		Apparent Power Total (St)
	28	32-bit float analog input	float	R		Power Factor Phase 1 (PF1)
	29	32-bit float analog input	float	R		Power Factor Phase 2 (PF2)
	30	32-bit float analog input	float	R		Power Factor Phase 3 (PF3)
	31	32-bit float analog input	float	R		Power Factor Total (PFt)
	32	32-bit float analog input	float	R		fi1 (angle between U1 and I1)
	33	32-bit float analog input	float	R		fi2 (angle between U2 and I2)
	34	32-bit float analog input	float	R		fi3 (angle between U3 and I3)
	35	32-bit float analog input	float	R		Power Angle Total (atan2(Pt,Qt))
	36	32-bit float analog input	float	R		Energy Counter 1
	37	32-bit float analog input	float	R		Energy Counter 2
	38	32-bit float analog input	float	R		Energy Counter 3
	39	32-bit float analog input	float	R		Energy Counter 4

TPDO1 Mapping Structure:

Supervision Relay SR100 uses multiplexed structure for data transferred inside TPDO1 and TPDO3. First byte (Byte 0) inside CAN 8-byte data field designates index of the multiplexed package being sent. TPDO1 contains 5 different packages and TPDO3 contains 50 different multiplexed packages. Bytes 1-6 inside CAN telegram data field are presenting multiplexed data. Byte 7 is never used.

CAN Byte 0	CAN Bytes 1-6	Description	Modbus address	Type (Modbus)	Type (CAN)	Multiplier
MUX index	Data bytes					to multiply the received value
0	1,2	Protocol ID, always 4600				
0	3,4	Frequency	30843	T17	int16	% of nominal Frequency
0	5,6	U1	30801	T16	int16	% of nominal Voltage
0	1,2	U2	30802	T16	int16	% of nominal Voltage
1	3,4	U3	30803	T16	int16	% of nominal Voltage
1	5,6	U12	30805	T16	int16	% of nominal Voltage
1	1,2	U23	30806	T16	int16	% of nominal Voltage
2	3,4	U31	30807	T16	int16	% of nominal Voltage
2	5,6	I1	30809	T16	int16	% of nominal Current
2	1,2	I2	30810	T16	int16	% of nominal Current
3	3,4	I3	30811	T16	int16	% of nominal Current
3	5,6	Active Power Total (Pt)	30819	T17	int16	% of nominal total Power
3	1,2	Reactive Power Total (Qt)	30823	T17	int16	% of nominal total Power
4	3,4	Apparent Power Total (St)	30827	T16	int16	% of nominal total Power
4	5,6	Power Factor Total (PFt)	30835	T17	int16	
5	1	Alarm: Overvoltage 1 triggered	37021	T1	int8 (bit 0)	Mask: H01
	1	Alarm: Overvoltage 2 triggered	37022	T1	int8 (bit 1)	Mask: H02
	1	Alarm: Undervoltage 1 triggered	37023	T1	int8 (bit 2)	Mask: H04
	1	Alarm: Undervoltage 2 triggered	37024	T1	int8 (bit 3)	Mask: H08
	1	Alarm: Overfrequency 1 triggered	37025	T1	int8 (bit 4)	Mask: H10
	1	Alarm: Overfrequency 2 triggered	37026	T1	int8 (bit 5)	Mask: H20
	1	Alarm: Underfrequency 1 triggered	37027	T1	int8 (bit 6)	Mask: H40
	1	Alarm: Underfrequency 2 triggered	37028	T1	int8 (bit 7)	Mask: H80
5	2	Alarm: Directional power 1 triggered	37029	T1	int8 (bit 0)	Mask: H01
	2	Alarm: Directional power 2 triggered	37030	T1	int8 (bit 1)	Mask: H02
	2	Alarm: Power underrun 1 triggered	37031	T1	int8 (bit 2)	Mask: H04
	2	Alarm: Power underrun 2 triggered	37032	T1	int8 (bit 3)	Mask: H08
	2	Alarm: Voltage Unbalances triggered	37033	T1	int8 (bit 4)	Mask: H10
	2	Alarm: Phase imbalance 1 triggered	37034	T1	int8 (bit 5)	Mask: H20
	2	Alarm: Phase imbalance 2 triggered	37035	T1	int8 (bit 6)	Mask: H40
	2	Reserved Alarm: Phase shift triggered	37036	T1	int8 (bit 7)	Mask: H80
5	3	Reserved Alarm: ROCOF df/dt triggered	37037	T1	int8 (bit 0)	Mask: H01

TPDO3 Mapping Structure:

CAN Byte 0	CAN Bytes 1-6	Description	Modbus address	Type (Modbus)	Type (CAN)	Multiplier (to multiply the received value with)	Unit
Mux index	Data bytes						
0	1,2	Protocol ID, always 4500					
0	3,4,5,6	Frequency	32498	T_float	float		Hz
1	1,2,3,4	U1	32500	T_float	float		V
2	1,2,3,4	U2	32502	T_float	float		V
3	1,2,3,4	U3	32504	T_float	float		V
4	1,2,3,4	Uavg (phase to neutral)	32506	T_float	float		V
5	1,2,3,4	U12	32508	T_float	float		V
6	1,2,3,4	U23	32510	T_float	float		V
7	1,2,3,4	U31	32512	T_float	float		V
8	1,2,3,4	Uavg (phase to phase)	32514	T_float	float		V
9	1,2,3,4	fi12 (angle between U1 and U2)	32578	T_float	float		°
10	1,2,3,4	fi23 (angle between U2 and U3)	32580	T_float	float		°
11	1,2,3,4	fi31 (angle between U3 and U1)	32582	T_float	float		°
12	1,2,3,4	I1	32516	T_float	float		A
13	1,2,3,4	I2	32518	T_float	float		A
14	1,2,3,4	I3	32520	T_float	float		A
15	1,2,3,4	Active Power Phase L1 (P1)	32530	T_float	float		W
16	1,2,3,4	Active Power Phase L2 (P2)	32532	T_float	float		W
17	1,2,3,4	Active Power Phase L3 (P3)	32534	T_float	float		W
18	1,2,3,4	Active Power Total (Pt)	32536	T_float	float		W
19	1,2,3,4	Reactive Power Phase L1 (Q1)	32538	T_float	float		var
20	1,2,3,4	Reactive Power Phase L2 (Q2)	32540	T_float	float		var
21	1,2,3,4	Reactive Power Phase L3 (Q3)	32542	T_float	float		var
22	1,2,3,4	Reactive Power Total (Qt)	32544	T_float	float		var
23	1,2,3,4	Apparent Power Phase L1 (S1)	32546	T_float	float		VA
24	1,2,3,4	Apparent Power Phase L2 (S2)	32548	T_float	float		VA
25	1,2,3,4	Apparent Power Phase L3 (S3)	32550	T_float	float		VA
26	1,2,3,4	Apparent Power Total (St)	32552	T_float	float		VA
27	1,2,3,4	Power Factor Phase 1 (PF1)	32562	T_float	float		
28	1,2,3,4	Power Factor Phase 2 (PF2)	32564	T_float	float		
29	1,2,3,4	Power Factor Phase 3 (PF3)	32566	T_float	float		
30	1,2,3,4	Power Factor Total (PFt)	32568	T_float	float		
31	1,2,3,4	fi1 (angle between U1 and I1)	32570	T_float	float		°
32	1,2,3,4	fi2 (angle between U2 and I2)	32572	T_float	float		°
33	1,2,3,4	fi3 (angle between U3 and I3)	32574	T_float	float		°
34	1,2,3,4	Power Angle Total (atan2(Pt,Qt))	32576	T_float	float		°
35	1,2,3,4	Energy Counter 1	32638	T_float	float		Wah
36	1,2,3,4	Energy Counter 2	32640	T_float	float		Wah
37	1,2,3,4	Energy Counter 3	32642	T_float	float		Wah
38	1,2,3,4	Energy Counter 4	32644	T_float	float		Wah
39	1,2	U1 THD%	30182	T16	int16	% of nominal value	
39	3,4	U2 THD%	30183	T16	int16	% of nominal value	
39	5,6	U3 THD%	30184	T16	int16	% of nominal value	
40	1,2	U12 THD%	30185	T16	int16	% of nominal value	
40	3,4	U23 THD%	30186	T16	int16	% of nominal value	
40	5,6	U31 THD%	30187	T16	int16	% of nominal value	
41	1,2	I1 THD%	30188	T16	int16	% of nominal value	
41	3,4	I2 THD%	30189	T16	int16	% of nominal value	
41	5,6	I3 THD%	30190	T16	int16	% of nominal value	

CAN Byte 0	CAN Bytes 1-6	Description	Modbus address	Type (Modbus)	Type (CAN)	Multiplier (to multiply the received value with)	Unit
Mux index	Data bytes						
42	1,2	Voltage Unbalances	37001	T16	int16	% of nominal value	
42	3,4	Phase Imbalance	37002	T16	int16	% of nominal value	
42	5,6	Phase Shift L1	37003	T17	int16	% of nominal value	
43	1,2	Phase Shift L2	37004	T17	int16	% of nominal value	
43	3,4	Phase Shift L3	37005	T17	int16	% of nominal value	
43	5,6	ROCOF df/dt	37006	T17	int16	% of nominal value	
44	1,2	I/O 1 Value	30193	T17	int16	0=Off, 1=On	
44	3,4	I/O 2 Value	30194	T17	int16	0=Off, 1=On	
44	5,6	I/O 3 Value	30195	T17	int16	0=Off, 1=On	
45	1,2	I/O 4 Value	30196	T17	int16	0=Off, 1=On	
45	3,4	Alarm: Overvoltage 1	37021	T1	int16	0=OK, Bit i-1=Alarm Phase i, Bit 4=Alarm Avg	
45	5,6	Alarm: Overvoltage 2	37022	T1	int16	0=OK, Bit i-1=Alarm Phase i, Bit 4=Alarm Avg	
46	1,2	Alarm: Undervoltage 1	37023	T1	int16	0=OK, Bit i-1=Alarm Phase i, Bit 4=Alarm Avg	
46	3,4	Alarm: Undervoltage 2	37024	T1	int16	0=OK, Bit i-1=Alarm Phase i, Bit 4=Alarm Avg	
46	5,6	Alarm: Overfrequency 1	37025	T1	int16	0=OK, 1=Alarm	
47	1,2	Alarm: Overfrequency 2	37026	T1	int16	0=OK, 1=Alarm	
47	3,4	Alarm: Underfrequency 1	37027	T1	int16	0=OK, 1=Alarm	
47	5,6	Alarm: Underfrequency 2	37028	T1	int16	0=OK, 1=Alarm	
48	1,2	Alarm: Directional power 1	37029	T1	int16	0=OK, 1=Alarm	
48	3,4	Alarm: Directional power 2	37030	T1	int16	0=OK, 1=Alarm	
48	5,6	Alarm: Power underrun 1	37031	T1	int16	0=OK, 1=Alarm	
49	1,2	Alarm: Power underrun 2	37032	T1	int16	0=OK, 1=Alarm	
49	3,4	Alarm: Voltage Unbalances	37033	T1	int16	0=OK, 1=Alarm	
49	5,6	Alarm: Phase imbalance 1	37034	T1	int16	0=OK, 1=Alarm	
50	1,2	Alarm: Phase imbalance 2	37035	T1	int16	0=OK, 1=Alarm	
50	3,4	Reserved Alarm: Phase shift	37036	T1	int16	0=OK, Bit i-1=Alarm Phase i	
50	5,6	Reserved Alarm: ROCOF df/dt	37037	T1	int16	0=OK, 1=Alarm	

APPENDIX C

Equations

Definitions of symbols

No	Symbol	Definition
1	MP	Average interval
2	U _f	Phase voltage (U ₁ , U ₂ or U ₃)
3	U _{ff}	Phase-to-phase voltage (U ₁₂ , U ₂₃ or U ₃₁)
4	N	Total number of samples in a period
5	n	Sample number (0 ≤ n ≤ N)
6	x, y	Phase number (1, 2 or 3)
7	i _n	Current sample n
8	u _{fn}	Phase voltage sample n
9	u _{ffn}	Phase-to-phase voltage sample n
10	φ _f	Power angle between current and phase voltage f (φ ₁ , φ ₂ or φ ₃)
11	U _u	Voltage unbalance
12	U _c	Agreed supply voltage

Voltage

$$U_f = \sqrt{\frac{\sum_{n=1}^N u_n^2}{N}}$$

Phase voltage

N – samples in averaging interval (up to 65 Hz)

$$U_{xy} = \sqrt{\frac{\sum_{n=1}^N (u_{xn} - u_{yn})^2}{N}}$$

Phase-to-phase voltage

u_x, u_y – phase voltages (U_f)

N – a number of samples in averaging interval

$$U_u = \sqrt{\frac{1 - \sqrt{3 - 6\beta}}{1 + \sqrt{3 - 6\beta}}} \cdot 100\%$$

Voltage unbalance

U_{fund} – first harmonic of phase-to-phase voltage

$$\beta = \frac{U_{12fund}^4 + U_{23fund}^4 + U_{31fund}^4}{(U_{12fund}^2 + U_{23fund}^2 + U_{31fund}^2)^2}$$

Current

$$I_{RMS} = \sqrt{\frac{\sum_{n=1}^N i_n^2}{N}}$$

Phase current

N – samples in averaging interval (up to 65 Hz)

$$I_n = \sqrt{\frac{\sum_{n=1}^N (i_{1n} + i_{2n} + i_{3n})^2}{N}}$$

Neutral current

i – n sample of phase current (1, 2 or 3)

N – samples in averaging interval (up to 65 Hz)

Power

$$P_f = \frac{1}{N} \cdot \sum_{n=1}^N (u_{fn} \cdot i_{fn})$$

Active power by phases

N – a number of periods

n – index of sample in a period

f – phase designation

$$P_t = P_1 + P_2 + P_3$$

Total active power

t – total power

1, 2, 3 – phase designation

$$\text{Sign}Q_f(\varphi)$$

$$\varphi \in [0^\circ - 180^\circ] \Rightarrow \text{Sign}Q_f(\varphi) = +1$$

$$\varphi \in [180^\circ - 360^\circ] \Rightarrow \text{Sign}Q_f(\varphi) = -1$$

Reactive power sign

Q_f – reactive power (by phases)

φ – power angle

$$S_f = U_f \cdot I_f$$

Apparent power by phases

U_f – phase voltage

I_f – phase current

$$S_t = S_1 + S_2 + S_3$$

Total apparent power

S_t – apparent power by phases

$$Q_f = \text{Sign}Q_f(\varphi) \cdot \sqrt{S_f^2 - P_f^2}$$

Reactive power by phases

S_f – apparent power by phases

P_f – active power by phases

$$Q_f = \frac{1}{N} \cdot \sum_{n=1}^N (u_{fn} \times i_{f[n+N/4]})$$

Reactive power by phases (displacement method)

N – a number of samples in a period

n – sample number ($0 \leq n \leq N$)

f – phase designation

$$Q_t = Q_1 + Q_2 + Q_3$$

Total reactive power

Q_t – reactive power by phases

$$\varphi_s = \arctan 2(P_t, Q_t)$$

$$\varphi_s = [-180^\circ, 179,99^\circ]$$

Total power angle

P_t – total active power

Q_t – total reactive power

$$PF = \frac{|P|}{S}$$

Distortion power factor

P – active power

S – apparent power

THD, TDD

$$I_f THD(\%) = \frac{\sqrt{\sum_{n=2}^{63} I_n^2}}{I_1} \cdot 100$$

Current THD

I_1 – value of first harmonic

n – number of harmonic

$$U_f THD(\%) = \frac{\sqrt{\sum_{n=2}^{63} U_{fn}^2}}{U_{f1}} \cdot 100$$

Phase voltage THD

U_1 – value of first harmonic

n – number of harmonic

$$U_{ff} THD(\%) = \frac{\sqrt{\sum_{n=2}^{63} U_{ffn}^2}}{U_{ff1}} \cdot 100$$

Phase-to-phase voltage THD

U_1 – value of first harmonic

n – number of harmonic

Energy

Price in tariff = Price $\cdot 10^{\text{Tarif price exponent}}$

Total exponent of tariff price and energy price in all tariffs

Printed in Slovenia • Subject to change without notice • GB K 22.496.520



Iskra, d.d.

Stegne 21

SI-1000 Ljubljana

Slovenia

Tel.: +386 1 51 31 000

Fax: +386 1 51 11 532

www.iskra.eu

info@iskra.eu